

Asbestos Register


(Hazardous Materials and Risk Assessment)

| | |
|-------------------------------|--|
| School: | Forest Lodge Public School (1932) |
| Region: | Sydney AMU |
| State Electorate: | Balmain |
| Local Government Area: | Sydney |

| | |
|--------------------------|--------------------------|
| Last Reviewed By: | AECOM 29-OCT-2014 |
| Last Revised By: | |

| | |
|--|-----------|
| Historical Fibro In Grounds Investigations/Events | No |
| <p>No previous investigations have been recorded against the school. However, asbestos containing materials maybe present in grounds from time to time and caution must be exercised prior to any grounds disturbance.</p> | |

1932 - Forest Lodge Public School
Site Plan (11877)

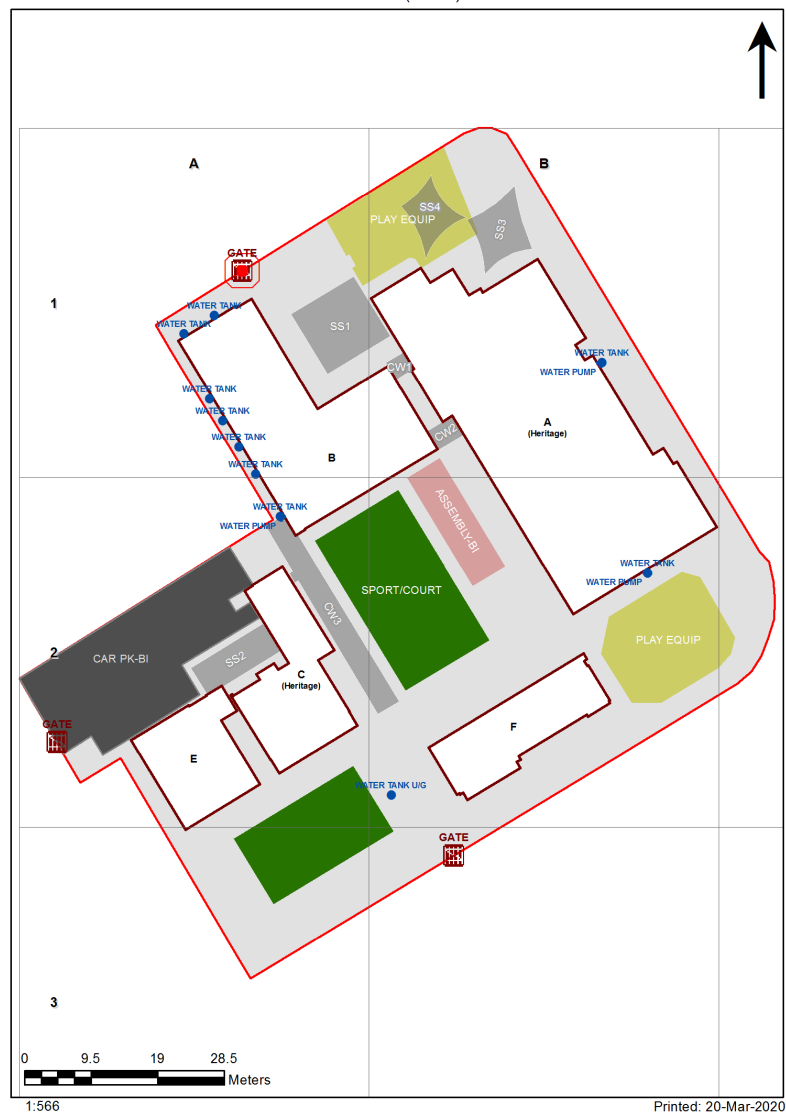

1:566

Printed: 20-Mar-2020

Preface to Asbestos Register

Limitations

Asbestos Registers established (first surveyed 2007/08) and maintained for the Department of Education (DoE) are limited in extent, in that:

1. All inspections and surveys of materials and finishes in DoE facilities are non-disturbance, with
2. Samples undertaken by hygienist to determine whether a sample is an Asbestos Containing Material (ACM),
3. The hygienist may apply a single sample to like materials within a space and adjoining spaces, but not normally between buildings,
4. Successive inspections have reduced any inconclusive records such as 'assumed asbestos' in difficult to access areas, by undertaking additional sampling with lifting devices.
5. In compliance with WHS Act 2011 and WHS Regulations 2017, additional inspections have been undertaken in ceiling spaces and sub-floor areas where access is possible.
 - o Where the ground floor is slab on ground, no inspection is made beneath the slab.
 - o Where fibro fragments (ACM taken for sampling) are located in ceiling spaces or sub floor voids air monitoring is normally undertaken at time of sampling, and clearance undertaken as soon as practicable.
6. No attempt has been made to identify any ACM that is hidden from view or encapsulated within
 - o Any wall cavity
 - o Sub floor area, particularly formwork for slabs in/on ground,
 - o Services (that may use ACM) such as: pipe lagging, asbestos cement pipes, flues.
7. All known ACM in Grounds (Fibro in Grounds) is made available in associated site specific asbestos management plans in DoE electronic files.
Notwithstanding information provided, ACM may be present in grounds from time to time and caution must be exercised prior to any grounds disturbance.

Use of the Asbestos Register

Prior to any disturbance works being undertaken in a building to which this asbestos register applies it will be necessary to confirm the extent of any ACM by a disturbance investigation:

- If the building was built prior to 2003
- If any ACM has been identified in the Asbestos Register for the building.

Update of Asbestos Registers

Asbestos Register Data is updated regularly by the DoE Hygienist Panel via the Online Asbestos Register Tool (Managed by Business Systems, School Infrastructure NSW). Internal users can view the latest edition of the Asbestos Register in the AMS.

Please note: The Department's external website may not contain the latest revision of the Asbestos Register.

Notes 1: Vermiculite

- During 2018/19, all vermiculite occurrences in DoE schools identified in 2007/08, were 'composite tested' in accordance with a safe work NSW agreed procedure. This required multiple testing of all vermiculite occurrences.
- During the period 2007/08 to 2018/19, some vermiculite has been over sheeted and a warning is indicated for schools where this has happened.

Note 2: DoE website link for information is here:

<https://www.schoolinfrastructure.nsw.gov.au/about-us/working-with-us/schools-asbestos-register.html>

<https://education.nsw.gov.au/about-us/strategies-and-reports/our-reports-and-reviews/schools-asbestos-register>

Note 3: Material Condition Assessment

The material condition assessment descriptors from Section 3 of the Asbestos Management Plan (AMP) is extracted below. Please read the AMP in its entirety for further information.

3.3.2.1 Material condition assessment

The OART records the material condition of identified ACM in the following format:

| Rating | Description |
|----------------------------|--|
| Good condition (1) | For non-friable asbestos that is sealed and has no visible damage. This primarily related to asbestos cement (AC) sheet and vinyl tiles |
| Minimal damage (2) | For non-friable asbestos that has a very small amount of damage, eg hairline cracks. |
| Some damage / unsealed (3) | For non-friable asbestos with significant breakage or several small areas where material has been damaged, revealing loose asbestos fibres. Non-friable asbestos that is unsealed. |
| Poor condition (4) | For non-friable asbestos that has extensive damage. Visible asbestos debris |
| Friable asbestos (5) | Any occurrence of friable asbestos |

| Product | Material Description | Extent | Location | Material Condition | Risk Status | Remediation Priority | Result |
|--|---|--------|--------------|----------------------------|-------------|----------------------|--|
| B00A - Administration/General Learning - 1883 - Brick/Block | | | | | | | |
| Exterior | | | | | | | |
| Ceiling Voids | No Asbestos Found | | | | | | |
| Underfloor Voids | No Asbestos Found | | | | | | |
| Interior | | | | | | | |
| B00A - M0002 - Movement - 3.78 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - M0003 - Movement - 3.34 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - M0004 - Stairs - 5.16 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - M0005 - No Access - 2.05 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - M0006 - Stairs - 5.16 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - M0007 - Plant - 90.83 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - M0008 - Plant - 26.39 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0002 - Staff Toilet - 3.86 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R0004 - Deputy Principal - 12.82 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0005 - Movement - 7.34 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R0006 - Other - 8.81 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R0007 - Main Switch Board - 8.91 m2 | | | | | | | |
| Floor Coverings Res/Textile | Flat AC Sheeting | 9m2 | All surfaces | Some Damage - Unsealed (3) | Medium (2) | Low Priority (2-3) | Chrysotile (white asbestos) , Amosite (brown asbestos) |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R0008 - Movement - 16.44 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0009 - Movement - 18.17 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0010 - External Movement - 1.03 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0011 - Movement - 21.38 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0012 - External Movement - 1.12 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0013 - Other - 2.87 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0014 - Withdrawal Space - 1hb - 16.74 m2 | | | | | | | |

| | | |
|---|---|--|
| No Asbestos | | |
| B00A - R0017 - Home Base - 46.92 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R0018 - Practical Activities - 1hb - 14.53 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0019 - Cleaning Distributed Store - 4.74 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| Floor Coverings Res/Textile | Vinyl Tiles | |
| B00A - R0022 - Duplicating Workroom - 10.73 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0023 - Clerical Office - 13.32 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0024 - Movement - 2.44 m2 | | |
| No Asbestos | | |
| B00A - R0025 - Movement - 2.31 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00A - R0026 - Entry Vestibule - 21.38 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0027 - Clerical Office - 10.47 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0028 - Principal - 18.3 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0029 - Distribution Board - .66 m2 | | |
| | | Note: No inspection of live electrical installation |
| No Asbestos | | |
| B00A - R0030 - Movement - 10.81 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00A - R0031 - Interview - 11.98 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0032 - Security Store - 8.61 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00A - R0033 - Movement - 7.39 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00A - R0036 - Movement - 14.03 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0037 - Practical Activities - 1hb - 14.59 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R0038 - Withdrawal Space - 1hb - 7.97 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00A - R0039 - Home Base - 48.57 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |

| | | | | | | | |
|---|--|-----|--------------|--------------------|---------|--------------------|-----------------------------|
| B00A - R0040 - Toilets - Girls - 15.55 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| Partition Walls (Cubicles) | Compressed AC Sheet | 4m2 | All surfaces | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00A - R0041 - Toilets - Boys - 15.61 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| Partition Walls (Cubicles) | Compressed AC Sheet | 2m2 | All surfaces | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00A - R0042 - Other - .9 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0043 - Toilets - Boys/Girls - 1.91 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R0044 - Withdrawal Space - 1hb - 31.21 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0045 - Practical Activities - 1hb - 15.63 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0046 - Home Base - 48.54 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | | | | | | |
| B00A - R0047 - External Movement - 52.88 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0048 - Raised Platform - 32.89 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0049 - Movement - 24.23 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R0050 - Communal Space - 127.6 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (120 - 250 m2) - (X15) | | | | | | |
| B00A - R0051 - External Movement - 3.67 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0056 - Hall Chair Store - 16.98 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| Floor Coverings Res/Textile | Vinyl Tiles | | | | | | |
| B00A - R0057 - Staff Room - 47.99 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | | | | | | |
| B00A - R0058 - Movement - 39.14 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0059 - Lift - 2.12 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0060 - Stairs - 3.78 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0062 - Stairs - 3.81 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0063 - Movement - 11.02 m2 | | | | | | | |

| | | | | | | | |
|---|---|-----|--------------|--------------------|---------|--|-----------------------------|
| No Asbestos | | | | | | | |
| B00A - R0064 - Stairs - 3.91 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0065 - Home Base/Practical Activities - 69.81 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0066 - Toilet - Lobby - 1.1 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0067 - Staff Toilet - 1.37 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0068 - Cleaning Distributed Store - 2.11 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R0069 - Cleaning Distributed Store - 6.13 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R1001 - Movement - 3.92 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R1002 - Home Base - 47.56 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | | | | | | |
| B00A - R1003 - Home Base - 47.63 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | | | | | | |
| B00A - R1005 - Staff Toilet - 6.3 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| Partition Walls (Cubicles) | Compressed AC Sheet | 4m2 | All surfaces | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00A - R1006 - Special Programs Room - 8.19 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| Floor Coverings Res/Textile | Vinyl Tiles | | | | | | |
| B00A - R1008 - Movement - 8.41 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R1009 - Movement - 29.38 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R1010 - Security Store - 5.65 m2 | | | | | | | |
| Floor Coverings Res/Textile | Vinyl Tiles | | | | | | |
| B00A - R1011 - Security Store - 8.32 m2 | | | | | | | |
| Floor Coverings Res/Textile | Vinyl Tiles | 9m2 | All surfaces | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00A - R1012 - Distribution Board - .69 m2 | | | | | | | |
| | | | | | | Note: No inspection of live electrical installation | |
| No Asbestos | | | | | | | |
| B00A - R1013 - Deputy Principal - 12.57 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | | | | | | |
| B00A - R1014 - Cleaning Distributed Store - 3.97 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00A - R1015 - Movement - 3.73 m2 | | | | | | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | | | | | | |
| B00A - R1016 - Movement - 47.89 m2 | | | | | | | |

| | | |
|---|---|--|
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R1017 - Withdrawal Space - 1hb - 15.7 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1018 - Home Base - 47.52 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R1019 - Practical Activities - 1hb - 15.57 m2 | | |
| Floor Coverings Res/Textile | Vinyl Tiles | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1020 - Home Base Store - 15.69 m2 | | |
| No Asbestos | | |
| B00A - R1021 - Movement - 1 m2 | | |
| No Asbestos | | |
| B00A - R1022 - Practical Activities - 1hb - 15.49 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| Floor Coverings Res/Textile | Vinyl Tiles | |
| B00A - R1023 - Home Base - 48.33 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R1024 - Withdrawal Space - 1hb - 13.77 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1025 - Practical Activities - 1hb - 19.6 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1026 - Home Base - 53.64 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R1027 - Home Base - 54.03 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R1028 - Practical Activities - 1hb - 18.41 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1029 - Library Office/Workroom - 11.78 m2 | | |
| No Asbestos | | |
| B00A - R1032 - Reading Area - 8.88 m2 | | |
| No Asbestos | | |
| B00A - R1033 - Reading Area - 93.88 m2 | | |
| No Asbestos | | |
| B00A - R1034 - Movement - 16.1 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1035 - Movement - 9.71 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00A - R1036 - Movement - 12.74 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1037 - Home Base Store - 4.18 m2 | | |

| | | |
|--|---|--|
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| Floor Coverings Res/Textile | Vinyl Tiles | |
| B00A - R1038 - Withdrawal Space - 1hb - 11.71 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1039 - Home Base - 48.22 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00A - R1040 - Practical Activities - 1hb - 14.67 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00A - R1041 - Movement - 11.88 m2 | | |
| No Asbestos | | |
| B00A - R1042 - Stairs - 2.95 m2 | | |
| Non Accessible | | |
| B00A - R1043 - Stairs - 2.94 m2 | | |
| No Asbestos | | |
| B00A - R1044 - Stairs - 13.93 m2 | | |
| No Asbestos | | |
| B00A - R1045 - Special Programs Room - 19.31 m2 | | |
| No Asbestos | | |
| B00A - R1046 - Shared Study Space - 37.46 m2 | | |
| No Asbestos | | |
| B00A - R1047 - K.L.A. Store - 1.73 m2 | | |
| No Asbestos | | |
| B00A - R1048 - Practical Activities - 5.03 m2 | | |
| No Asbestos | | |
| B00A - R1049 - Toilet - Lobby - 1.84 m2 | | |
| No Asbestos | | |
| B00A - R1050 - Staff Toilet - 4.08 m2 | | |
| No Asbestos | | |
| B00B - General Learning/Pupil Facilities - 1998 - Brick/Block | | |
| Exterior | | |
| Underfloor Voids | No Asbestos Found | |
| Ceiling Voids | No Asbestos Found | |
| Interior | | |
| B00B - R0002 - Out Of School Hours Care Centre - 49.53 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00B - R0004 - Home Base - 48.84 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00B - R0006 - Home Base - 48.7 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (40 - 70 m2) - (X5) | |
| B00B - R0008 - Out Of School Hours Care Centre - 38.38 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (10 - 40 m2) - (X3) | |
| B00B - R0009 - Out Of School Hours Care Centre - 3.91 m2 | | |
| Ceiling Structures/Linings | Vermiculite - Composite Sample - (< 10 m2) - (X2) | |
| B00B - R0012 - Toilets - Boys - 10.45 m2 | | |

| | | | | | | | |
|--|---------------------|--------|---|--------------------|---------|--------------------|-----------------------------|
| Partition Walls (Cubicles) | Compressed AC Sheet | | | | | | |
| Ceiling Structures/Linings | Flat AC Sheeting | 10m2 | Upper portion | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00B - R0015 - General Assistant/Bulk Store - 9.4 m2 | | | | | | | |
| Ceiling Structures/Linings | Flat AC Sheeting | 10m2 | All surfaces | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00B - R0016 - Distribution Board - .3 m2 Note: No inspection of live electrical installation | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0020 - External Movement - 188.17 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0021 - Toilets - Girls - 27.97 m2 | | | | | | | |
| Ceiling Structures/Linings | Flat AC Sheeting | 27.5m2 | Upper portion | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| Partition Walls (Cubicles) | Compressed AC Sheet | | | | | | |
| B00B - R0022 - Toilets - Boys - 10.4 m2 | | | | | | | |
| Ceiling Structures/Linings | Compressed AC Sheet | 10.4m2 | Throughout | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| Partition Walls (Cubicles) | Compressed AC Sheet | | | | | | |
| B00B - R0023 - General Storeroom - 3.39 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0024 - Toilets - Boys - 10.63 m2 | | | | | | | |
| Ceiling Structures/Linings | Flat AC Sheeting | 10.5m2 | Upper portion | Good Condition (1) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |
| B00B - R0025 - Withdrawal Space - 1hb - 4.93 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0026 - Practical Activities - 1hb - 13.68 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0027 - Practical Activities - 1hb - 13.58 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0028 - Withdrawal Space - 1hb - 4.98 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0029 - Practical Activities - 1hb - 14 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00B - R0030 - Withdrawal Space - 1hb - 4.93 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00C - Other - After School Care/Other - Commercial - 1860 - Brick/Block | | | | | | | |
| Exterior | | | | | | | |
| Eaves Linings | Flat AC Sheeting | 40m2 | East facing, West facing, Upper portion | Good Condition (1) | Low (1) | Low Priority (2-3) | Assumed Asbestos |
| Ceiling Voids | No Asbestos Found | | | | | | |
| Underfloor Voids | Non Accessible Area | | | | | | |
| Interior | | | | | | | |
| B00C - R0004 - Movement - 1.1 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00C - R0007 - Other - 15.76 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00C - R0010 - External Movement - 30.23 m2 | | | | | | | |
| No Asbestos | | | | | | | |
| B00C - R0012 - Movement - 10.01 m2 | | | | | | | |
| Floor Coverings Res/Textile | Vinyl Tiles | 3m2 | in Cupboard Under Stairs | Minimal Damage (2) | Low (1) | Low Priority (2-3) | Chrysotile (white asbestos) |

| |
|--|
| B00C - R0018 - External Movement - 21.7 m2 |
| No Asbestos |
| B00C - R0019 - Stairs - 3.04 m2 |
| No Asbestos |
| B00C - R0020 - Stairs - 2.05 m2 |
| No Asbestos |
| B00C - R0023 - General Storeroom - .99 m2 |
| No Asbestos |
| B00C - R0026 - External Movement - 6.74 m2 |
| No Asbestos |
| B00C - R0027 - Other-After School Care - 37.56 m2 |
| No Asbestos |
| B00C - R0028 - Other-After School Care - 19.75 m2 |
| No Asbestos |
| B00C - R0029 - Out Of School Hours Care Centre - 70.17 m2 |
| No Asbestos |
| B00C - R1001 - Adjoining School - 20.17 m2 |
| No Asbestos |
| B00C - R1004 - Adjoining School - 10.29 m2 |
| No Asbestos |
| B00C - R1006 - Adjoining School - 4.93 m2 |
| No Asbestos |
| B00C - R1009 - Adjoining School - 7.44 m2 |
| No Asbestos |
| B00C - R1010 - Stairs - 2.45 m2 |
| No Asbestos |
| B00C - R1011 - Stairs - 10.48 m2 |
| No Asbestos |
| B00C - R1012 - Toilet - Lobby - 3.44 m2 |
| No Asbestos |
| B00C - R1013 - Staff Toilet - 1.6 m2 |
| No Asbestos |
| B00C - R1014 - Other-Community Use - 27.71 m2 |
| No Asbestos |
| B00C - R1015 - Other-Commercial - 34.53 m2 |
| No Asbestos |
| B00C - R2001 - Other - 25.43 m2 |
| No Asbestos |
| B00C - R2002 - Other - 6.2 m2 |
| No Asbestos |
| B00C - R2003 - Other - 15.02 m2 |
| No Asbestos |
| B00C - R2005 - Stairs - 5.61 m2 |
| No Asbestos |
| B00C - R2006 - Other-Community Use - 27.46 m2 |
| No Asbestos |
| B00E - General Learning - 2011 - Brick/Veneer |
| Exterior |
| No Asbestos |
| Interior |
| B00E - R0001 - Special Programs Room - 70.27 m2 |

| | |
|---|--|
| No Asbestos | |
| B00E - R0002 - Craft Store - 16.49 m2 | |
| No Asbestos | |
| B00E - R0003 - Access Shower/Toilet - 12.73 m2 | |
| No Asbestos | |
| B00E - R0004 - Kiln Room - 6.08 m2 | |
| No Asbestos | |
| B00E - R0005 - External Movement - 74.99 m2 | |
| No Asbestos | |
| B00F - Pupil Facilities - 2011 - Brick/Veneer | |
| Exterior | |
| No Asbestos | |
| Interior | |
| B00F - R0001 - Covered Outdoor Learning Area - 187.51 m2 | |
| No Asbestos | |
| B00F - R0002 - Sports Store - 12.01 m2 | |
| No Asbestos | |
| B00F - R0003 - General Assistant/Bulk Store - 6.2 m2 | |
| No Asbestos | |

Demountables

There are no Demountable(s) Located at this school as per the AMS records as of 09-Sep-2020