


Wee Waa High School

Monthly Noise Monitoring Mar'23


Monitoring Devices

Date Range 01 Mar 2023 - 31 Mar 2023

Device Serial	Monitoring Points
HEX-000168	41 George St

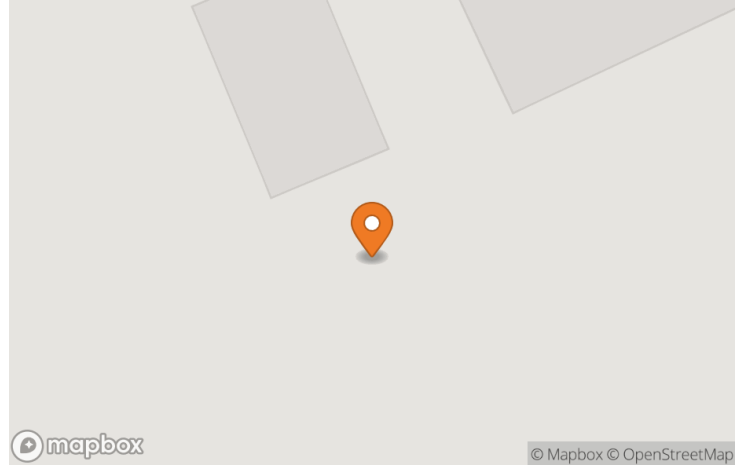

Noise Monitoring Statistics

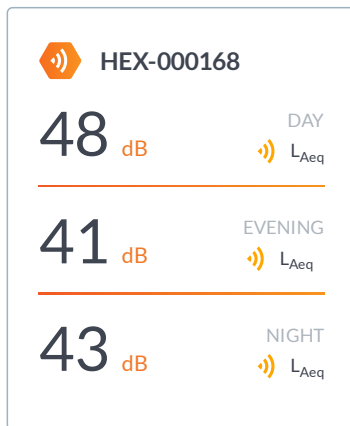

Site Activities within proximity to 41 George St

- Inground water, sprinkler, hydrant and sewer mains install.
- Levelling of soil batter adjacent to 41 George St property boundary.
- Truck movements for DfMA deliveries.
- Truck movements for concrete pours.
- Screw piling install to Building E.
- DfMA Panel install to Building A.

Machinery Used





Excavator
Water Cart
Franna

Noise Monitoring Statistics

Average daily Laeq monitored for the month was 48dB.
No exceedance of Day Noise Limit (DNL) of 75dB.

Average value across selected time period. Time of Day Periods: Day (7am to 6pm) Evening (6pm to 10pm) Night (10pm to 7am).

Noise Monitoring Graphs

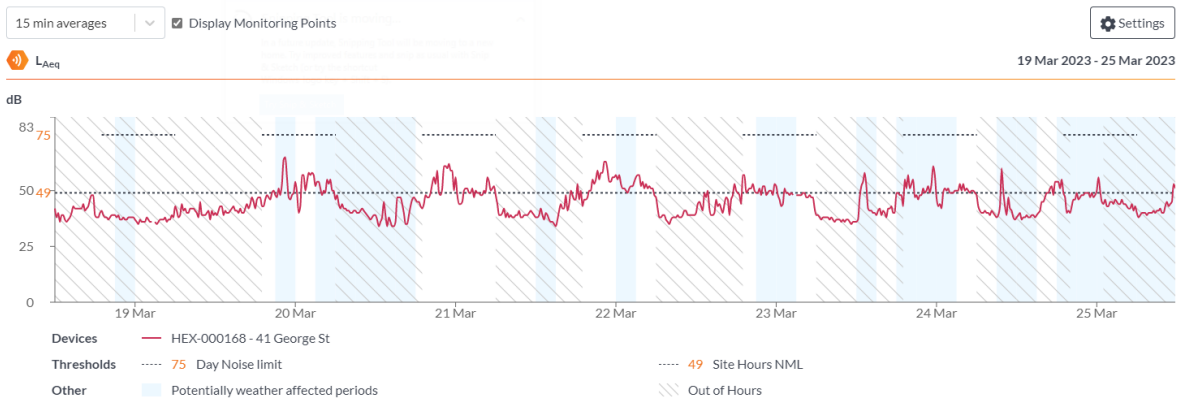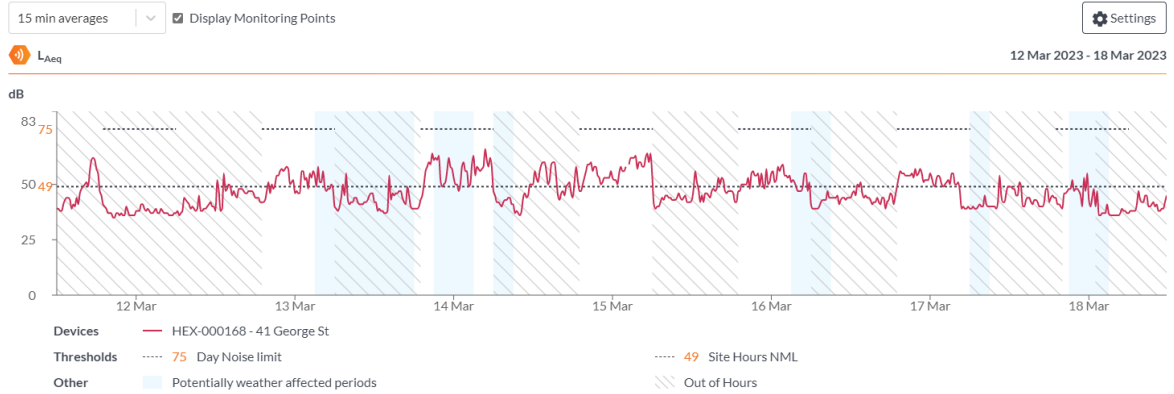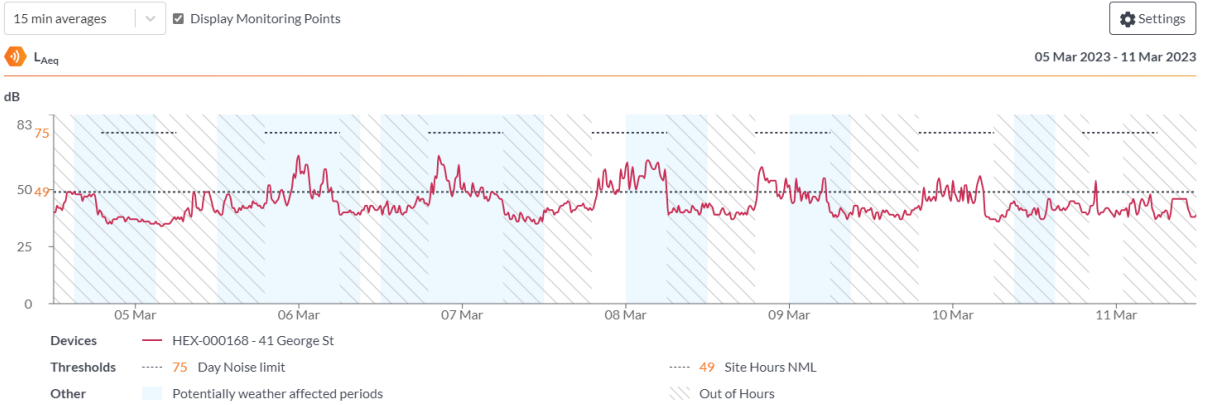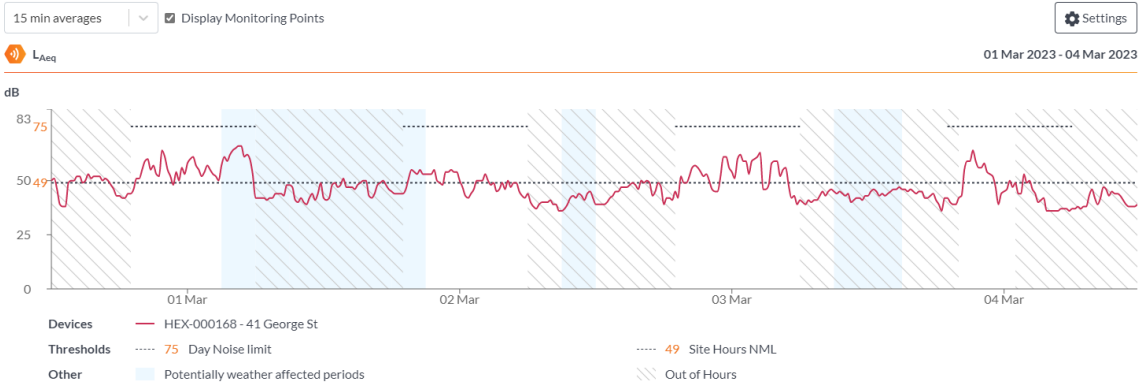


Noise Monitoring Graphs

15 min averages Display Monitoring Points

 Settings

 L_{Aeq}

26 Mar 2023 - 31 Mar 2023

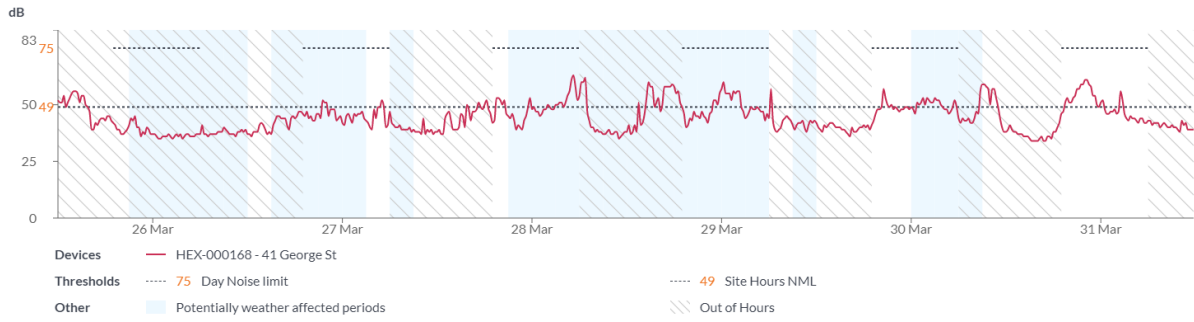

Device Details

Device Serial	Monitoring Points	Model	Calibration Date	Calibration Due
HEX-000168	41 George St	SiteHive Hexanode	04 Nov 2022	04 Nov 2024