


## Wee Waa High School

June - PCG


### Monitoring Devices

Date Range 01 Jun 2023 - 28 Jun 2023

Device Serial	Monitoring Points
HEX-000168	41 George St

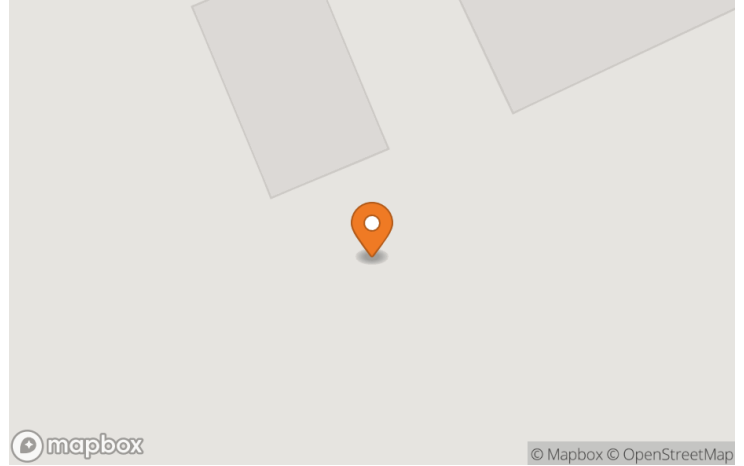

### Noise Monitoring Statistics

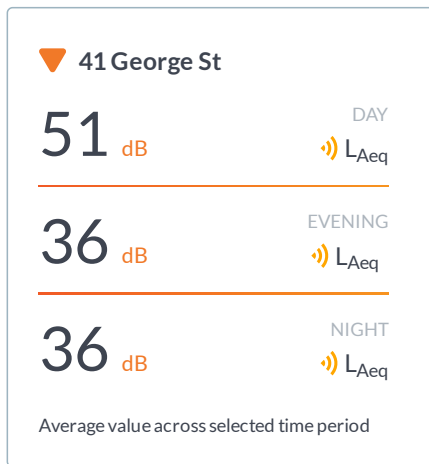

#### Site Activities within proximity to 41 George St

- Truck movements for DfMA deliveries.
- Truck movements for concrete pours.
- Excavation of walkway pad footings
- Building E panel install with crane/ Franna
- Walkway steel install - Franna bringing up materials

#### Machinery Used

- Excavator
- Water Cart
- Franna
- Trucks
- Crane

#### Noise Monitoring Statistics

Average daily Laeq monitored for the month was 51dB.




No exceedance of Day Noise Limit (DNL) of 75dB.

Note: there are various spikes throughout the month of June and this is due to the neighbour carrying out landscaping tasks right next to monitor.

Average value across selected time period. Time of Day Periods: Day (7am to 6pm) Evening (6pm to 10pm) Night (10pm to 7am).

dB	41 George St		
	L <sub>A90</sub>	L <sub>Amax</sub>	L <sub>Amin</sub>
Day	46	90	29
Evening	34	75	29
Night	34	79	28

# Noise Monitoring Graphs

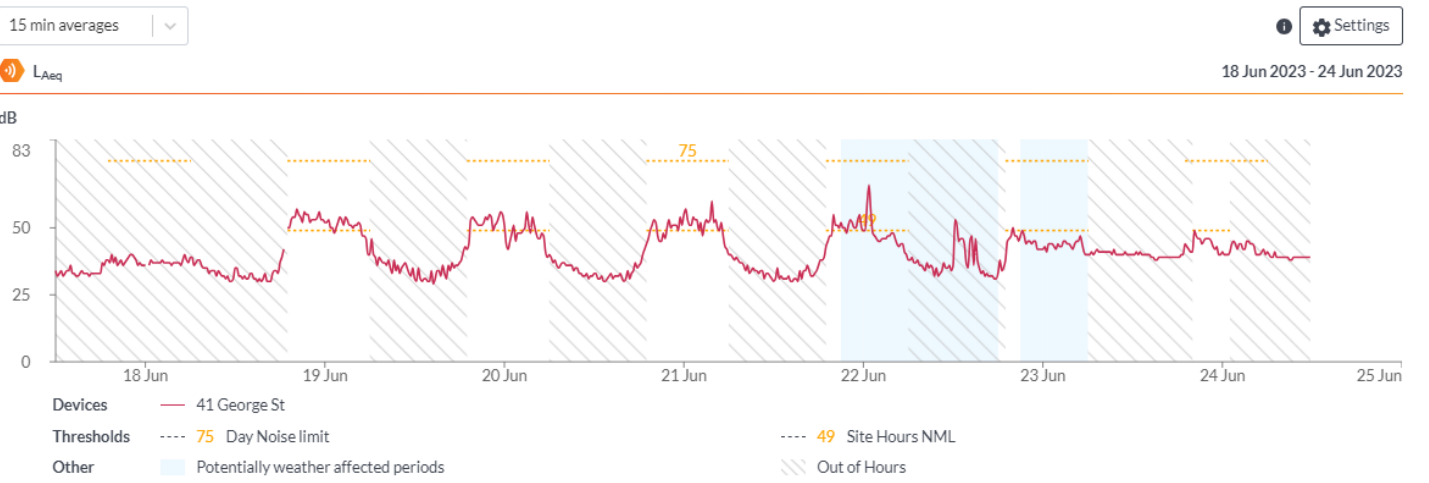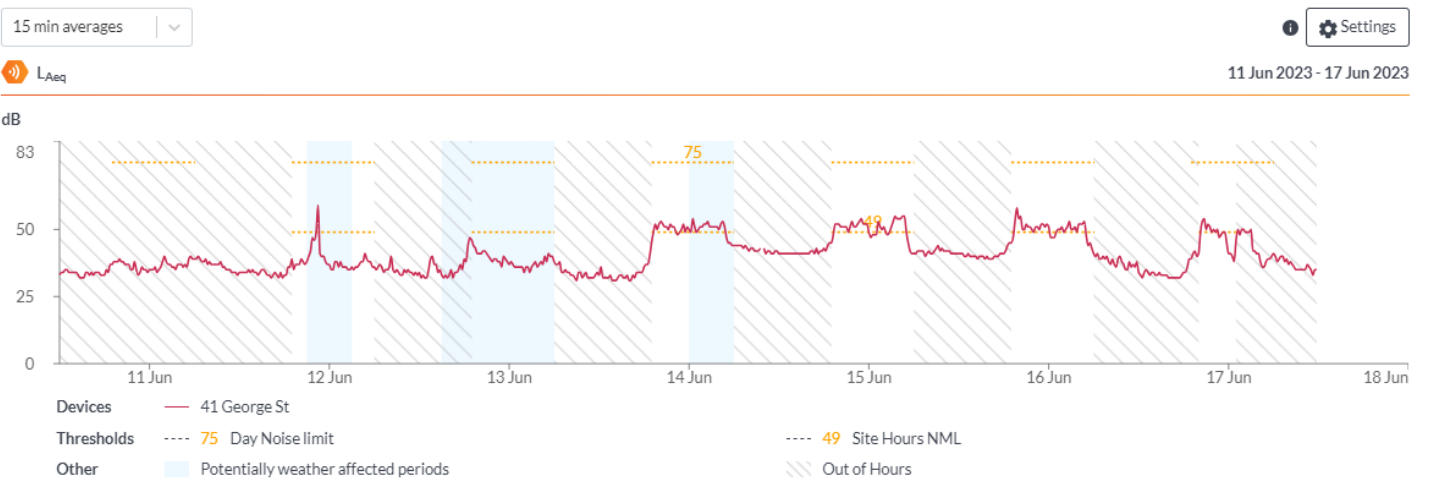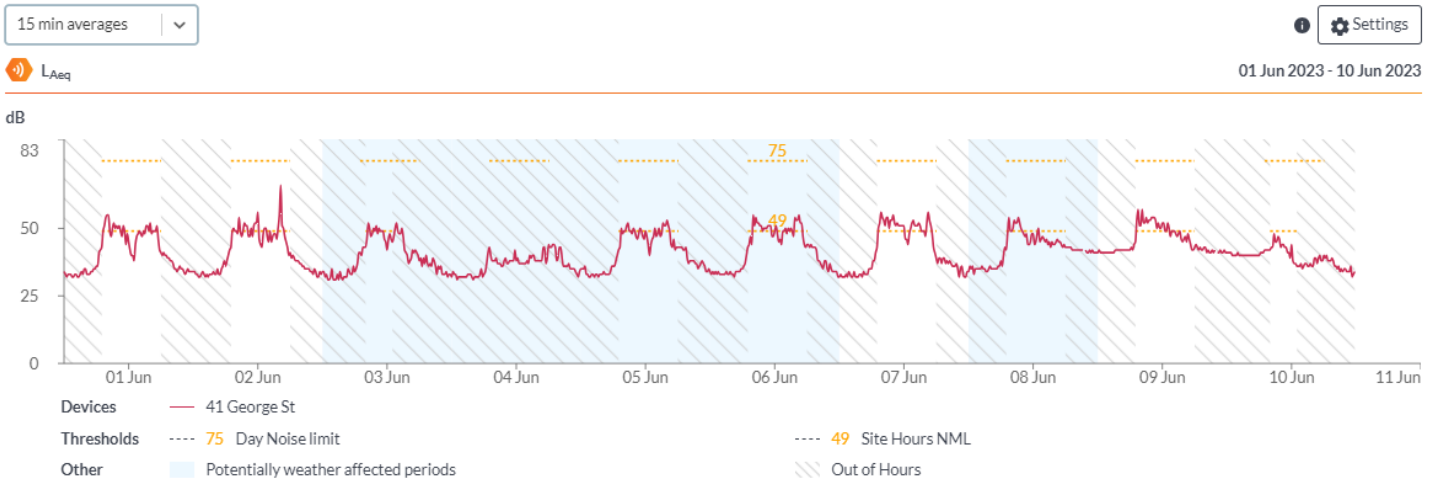

15 min averages

Settings

L<sub>Aeq</sub>

25 Jun 2023 - 28 Jun 2023

