


## Wee Waa High School

### Monitoring Devices

Date Range 01 May 2023 - 26 May 2023

Device Serial	Monitoring Points
HEX-000168	41 George St

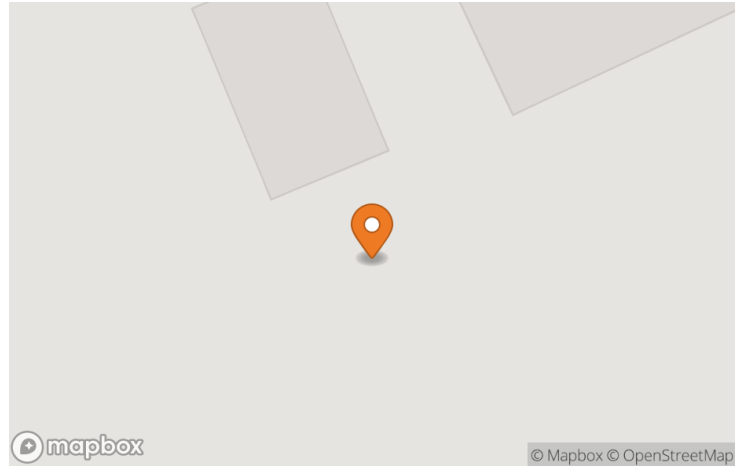

### Noise Monitoring Statistics

**HEX-000168**

**52** dB DAY L<sub>Aeq</sub>

---

**35** dB EVENING L<sub>Aeq</sub>

---

**36** dB NIGHT L<sub>Aeq</sub>

Average value across selected time period

- Site Activities within proximity to 41 George St
- Inground water, sprinkler, hydrant and sewer mains install.
  - Truck movements for DfMA deliveries.
  - Truck movements for concrete pours.
  - Screw piling install to walkways and Building E
  - Excavation of walkway pad footings
  - Concrete pour Building E

- Machinery Used
- Excavator
  - Water Cart
  - Franna
  - Trucks

Noise Monitoring Statistics  
 Average daily Laeq monitored for the month was 49dB.  
 No exceedance of Day Noise Limit (DNL) of 75dB.

Average value across selected time period. Time of Day Periods: Day (7am to 6pm) Evening (6pm to 10pm) Night (10pm to 7am).

dB	HEX-000168		
	L <sub>A90</sub>	L <sub>Amax</sub>	L <sub>Amin</sub>
Day	47	93	30
Evening	32	82	26
Night	34	74	26


## Noise Monitoring Graphs

15 min averages

Settings

L<sub>Aeq</sub>

01 May 2023 - 06 May 2023

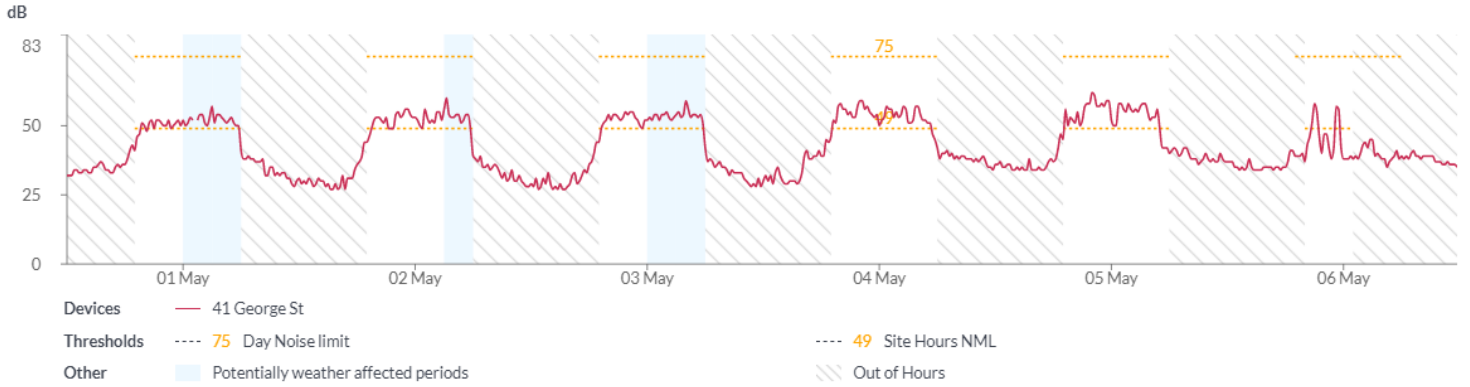


15 min averages

Settings

L<sub>Aeq</sub>

07 May 2023 - 13 May 2023

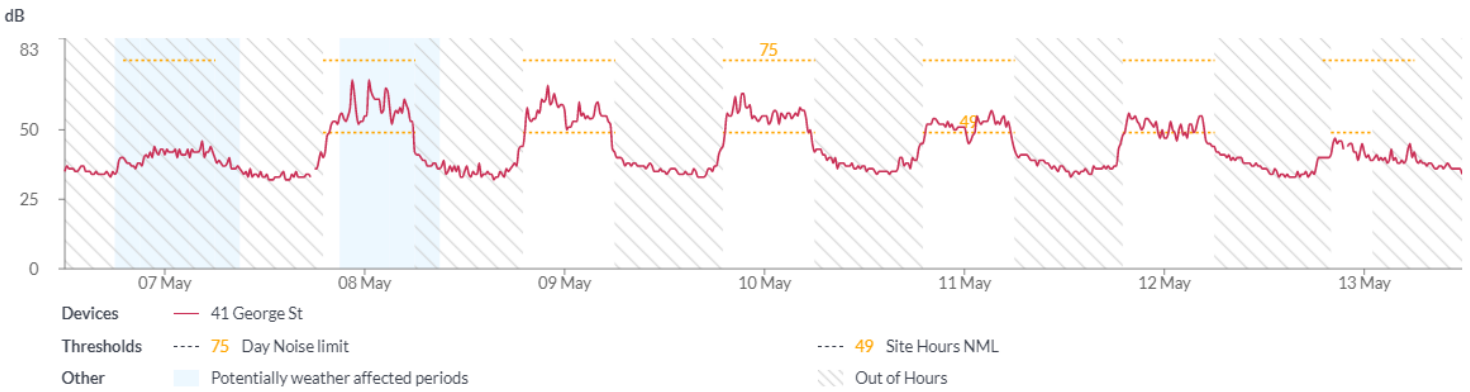


15 min averages

Settings

L<sub>Aeq</sub>

14 May 2023 - 20 May 2023

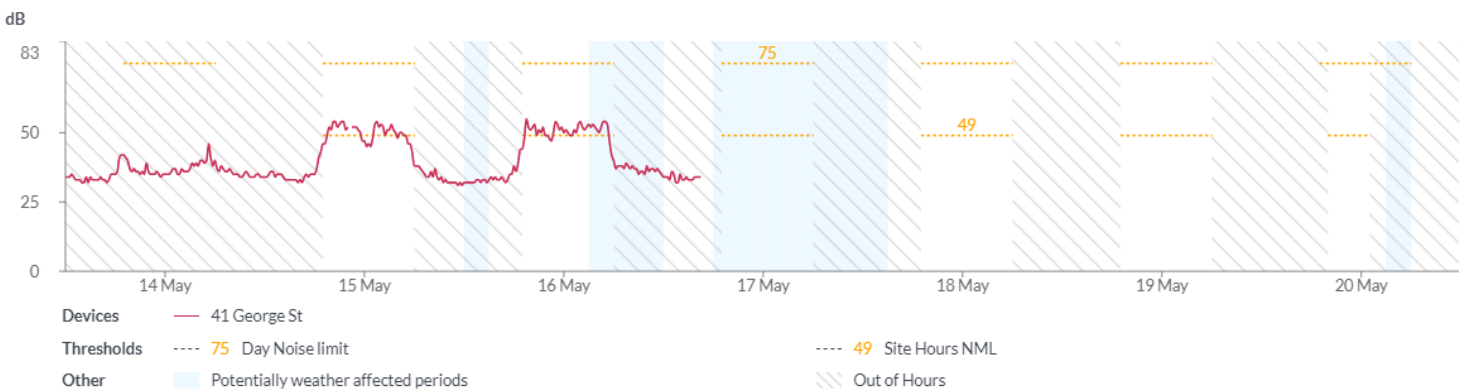

15 min averages

Settings

L<sub>Aeq</sub>

21 May 2023 - 26 May 2023

