



VENTILATION AUDIT REPORT

SCHOOL:	Alstonville High School (8578)
AMU REGION:	North Coast
STATE ELECTORATE:	Ballina
LOCAL GOVERNMENT AREA:	Ballina

8578 - Alstonville High School
Site Plan (10181)

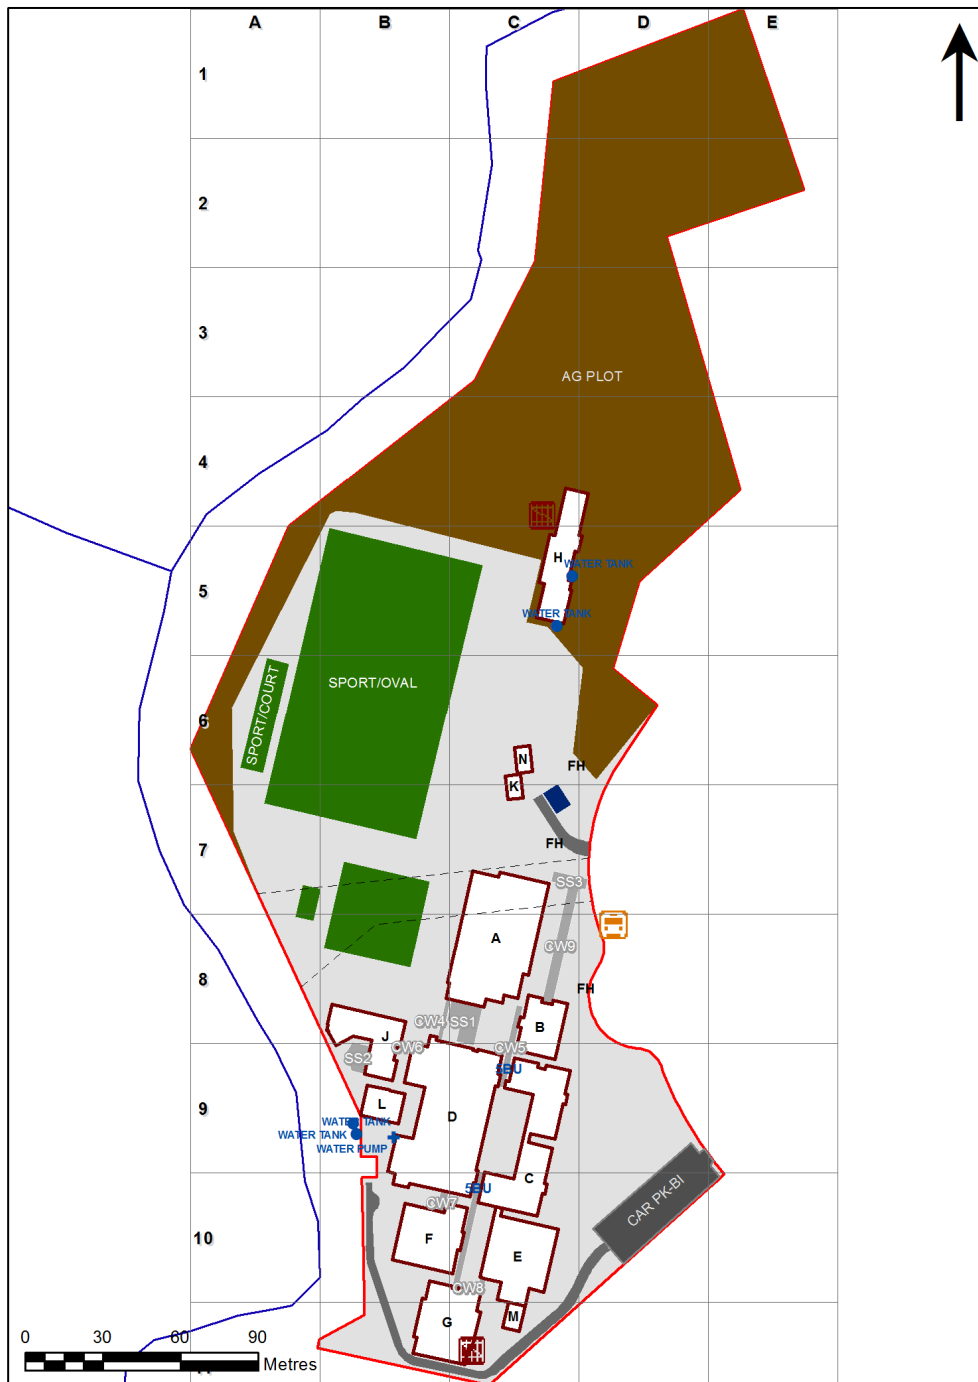

1:1,938






























Printed: 23-Apr-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Multi-Purpose Space - (465.94 SQM)	● Student Space (216)	
B00A - R0004 - Interview/Meeting - (17.34 SQM)	● Office (4)	
B00A - R0006 - Movement - (13.85 SQM)	Not Applicable	Circulation or storage space.
B00A - R0008 - Stage - (88.78 SQM)	Not Applicable	Circulation or storage space.
B00A - R0010 - Movement - (13.85 SQM)	Not Applicable	Circulation or storage space.
B00A - R0016 - Student Canteen - (56.59 SQM)	Not Applicable	Circulation or storage space.
B00A - R0017 - General Assistants - (12.44 SQM)	● Office (3)	
B00B - R0001 - Principal Office - (19.75 SQM)	● Office (4)	
B00B - R0003 - Administration - Clerical - (37.9 SQM)	● Office (9)	
B00B - R0004 - Duplicating Workroom - (26.92 SQM)	● Office (6)	
B00B - R0007 - Clinic - Boys - (14.53 SQM)	● Office (3)	
B00B - R0010 - Clinic - Girls - (15.79 SQM)	● Office (3)	
B00B - R0012 - Ancillary Staff - (22.8 SQM)	● Office (5)	
B00B - R0013 - Deputy Principal Office - (15.81 SQM)	● Office (3)	
B00B - R0014 - Pupil Entry - (11.11 SQM)	Not Applicable	Circulation or storage space.
B00B - R0015 - Deputy Principal Office - (13.87 SQM)	● Office (3)	
B00B - R0020 - Movement - (21.92 SQM)	Not Applicable	Circulation or storage space.
B00B - R0021 - Movement - (10.05 SQM)	Not Applicable	Circulation or storage space.
B00B - R0024 - Interview/Meeting - (24.07 SQM)	● Office (6)	
B00B - R0025 - Public Reception - (26.4 SQM)	Not Applicable	Circulation or storage space.
B00B - R0026 - Movement - (7.86 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Staff Study - (38.67 SQM)	● Office (9)	
B00C - R0003 - Laboratory L.S. - (81.4 SQM) - Teaching Space: 1	● Student Space (37)	
B00C - R0004 - Preparation - (18.34 SQM)	Not Applicable	Circulation or storage space.
B00C - R0006 - Laboratory L.S. - (81.39 SQM) - Teaching Space: 1	● Student Space (37)	
B00C - R0007 - Preparation - (29.83 SQM)	Not Applicable	Circulation or storage space.
B00C - R0008 - Laboratory L.S. - (81.21 SQM) - Teaching Space: 1	● Student Space (37)	
B00C - R0011 - Laboratory L.S. - (81.22 SQM) - Teaching Space: 1	● Student Space (37)	
B00C - R0013 - Preparation - (29.48 SQM)	Not Applicable	Circulation or storage space.
B00C - R0022 - Dark Room - (29.84 SQM)	● Office (7)	
B00C - R0025 - Laboratory L.S. - (99.26 SQM) - Teaching Space: 1	● Student Space (46)	
B00D - R0003 - General Learning Space - (47.29 SQM) - Teaching Space: 1	● Student Space (21)	
B00D - R0004 - General Learning Space - (47.28 SQM) - Teaching Space: 1	● Student Space (21)	
B00D - R0005 - General Learning Space - (48.12 SQM) - Teaching Space: 1	● Student Space (22)	
B00D - R0006 - Computer Learning Space - (48 SQM) - Teaching Space: 1	● Student Space (22)	
B00D - R0008 - Seminar - (15.45 SQM)	● Office (3)	
B00D - R0011 - Movement - (139.67 SQM)	Not Applicable	Circulation or storage space.
B00D - R0013 - General Learning Space - (51.85 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0014 - Senior Study - (39.41 SQM)	● Office (9)	
B00D - R0015 - Staff Study - (26.48 SQM)	● Office (6)	
B00D - R0016 - Staff Study - (52.89 SQM)	● Office (13)	
B00D - R0021 - Interview/Office - Type 1 - (12.68 SQM)	● Office (3)	
B00D - R0023 - Seminar - (15.49 SQM)	● Office (3)	
B00D - R0028 - Movement - (160.27 SQM)	Not Applicable	Circulation or storage space.
B00D - R0029 - Main Area - (151.51 SQM)	Not Applicable	Circulation or storage space.
B00D - R0038 - Movement - (12.45 SQM)	Not Applicable	Circulation or storage space.
B00D - R0041 - Movement - (5.67 SQM)	Not Applicable	Circulation or storage space.
B00D - R0043 - Tiered Learning Area - (41.87 SQM)	● Student Space (19)	
B00D - R0044 - Movement - (14.72 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R0045 - Workroom - (43.39 SQM)	Office (10)	
B00D - R0047 - Audio Visual Workroom - (23.44 SQM)	Student Space (10)	
B00D - R0048 - Main Area - (169.57 SQM)	Not Applicable	Circulation or storage space.
B00D - R0049 - Seminar - (12.49 SQM)	Office (3)	
B00D - R0050 - Seminar - (12.66 SQM)	Office (3)	
B00D - R0052 - Staff Study - (25.84 SQM)	Office (6)	
B00D - R0053 - Movement - (14.12 SQM)	Not Applicable	Circulation or storage space.
B00D - R0054 - Staff Study - (39.06 SQM)	Office (9)	
B00D - R1003 - General Learning Space - (46.87 SQM) - Teaching Space: 1	Student Space (21)	
B00D - R1004 - General Learning Space - (47.11 SQM) - Teaching Space: 1	Student Space (21)	
B00D - R1005 - General Learning Space - (48.76 SQM) - Teaching Space: 1	Student Space (22)	
B00D - R1006 - General Learning Space - (48.76 SQM) - Teaching Space: 1	Student Space (22)	
B00D - R1008 - Seminar - (15.33 SQM)	Office (3)	
B00D - R1009 - Interview/Office - Type 1 - (12.61 SQM)	Office (3)	
B00D - R1012 - Commonroom - (95.09 SQM)	Office (23)	
B00D - R1017 - Staff Study - (12.75 SQM)	Office (3)	
B00D - R1018 - Movement - (33.58 SQM)	Not Applicable	Circulation or storage space.
B00D - R1019 - General Learning Space - (51.85 SQM) - Teaching Space: 1	Student Space (24)	
B00D - R1020 - General Learning Space - (39.61 SQM) - Teaching Space: 1	Student Space (18)	
B00D - R1021 - General Learning Space - (38.41 SQM) - Teaching Space: 1	Student Space (17)	
B00D - R1022 - General Learning Space - (38.79 SQM) - Teaching Space: 1	Student Space (17)	
B00D - R1023 - Study Space - (15.56 SQM)	Not Applicable	Circulation or storage space.
B00D - R1025 - Movement - (146.27 SQM)	Not Applicable	Circulation or storage space.
B00D - R1026 - Movement - (127.68 SQM)	Not Applicable	Circulation or storage space.
B00D - R1028 - Movement - (26.48 SQM)	Not Applicable	Circulation or storage space.
B00D - R1030 - Movement - (5.67 SQM)	Not Applicable	Circulation or storage space.
B00D - R1031 - Movement - (35.05 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Movement - (44.43 SQM)	Not Applicable	Circulation or storage space.
B00E - R0002 - Metal Technology L.S. - (92.04 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0003 - Welding Area - (17.4 SQM)	Not Applicable	Circulation or storage space.
B00E - R0006 - Metal Technology Bay - (28.77 SQM)	Not Applicable	Circulation or storage space.
B00E - R0008 - Welding/Hot Metals Area - (49.76 SQM)	Not Applicable	Circulation or storage space.
B00E - R0009 - Metal Technology L.S. - (92.05 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0010 - Wood Technology L.S. - (92.05 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0011 - Wood Technology Bay - (29.05 SQM)	Not Applicable	Circulation or storage space.
B00E - R0012 - Wood Technology L.S. - (92.05 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0015 - Seminar/Technology Space - (27.75 SQM)	Office (6)	
B00E - R1001 - Movement - (5.19 SQM)	Not Applicable	Circulation or storage space.
B00E - R1002 - Staff Study - (28.08 SQM)	Office (7)	
B00F - R0005 - Staff Study - (30.09 SQM)	Office (7)	
B00F - R0006 - Food Technology L.S. - (103.71 SQM) - Teaching Space: 1	Student Space (48)	
B00F - R0007 - Preparation - (19.68 SQM)	Not Applicable	Circulation or storage space.
B00F - R0009 - Food Technology L.S. - (103.47 SQM) - Teaching Space: 1	Student Space (48)	
B00F - R0010 - Movement - (54.17 SQM)	Not Applicable	Circulation or storage space.
B00F - R0012 - Textiles Technology L.S. - (70.57 SQM) - Teaching Space: 1	Student Space (32)	
B00F - R0015 - Textiles Technology L.S. - (70.39 SQM) - Teaching Space: 1	Student Space (32)	
B00F - R0016 - Movement - (29.76 SQM)	Not Applicable	Circulation or storage space.
B00F - R1001 - Staff Study - (18.97 SQM)	Office (4)	
B00F - R1004 - Movement - (77.48 SQM)	Not Applicable	Circulation or storage space.
B00F - R1007 - Music Learning Space - (62.26 SQM) - Teaching Space: 1	Student Space (28)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00F - R1009 - Music Learning Space - (80.67 SQM) - Teaching Space: 1	 Student Space (37)	
B00G - R0001 - Art Learning Space - (60.71 SQM) - Teaching Space: 1	 Student Space (28)	
B00G - R0002 - Visual Arts Workshop - (59.16 SQM)	 Student Space (27)	
B00G - R0003 - Art Learning Space - (60.25 SQM) - Teaching Space: 1	 Student Space (27)	
B00G - R0007 - Staff Study - (18 SQM)	 Office (4)	
B00G - R0008 - Staff Study - (12.22 SQM)	 Office (3)	
B00G - R0012 - Seminar - (27.53 SQM)	 Office (6)	
B00G - R0013 - Computer Learning Space - (60.25 SQM) - Teaching Space: 1	 Student Space (27)	
B00G - R0014 - Design L.S. - (59.42 SQM) - Teaching Space: 1	 Student Space (27)	
B00G - R0015 - Art Learning Space - (60.59 SQM) - Teaching Space: 1	 Student Space (28)	
B00G - R0016 - Movement - (97.87 SQM)	Not Applicable	Circulation or storage space.
B00H - R0011 - Workroom - (57.83 SQM)	 Office (14)	
B00H - R0012 - Seminar - (42.83 SQM)	 Office (10)	
B00H - R0015 - Staff Study - (10.12 SQM)	 Office (2)	
B00J - R0001 - General Learning Space - (51.53 SQM) - Teaching Space: 1	 Student Space (23)	
B00J - R0002 - Movement - (31.75 SQM)	Not Applicable	Circulation or storage space.
B00J - R0003 - Seminar - (13.75 SQM)	 Office (3)	
B00J - R0004 - Computer Learning Space - (57.99 SQM) - Teaching Space: 1	 Student Space (26)	
B00J - R0006 - Staff Study - (9.44 SQM)	 Office (2)	
B00J - R0007 - General Learning Space - (51.46 SQM) - Teaching Space: 1	 Student Space (23)	
B00J - R0008 - General Learning Space - (51.31 SQM) - Teaching Space: 1	 Student Space (23)	
B00J - R0009 - General Learning Space - (51.67 SQM) - Teaching Space: 1	 Student Space (23)	
B00J - R1001 - General Learning Space - (48.9 SQM) - Teaching Space: 1	 Student Space (22)	
B00J - R1002 - Movement - (39.82 SQM)	Not Applicable	Circulation or storage space.
B00J - R1003 - Staff Study - (42.52 SQM)	 Office (10)	
B00J - R1006 - Interview/Office - Type 1 - (11.45 SQM)	 Office (2)	
B00J - R1008 - General Learning Space - (48.2 SQM) - Teaching Space: 1	 Student Space (22)	
B00J - R1009 - General Learning Space - (48.47 SQM) - Teaching Space: 1	 Student Space (22)	
B00J - R1010 - General Learning Space - (48.34 SQM) - Teaching Space: 1	 Student Space (22)	
B00K - R0001 - General Assistants - (52.44 SQM)	 Office (13)	
B00L - R0002 - Performance Workshop - (102.06 SQM)	 Student Space (47)	
B00N - R0001 - Gymnasium - (58.42 SQM)	 Student Space (27)	