


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Alstonville Public School (1030)</b>
<b>AMU REGION:</b>	<b>North Coast</b>
<b>STATE ELECTORATE:</b>	<b>Ballina</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Ballina</b>

1030 - Alstonville Public School  
Site Plan (13242)

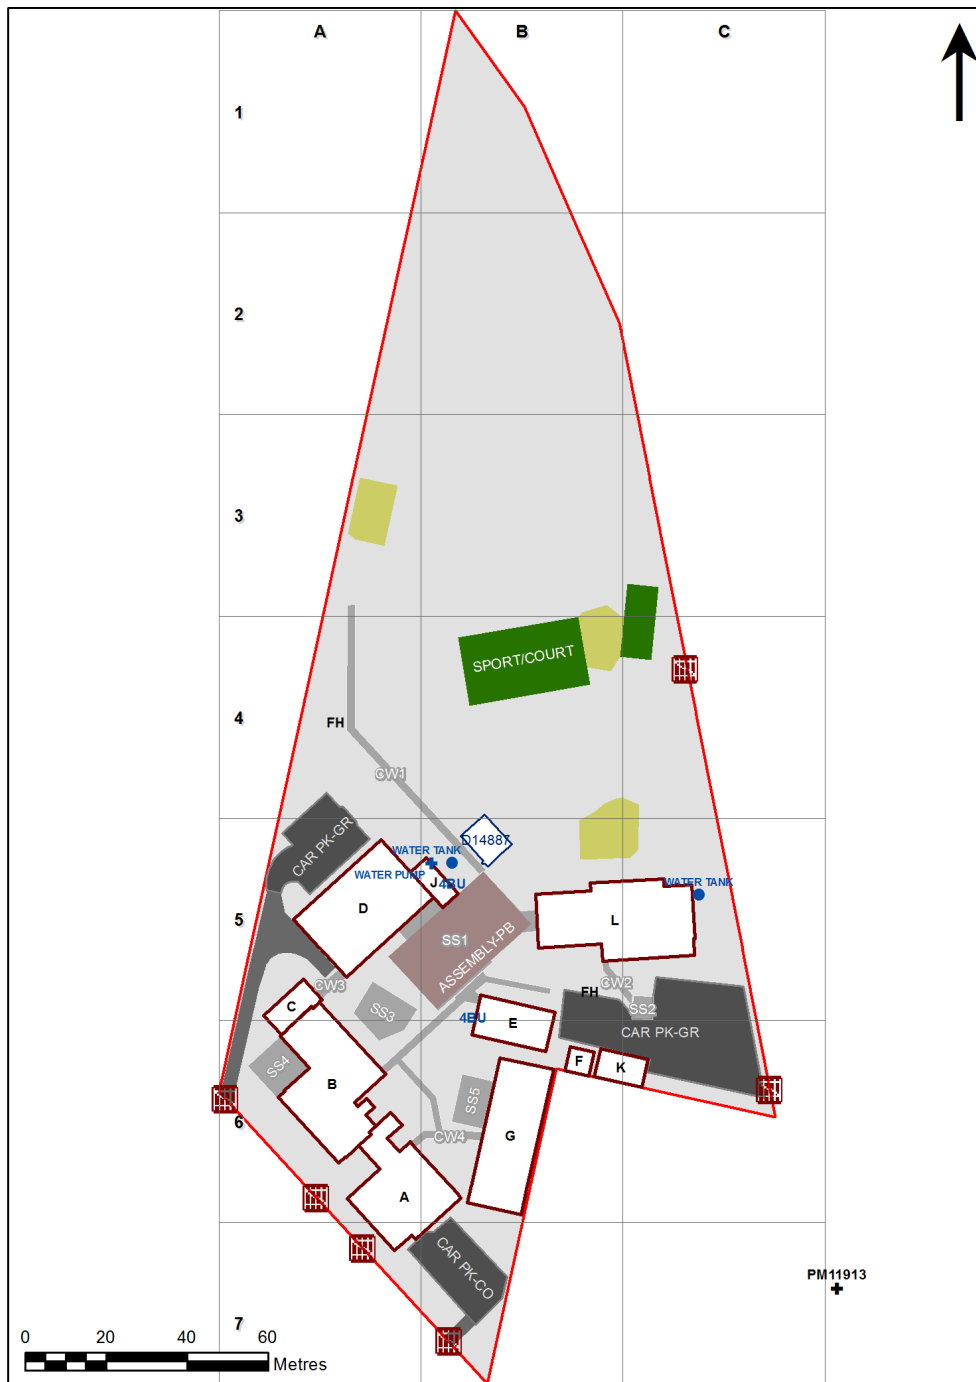

1:1,241

Printed: 12-Apr-2021

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Movement - (20.97 SQM)	Not Applicable	Circulation or storage space.
B00A - R0005 - Duplicating Workroom - (12.24 SQM)	Office (3)	
B00A - R0008 - Entry Vestibule - (18.7 SQM)	Not Applicable	Circulation or storage space.
B00A - R0009 - Principal - (19.4 SQM)	Office (4)	
B00A - R0010 - Movement - (59.01 SQM)	Not Applicable	Circulation or storage space.
B00A - R0011 - Movement - (36.12 SQM)	Not Applicable	Circulation or storage space.
B00A - R0012 - Staff Room - (60.95 SQM)	Office (15)	
B00A - R0013 - Interview - (12.24 SQM)	Office (3)	
B00A - R0014 - Clerical Office - (12.88 SQM)	Office (3)	
B00A - R0015 - Deputy Principal - (12.57 SQM)	Office (3)	
B00A - R0018 - Withdrawal Space - 1hb - (15.01 SQM)	Student Space (6)	
B00A - R0019 - Movement - (43.65 SQM)	Not Applicable	Circulation or storage space.
B00A - R0023 - Clerical Office - (22.33 SQM)	Office (5)	
B00A - R1001 - Movement - (14.45 SQM)	Not Applicable	Circulation or storage space.
B00A - R1003 - Seminar/Study - (10.55 SQM)	Office (2)	
B00A - R1013 - Movement - (22.23 SQM)	Not Applicable	Circulation or storage space.
B00A - R1014 - Special Programs Room - (12.26 SQM)	Student Space (5)	
B00A - R1015 - Movement - (17.21 SQM)	Not Applicable	Circulation or storage space.
B00A - R1016 - Special Programs Room - Type 1 - (217.51 SQM)	Student Space (100)	
B00B - R0001 - Movement - (139.4 SQM)	Not Applicable	Circulation or storage space.
B00B - R0002 - Practical Activities - 1hb - (18.01 SQM)	Student Space (8)	
B00B - R0003 - Home Base - (52.08 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0004 - Movement - (46.78 SQM)	Not Applicable	Circulation or storage space.
B00B - R0005 - Home Base - (52.16 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0006 - Practical Activities - 1hb - (18.09 SQM)	Student Space (8)	
B00B - R0008 - Movement - (16.16 SQM)	Not Applicable	Circulation or storage space.
B00B - R0010 - Practical Activities - 1hb - (13.61 SQM)	Student Space (6)	
B00B - R0011 - Home Base - (80.46 SQM) - Teaching Space: 1	Student Space (37)	
B00B - R0012 - Home Base - (51.45 SQM) - Teaching Space: 1	Student Space (23)	
B00B - R0013 - Practical Activities - 1hb - (18.01 SQM)	Student Space (8)	
B00B - R0014 - Movement - (8.84 SQM)	Not Applicable	Circulation or storage space.
B00B - R1001 - Movement - (79.01 SQM)	Not Applicable	Circulation or storage space.
B00B - R1002 - Practical Activities - 1hb - (18.01 SQM)	Student Space (8)	
B00B - R1003 - Home Base - (51.84 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1004 - Home Base - (52.1 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1005 - Practical Activities - 1hb - (17.96 SQM)	Student Space (8)	
B00B - R1008 - Practical Activities - 1hb - (18.01 SQM)	Student Space (8)	
B00B - R1010 - Home Base - (51.37 SQM) - Teaching Space: 1	Student Space (23)	
B00B - R1011 - Practical Activities - 1hb - (18.01 SQM)	Student Space (8)	
B00B - R1012 - Movement - (15.93 SQM)	Not Applicable	Circulation or storage space.
B00B - R1013 - Home Base - (51.45 SQM) - Teaching Space: 1	Student Space (23)	
B00C - R0001 - Movement - (29.57 SQM)	Not Applicable	Circulation or storage space.
B00D - R0001 - Movement - (193.42 SQM)	Not Applicable	Circulation or storage space.
B00D - R0004 - Raised Platform - (37.01 SQM)	Not Applicable	Circulation or storage space.
B00D - R0007 - Movement - (26.49 SQM)	Not Applicable	Circulation or storage space.
B00D - R0013 - Canteen - (26.94 SQM)	Not Applicable	Circulation or storage space.
B00D - R0018 - Reading Area - (156.1 SQM)	Student Space (72)	
B00D - R0019 - Breakout Area - (12.39 SQM)	Not Applicable	Circulation or storage space.
B00E - R0002 - Home Base - (53.72 SQM) - Teaching Space: 1	Student Space (24)	
B00E - R0004 - Home Base - (54.09 SQM) - Teaching Space: 1	Student Space (25)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00E - R0008 - Movement - (29.8 SQM)	Not Applicable	Circulation or storage space.
B00G - R0001 - Movement - (14.6 SQM)	Not Applicable	Circulation or storage space.
B00G - R0002 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00G - R0004 - Practical Activities - 1hb - (12.85 SQM)	● Student Space (5)	
B00G - R0006 - Withdrawal Space - 1hb - (11.47 SQM)	● Student Space (5)	
B00G - R0007 - Home Base - (59.3 SQM) - Teaching Space: 1	● Student Space (27)	
B00G - R0008 - Movement - (14.73 SQM)	Not Applicable	Circulation or storage space.
B00G - R0010 - Practical Activities - 1hb - (11.2 SQM)	● Student Space (5)	
B00G - R0012 - Movement - (14.65 SQM)	Not Applicable	Circulation or storage space.
B00G - R0013 - Home Base - (59.26 SQM) - Teaching Space: 1	● Student Space (27)	
B00G - R0015 - Practical Activities - 1hb - (11.18 SQM)	● Student Space (5)	
B00G - R0017 - Withdrawal Space - 1hb - (11.47 SQM)	● Student Space (5)	
B00G - R0018 - Home Base - (59.06 SQM) - Teaching Space: 1	● Student Space (27)	
B00G - R0020 - Movement - (14.62 SQM)	Not Applicable	Circulation or storage space.
B00G - R0021 - Practical Activities - 1hb - (11.16 SQM)	● Student Space (5)	
B00G - R0023 - Movement - (67.73 SQM)	Not Applicable	Circulation or storage space.
B00L - R0001 - Communal Space - (203.62 SQM)	● Student Space (94)	
B00L - R0002 - Raised Platform - (57.23 SQM)	Not Applicable	Circulation or storage space.
B00L - R0017 - Movement - (17.05 SQM)	Not Applicable	Circulation or storage space.
OS 602 14887 - OS 602 14887 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	