


VENTILATION AUDIT REPORT

SCHOOL:	Ambarvale High School (8570)
AMU REGION:	South Western Sydney
STATE ELECTORATE:	Campbelltown
LOCAL GOVERNMENT AREA:	Campbelltown

8570 - Ambarvale High School
Site Plan (13006)

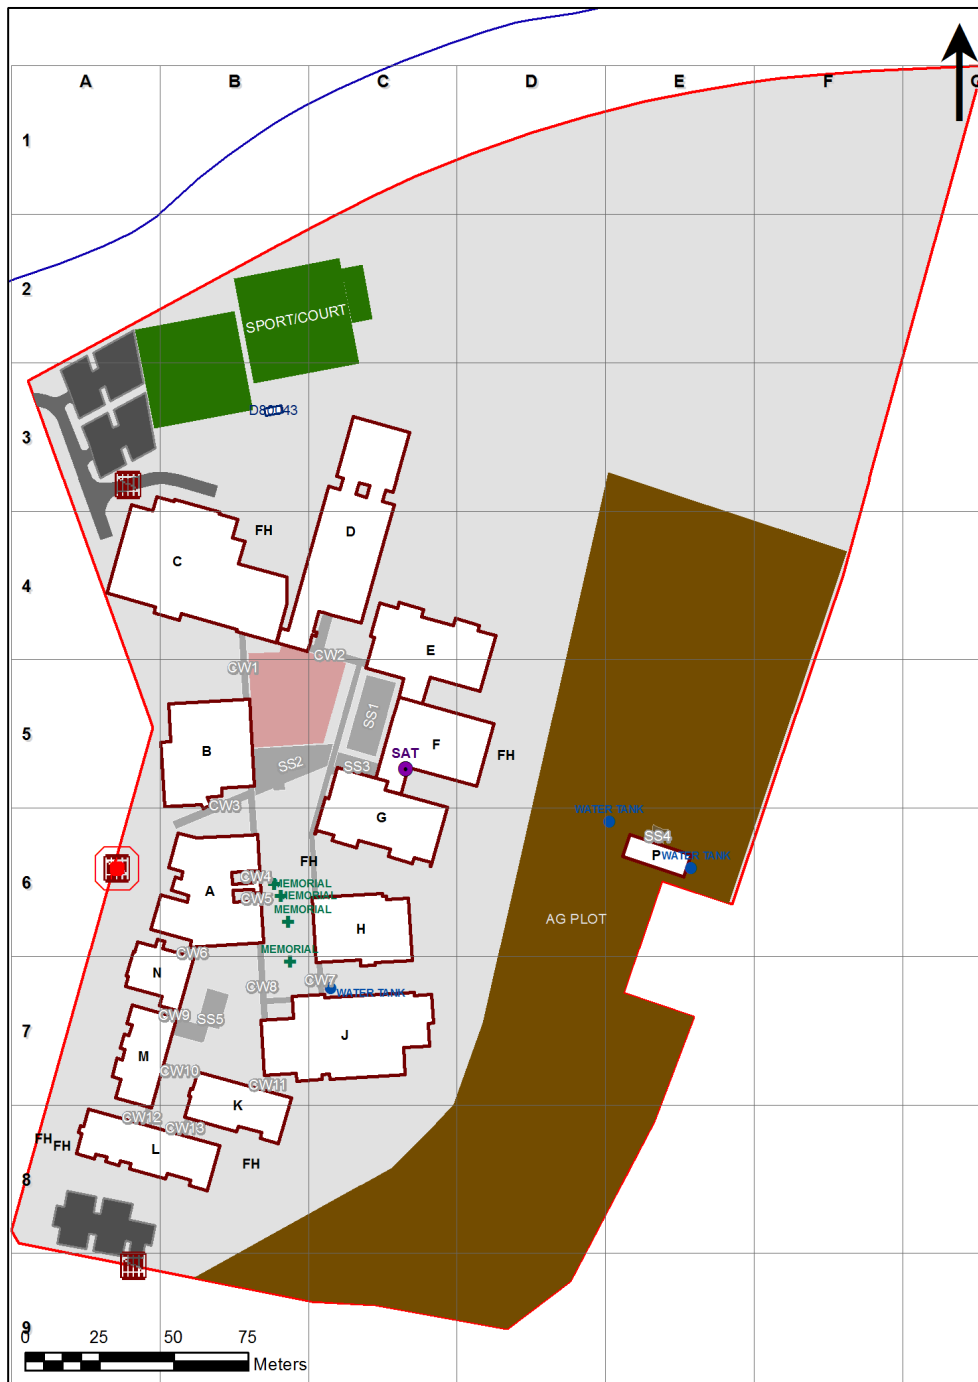

1:1,689

Printed: 21-Mar-2020









Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Deputy Principal Office - (13.01 SQM)	Office (3)	
B00A - R0002 - Deputy Principal Office - (16.19 SQM)	Office (4)	
B00A - R0007 - Administration - Executive - (13.14 SQM)	Office (3)	
B00A - R0012 - Leading Teacher - (12.98 SQM)	Office (3)	
B00A - R0013 - General Assistants - (17.01 SQM)	Office (4)	
B00A - R0023 - Administration - Clerical - (19.41 SQM)	Office (4)	
B00A - R0024 - Clinic - Girls - (15.04 SQM)	Office (3)	
B00A - R0027 - Clinic - Boys - (13.93 SQM)	Office (3)	
B00A - R0028 - Leading Teacher - (12.89 SQM)	Office (3)	
B00A - R0030 - Administration - Clerical - (43.75 SQM)	Office (10)	
B00A - R0031 - Administration - Clerical - (15.78 SQM)	Office (3)	
B00A - R0034 - Commonroom - (147.06 SQM)	Office (36)	
B00A - R0035 - Tea Room - (8.32 SQM)	Not Applicable	Circulation or storage space.
B00A - R0037 - Pupil Entry - (42.76 SQM)	Not Applicable	Circulation or storage space.
B00A - R0038 - Movement - (8.44 SQM)	Not Applicable	Circulation or storage space.
B00A - R0040 - Ancillary Staff - (11.72 SQM)	Office (2)	
B00A - R0042 - Principal Office - (34.25 SQM)	Office (8)	
B00A - R0044 - Movement - (60.24 SQM)	Not Applicable	Circulation or storage space.
B00A - R0045 - Public Entry - (47.62 SQM)	Not Applicable	Circulation or storage space.
B00A - R0046 - Movement - (6.05 SQM)	Not Applicable	Circulation or storage space.
B00A - R0047 - Movement - (54.52 SQM)	Not Applicable	Circulation or storage space.
B00A - R0048 - Interview/Office - Type 1 - (12.69 SQM)	Office (3)	
B00B - R0001 - Fitness Laboratory - (77.27 SQM)	Student Space (35)	
B00B - R0002 - Design/Technology L.S. - (67.83 SQM) - Teaching Space: 1	Student Space (31)	
B00B - R0003 - Design/Technology L.S. - (67.58 SQM) - Teaching Space: 1	Student Space (31)	
B00B - R0005 - Food Technology L.S. - (107.34 SQM) - Teaching Space: 1	Student Space (49)	
B00B - R0006 - Preparation - (21.31 SQM)	Not Applicable	Circulation or storage space.
B00B - R0013 - General Learning Space - (61.82 SQM) - Teaching Space: 1	Student Space (28)	
B00B - R0014 - Staff Study - (26.39 SQM)	Office (6)	
B00B - R0015 - Staff Study - (26.3 SQM)	Office (6)	
B00B - R0016 - Movement - (67.42 SQM)	Not Applicable	Circulation or storage space.
B00B - R0018 - Seminar - Type 1 - (21.06 SQM)	Office (5)	
B00B - R0021 - Staff Study - (33.69 SQM)	Office (8)	
B00B - R0023 - Movement - (7.81 SQM)	Not Applicable	Circulation or storage space.
B00B - R0027 - Food Technology L.S. - (94.95 SQM) - Teaching Space: 1	Student Space (44)	
B00B - R0028 - Kitchen - Type 1 - (12.41 SQM)	Student Space (5)	
B00B - R0029 - Movement - (60.72 SQM)	Not Applicable	Circulation or storage space.
B00C - R0005 - Multi-Purpose Space - (524.91 SQM)	Student Space (243)	
B00C - R0017 - Movement - (24.91 SQM)	Not Applicable	Circulation or storage space.
B00C - R0022 - Movement - (25.54 SQM)	Not Applicable	Circulation or storage space.
B00C - R0025 - Student Canteen - (61.48 SQM)	Not Applicable	Circulation or storage space.
B00C - R0030 - Staff Kitchen - (16.27 SQM)	Office (4)	
B00C - R0031 - General Assistants - (13.66 SQM)	Office (3)	
B00C - R0051 - Movement - (20.92 SQM)	Not Applicable	Circulation or storage space.
B00C - R0055 - Stage - (94.44 SQM)	Not Applicable	Circulation or storage space.
B00C - R0057 - Movement - (6.81 SQM)	Not Applicable	Circulation or storage space.
B00D - R0001 - Laboratory L.S. - (81.11 SQM) - Teaching Space: 1	Student Space (37)	
B00D - R0005 - Laboratory L.S. - (81.38 SQM) - Teaching Space: 1	Student Space (37)	
B00D - R0006 - Preparation - Science - (32.27 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R0007 - Laboratory L.S. - (81.2 SQM) - Teaching Space: 1	● Student Space (37)	
B00D - R0008 - Laboratory L.S. - (81.29 SQM) - Teaching Space: 1	● Student Space (37)	
B00D - R0009 - Preparation - Science - (32.17 SQM)	Not Applicable	Circulation or storage space.
B00D - R0010 - Laboratory L.S. - (81.56 SQM) - Teaching Space: 1	● Student Space (37)	
B00D - R0015 - Laboratory L.S. - (81.29 SQM) - Teaching Space: 1	● Student Space (37)	
B00D - R0016 - Preparation - Science - (37.9 SQM)	Not Applicable	Circulation or storage space.
B00D - R0017 - Movement - (175.59 SQM)	Not Applicable	Circulation or storage space.
B00D - R0018 - Tiered Learning Area - (65.45 SQM)	● Student Space (30)	
B00D - R0028 - Staff Study - (37.84 SQM)	● Office (9)	
B00E - R0001 - General Learning Space - (49.04 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R0002 - General Learning Space - (49.57 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R0003 - General Learning Space - (39.89 SQM) - Teaching Space: 1	● Student Space (18)	
B00E - R0008 - Computer Learning Space - (46.89 SQM) - Teaching Space: 1	● Student Space (21)	
B00E - R0010 - General Learning Space - (48.96 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R0011 - Study Space - (15.98 SQM)	Not Applicable	Circulation or storage space.
B00E - R0012 - General Learning Space - (49.39 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R0016 - Study Space - (15.92 SQM)	Not Applicable	Circulation or storage space.
B00E - R0017 - General Learning Space - (49.11 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R0018 - Movement - (193.88 SQM)	Not Applicable	Circulation or storage space.
B00E - R0025 - Workroom - (13.09 SQM)	● Office (3)	
B00E - R0027 - Dark Room - (15.83 SQM)	● Office (3)	
B00E - R0028 - Staff Study - (39.71 SQM)	● Office (9)	
B00E - R1001 - General Learning Space - (49.12 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R1003 - Computer Learning Space - (49.3 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R1004 - Computer Learning Space - (39.7 SQM) - Teaching Space: 1	● Student Space (18)	
B00E - R1007 - General Learning Space - (41.23 SQM) - Teaching Space: 1	● Student Space (19)	
B00E - R1008 - General Learning Space - (49.59 SQM) - Teaching Space: 1	● Student Space (23)	
B00E - R1010 - General Learning Space - (49.04 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R1011 - Shared Study Space - (15.84 SQM)	● Office (3)	
B00E - R1012 - General Learning Space - (49.53 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R1017 - General Learning Space - (48.83 SQM) - Teaching Space: 1	● Student Space (22)	
B00E - R1018 - Movement - (162.03 SQM)	Not Applicable	Circulation or storage space.
B00E - R1019 - Staff Study - (39.87 SQM)	● Office (9)	
B00F - R0001 - Main Area - (426.49 SQM)	Not Applicable	Circulation or storage space.
B00F - R0003 - Seminar - (14.09 SQM)	● Office (3)	
B00F - R0004 - Seminar - (13.69 SQM)	● Office (3)	
B00F - R0014 - Leading Teacher - (15.29 SQM)	● Office (3)	
B00F - R0021 - Tea Room - (8.74 SQM)	Not Applicable	Circulation or storage space.
B00F - R1003 - Interview/Office - Type 1 - (14.41 SQM)	● Office (3)	
B00F - R1007 - Seminar/Study - (78.01 SQM)	● Office (19)	
B00G - R0001 - General Learning Space - (49.45 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R0002 - General Learning Space - (49.04 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R0003 - General Learning Space - (48.97 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R0007 - Staff Study - (40.18 SQM)	● Office (10)	
B00G - R0008 - General Learning Space - (48.89 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R0009 - Study Space - (15.86 SQM)	Not Applicable	Circulation or storage space.
B00G - R0010 - Computer Learning Space - (49.1 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R0012 - General Learning Space - (48.97 SQM) - Teaching Space: 1	● Student Space (22)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00G - R0013 - General Learning Space - (41.03 SQM) - Teaching Space: 1	● Student Space (19)	
B00G - R0016 - General Learning Space - (39.89 SQM) - Teaching Space: 1	● Student Space (18)	
B00G - R0021 - Movement - (176.78 SQM)	Not Applicable	Circulation or storage space.
B00G - R0022 - Movement - (15.8 SQM)	Not Applicable	Circulation or storage space.
B00G - R1002 - General Learning Space - (49.16 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R1003 - General Learning Space - (48.97 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R1008 - General Learning Space - (48.97 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R1010 - General Learning Space - (49.7 SQM) - Teaching Space: 1	● Student Space (23)	
B00G - R1012 - General Learning Space - (48.83 SQM) - Teaching Space: 1	● Student Space (22)	
B00G - R1013 - General Learning Space - (41.1 SQM) - Teaching Space: 1	● Student Space (19)	
B00G - R1017 - General Learning Space - (39.89 SQM) - Teaching Space: 1	● Student Space (18)	
B00G - R1018 - General Learning Space - (49.71 SQM) - Teaching Space: 1	● Student Space (23)	
B00G - R1019 - Movement - (153.41 SQM)	Not Applicable	Circulation or storage space.
B00G - R1020 - Staff Study - (25.08 SQM)	● Office (6)	
B00H - R0004 - Art Learning Space - (61.17 SQM) - Teaching Space: 1	● Student Space (28)	
B00H - R0006 - Art Learning Space - (62.19 SQM) - Teaching Space: 1	● Student Space (28)	
B00H - R0010 - Art Learning Space - (62.36 SQM) - Teaching Space: 1	● Student Space (28)	
B00H - R0011 - Art Learning Space - (62.35 SQM) - Teaching Space: 1	● Student Space (28)	
B00H - R0019 - Visual Arts Workshop - (53.33 SQM)	● Student Space (24)	
B00H - R0024 - Staff Study - (20.77 SQM)	● Office (5)	
B00H - R0026 - Art Entry/Display - (140.49 SQM)	Not Applicable	Circulation or storage space.
B00H - R0027 - Movement - (6.58 SQM)	Not Applicable	Circulation or storage space.
B00J - R0001 - Metal Technology L.S. - (92.12 SQM) - Teaching Space: 1	● Student Space (42)	
B00J - R0004 - Wood Technology L.S. - (92.38 SQM) - Teaching Space: 1	● Student Space (42)	
B00J - R0006 - Wood Technology Bay - (29.86 SQM)	Not Applicable	Circulation or storage space.
B00J - R0007 - Wood Technology L.S. - (92.18 SQM) - Teaching Space: 1	● Student Space (42)	
B00J - R0009 - Design L.S. - (57.25 SQM) - Teaching Space: 1	● Student Space (26)	
B00J - R0012 - Computer Learning Space - (57.17 SQM) - Teaching Space: 1	● Student Space (26)	
B00J - R0017 - Metal Technology Bay - (32.34 SQM)	Not Applicable	Circulation or storage space.
B00J - R0018 - Movement - (296.88 SQM)	Not Applicable	Circulation or storage space.
B00J - R0020 - Materials Technology L.S. - (88.69 SQM) - Teaching Space: 1	● Student Space (41)	
B00J - R0028 - Metal Technology L.S. - (68.48 SQM) - Teaching Space: 1	● Student Space (31)	
B00J - R0029 - Welding Area - (6.84 SQM)	Not Applicable	Circulation or storage space.
B00J - R0030 - Staff Study - (27.25 SQM)	● Office (6)	
B00K - R0001 - Special Learning Space - (59.9 SQM) - Teaching Space: 1	● Student Space (27)	
B00K - R0002 - Study Space - (9.07 SQM)	Not Applicable	Circulation or storage space.
B00K - R0004 - Practical Activities Area - 2 G.L.S. - (36.37 SQM)	● Student Space (16)	
B00K - R0006 - Special Learning Space - (60.1 SQM) - Teaching Space: 1	● Student Space (27)	
B00K - R0008 - Study Space - (9.04 SQM)	Not Applicable	Circulation or storage space.
B00K - R0018 - Staff Study - (15.57 SQM)	● Office (3)	
B00K - R0020 - Computer Learning Space - (77.88 SQM) - Teaching Space: 1	● Student Space (36)	
B00K - R0021 - Study Space - (13.13 SQM)	Not Applicable	Circulation or storage space.
B00L - R0001 - Music Learning Space - (60.04 SQM) - Teaching Space: 1	● Student Space (27)	
B00L - R0002 - Study Space - (8.76 SQM)	Not Applicable	Circulation or storage space.
B00L - R0004 - Staff Study - (37.27 SQM)	● Office (9)	
B00L - R0006 - Music Learning Space - (60 SQM) - Teaching Space: 1	● Student Space (27)	
B00L - R0012 - General Learning Space - (59.94 SQM) - Teaching Space: 1	● Student Space (27)	
B00L - R0013 - Study Space - (8.73 SQM)	Not Applicable	Circulation or storage space.
B00L - R0016 - Practical Activities Area - 2 G.L.S. - (75.17 SQM)	● Student Space (34)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00L - R0019 - Special Learning Space - (60 SQM) - Teaching Space: 1	 Student Space (27)	
B00L - R0020 - Study Space - (8.73 SQM)	Not Applicable	Circulation or storage space.
B00M - R0001 - Seminar Space - (8.82 SQM)	 Office (2)	
B00M - R0002 - Special Learning Space - (60 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0005 - Special Learning Space - (74.32 SQM) - Teaching Space: 1	 Student Space (34)	
B00M - R0008 - Special Learning Space - (60 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0009 - Seminar Space - (8.79 SQM)	 Office (2)	
B00M - R0018 - Interview/Office - Type 1 - (14.33 SQM)	 Office (3)	
B00M - R0020 - Staff Study - (37.16 SQM)	 Office (9)	
B00N - R0008 - Movement Studio - (113.92 SQM)	Not Applicable	Circulation or storage space.
B00N - R0009 - Student Canteen - (17.29 SQM)	Not Applicable	Circulation or storage space.
B00P - R0001 - Growing/Breeding - (10.11 SQM)	Not Applicable	Circulation or storage space.