


VENTILATION AUDIT REPORT

SCHOOL:	Anzac Park Public School (4656)
AMU REGION:	Northern Sydney
STATE ELECTORATE:	Willoughby
LOCAL GOVERNMENT AREA:	North Sydney

4656 - Anzac Park Public School
Site Plan (15698)

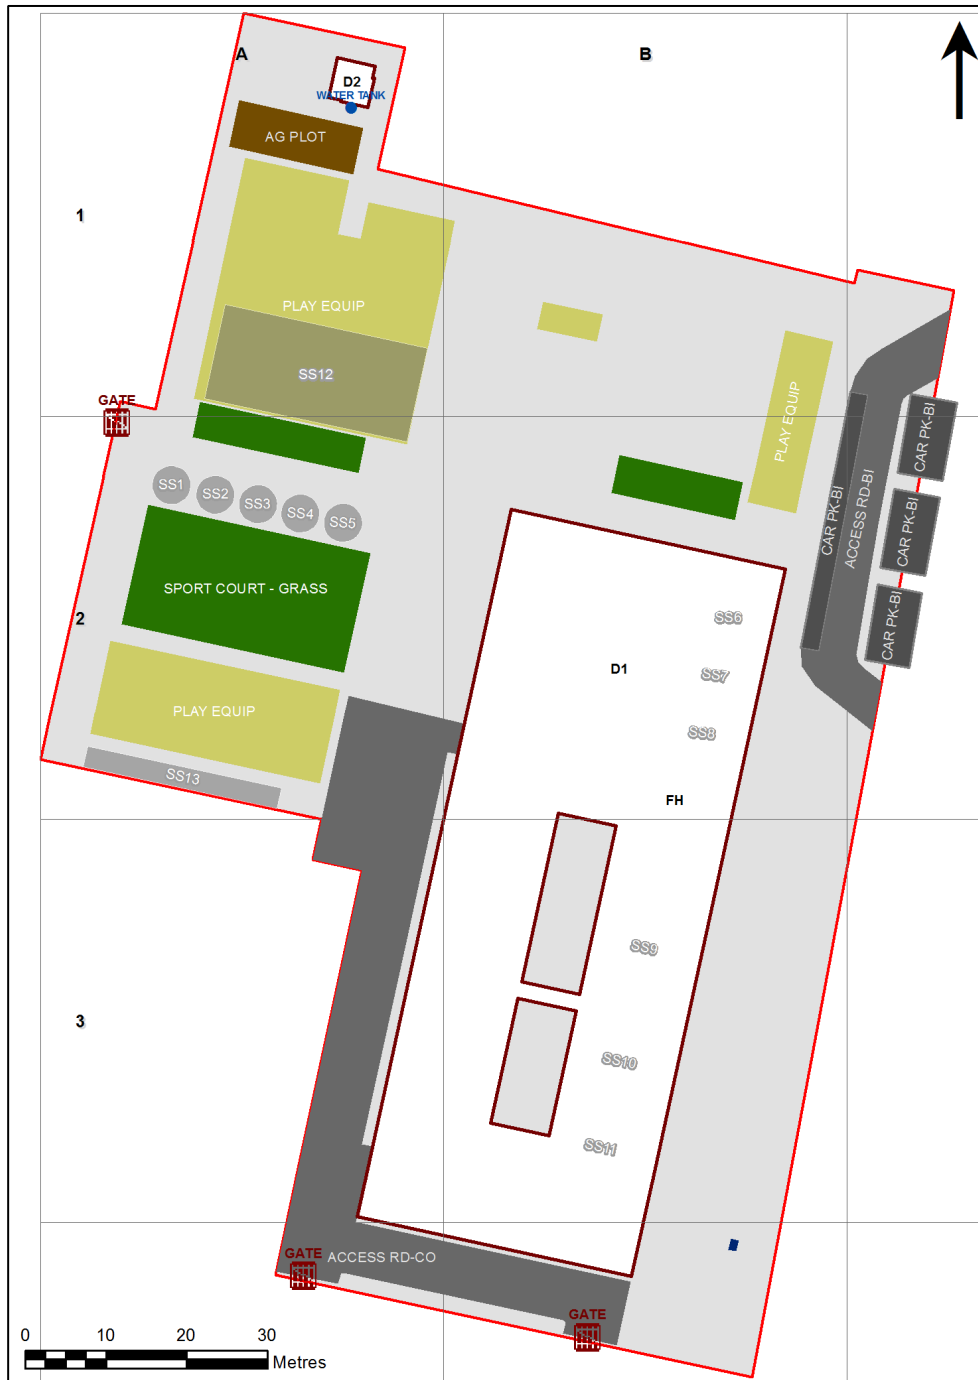

1:622

Printed: 12-Jun-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
BOD1 - R0001 - Communal Space - (301.84 SQM)	● Student Space (140)	
BOD1 - R0005 - Raised Platform - (61.51 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R0009 - Movement - (18.13 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R0010 - Movement - (9.81 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R0011 - Movement - (10.12 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R0014 - Canteen - (54.51 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1001 - Entry Vestibule - (24.02 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1002 - Interview - (13.15 SQM)	● Office (3)	
BOD1 - R1003 - Interview - (13.04 SQM)	● Office (3)	
BOD1 - R1005 - Sick Bay - (8.49 SQM)	● Student Space (3)	
BOD1 - R1007 - Deputy Principal - (13.48 SQM)	● Office (3)	
BOD1 - R1008 - Deputy Principal - (13.82 SQM)	● Office (3)	
BOD1 - R1012 - Staff Room - (83.63 SQM)	● Office (20)	
BOD1 - R1013 - Staff Room - (46.22 SQM)	● Office (11)	
BOD1 - R1016 - Deputy Principal - (14.06 SQM)	● Office (3)	
BOD1 - R1017 - Interview/Office - Type 3 - (17.77 SQM)	● Office (4)	
BOD1 - R1018 - Principal - (16.94 SQM)	● Office (4)	
BOD1 - R1019 - Clerical/Printing - (22.07 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1020 - Clerical/Printing - (47.01 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1024 - Movement - (6.95 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1026 - Special Programs Room - (30.68 SQM)	● Student Space (14)	
BOD1 - R1028 - Special Programs Room - (31.18 SQM)	● Student Space (14)	
BOD1 - R1030 - Reading Area - (282.57 SQM)	● Student Space (131)	
BOD1 - R1035 - Special Programs Room - Type 2 - (30.11 SQM)	● Student Space (13)	
BOD1 - R1037 - Special Programs Room - Type 2 - (32.73 SQM)	● Student Space (15)	
BOD1 - R1044 - Deputy Principal - (13.26 SQM)	● Office (3)	
BOD1 - R1045 - Movement - (24.24 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1047 - Movement - (51.84 SQM)	Not Applicable	Circulation or storage space.
BOD1 - R1048 - Staff Kitchen - (9.19 SQM)	● Office (2)	
BOD1 - R1049 - Staff Kitchen - (6.87 SQM)	● Office (1)	
BOD1 - R2001 - Practical Activities - (21.22 SQM)	● Student Space (9)	
BOD1 - R2002 - Home Base - (59.89 SQM) - Teaching Space: 1	● Student Space (27)	
BOD1 - R2004 - Withdrawal Space - 2hb - (11.53 SQM)	● Student Space (5)	
BOD1 - R2005 - Practical Activities - (21.55 SQM)	● Student Space (9)	
BOD1 - R2006 - Home Base - (60.78 SQM) - Teaching Space: 1	● Student Space (28)	
BOD1 - R2008 - Practical Activities - (21.46 SQM)	● Student Space (9)	
BOD1 - R2009 - Home Base - (60.45 SQM) - Teaching Space: 1	● Student Space (28)	
BOD1 - R2011 - Withdrawal Space - 2hb - (11.61 SQM)	● Student Space (5)	
BOD1 - R2012 - Practical Activities - (21.42 SQM)	● Student Space (9)	
BOD1 - R2013 - Home Base - (60.17 SQM) - Teaching Space: 1	● Student Space (27)	
BOD1 - R2015 - Home Base - (60.71 SQM) - Teaching Space: 1	● Student Space (28)	
BOD1 - R2017 - Practical Activities - (21.08 SQM)	● Student Space (9)	
BOD1 - R2018 - Withdrawal Space - 2hb - (11.57 SQM)	● Student Space (5)	
BOD1 - R2019 - Home Base - (59.97 SQM) - Teaching Space: 1	● Student Space (27)	
BOD1 - R2020 - Practical Activities - (20.38 SQM)	● Student Space (9)	
BOD1 - R2024 - Home Base - (60.11 SQM) - Teaching Space: 1	● Student Space (27)	
BOD1 - R2026 - Practical Activities - (20.54 SQM)	● Student Space (9)	
BOD1 - R2027 - Withdrawal Space - 2hb - (11.68 SQM)	● Student Space (5)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B0D1 - R2028 - Home Base - (60.79 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2029 - Practical Activities - (21.25 SQM)	● Student Space (9)	
B0D1 - R2031 - Practical Activities - (21.39 SQM)	● Student Space (9)	
B0D1 - R2032 - Home Base - (60.86 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2034 - Withdrawal Space - 2hb - (11.65 SQM)	● Student Space (5)	
B0D1 - R2035 - Practical Activities - (21.39 SQM)	● Student Space (9)	
B0D1 - R2036 - Home Base - (60.64 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2038 - Practical Activities - M - 1hb - (21.43 SQM)	● Student Space (9)	
B0D1 - R2039 - Home Base - (60.62 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2041 - Withdrawal - M - (11.69 SQM)	● Student Space (5)	
B0D1 - R2042 - Practical Activities - M - 1hb - (21.41 SQM)	● Student Space (9)	
B0D1 - R2043 - Home Base - (60.56 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2049 - Home Base - (61.34 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2051 - Practical Activities - (21.48 SQM)	● Student Space (9)	
B0D1 - R2052 - Withdrawal Space - 2hb - (11.77 SQM)	● Student Space (5)	
B0D1 - R2053 - Home Base - (61.05 SQM) - Teaching Space: 1	● Student Space (28)	
B0D1 - R2054 - Practical Activities - (21.27 SQM)	● Student Space (9)	
B0D1 - R2059 - Movement - (20.75 SQM)	Not Applicable	Circulation or storage space.
B0D1 - R2068 - Movement - (13.38 SQM)	Not Applicable	Circulation or storage space.
B0D1 - R3001 - Practical Activities - (21.01 SQM)	● Student Space (9)	
B0D1 - R3002 - Home Base - (59.7 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3004 - Withdrawal Space - 2hb - (11.68 SQM)	● Student Space (5)	
B0D1 - R3005 - Practical Activities - (21.42 SQM)	● Student Space (9)	
B0D1 - R3006 - Home Base - (60.29 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3008 - Practical Activities - (21.35 SQM)	● Student Space (9)	
B0D1 - R3009 - Home Base - (60.14 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3011 - Withdrawal Space - 2hb - (11.68 SQM)	● Student Space (5)	
B0D1 - R3012 - Practical Activities - (21.36 SQM)	● Student Space (9)	
B0D1 - R3013 - Home Base - (59.65 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3015 - Home Base - (60.15 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3017 - Practical Activities - (21.18 SQM)	● Student Space (9)	
B0D1 - R3018 - Withdrawal Space - 2hb - (11.77 SQM)	● Student Space (5)	
B0D1 - R3019 - Home Base - (59.62 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3020 - Practical Activities - (20.54 SQM)	● Student Space (9)	
B0D1 - R3024 - Home Base - (59.27 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3026 - Practical Activities - (20.63 SQM)	● Student Space (9)	
B0D1 - R3027 - Withdrawal Space - 2hb - (11.77 SQM)	● Student Space (5)	
B0D1 - R3028 - Home Base - (60.17 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3029 - Practical Activities - (21.05 SQM)	● Student Space (9)	
B0D1 - R3031 - Practical Activities - (21.21 SQM)	● Student Space (9)	
B0D1 - R3032 - Home Base - (59.3 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3034 - Withdrawal Space - 2hb - (11.72 SQM)	● Student Space (5)	
B0D1 - R3035 - Practical Activities - (21.61 SQM)	● Student Space (10)	
B0D1 - R3036 - Home Base - (59.8 SQM) - Teaching Space: 1	● Student Space (27)	
B0D1 - R3038 - Practical Activities - (21.55 SQM)	● Student Space (9)	
B0D1 - R3039 - Home Base - (60.05 SQM) - Teaching Space: 1	● Student Space (27)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B0D1 - R3041 - Withdrawal Space - 2hb - (11.66 SQM)	Student Space (5)	
B0D1 - R3042 - Practical Activities - (21.15 SQM)	Student Space (9)	
B0D1 - R3043 - Home Base - (59.33 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R3049 - Home Base - (56.85 SQM) - Teaching Space: 1	Student Space (26)	
B0D1 - R3051 - Withdrawal Space - 1hb - (7.82 SQM)	Student Space (3)	
B0D1 - R3052 - Practical Activities - (23.18 SQM)	Student Space (10)	
B0D1 - R3053 - Practical Activities - (22.92 SQM)	Student Space (10)	
B0D1 - R3054 - Home Base - (59.48 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R3056 - Withdrawal Space - 2hb - (12.06 SQM)	Student Space (5)	
B0D1 - R3057 - Practical Activities - (20.96 SQM)	Student Space (9)	
B0D1 - R3058 - Home Base - (61.97 SQM) - Teaching Space: 1	Student Space (28)	
B0D1 - R3060 - Practical Activities - (20.84 SQM)	Student Space (9)	
B0D1 - R3061 - Home Base - (61.13 SQM) - Teaching Space: 1	Student Space (28)	
B0D1 - R3063 - Withdrawal Space - 2hb - (12.06 SQM)	Student Space (5)	
B0D1 - R3064 - Practical Activities - (23.91 SQM)	Student Space (11)	
B0D1 - R3065 - Home Base - (58.71 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R3067 - Home Base - (57.14 SQM) - Teaching Space: 1	Student Space (26)	
B0D1 - R3068 - Practical Activities - (22.86 SQM)	Student Space (10)	
B0D1 - R3069 - Withdrawal Space - 2hb - (7.88 SQM)	Student Space (3)	
B0D1 - R3075 - Movement - (12.55 SQM)	Not Applicable	Circulation or storage space.
B0D1 - R3080 - Movement - (18.62 SQM)	Not Applicable	Circulation or storage space.
B0D1 - R3083 - Movement - (18.97 SQM)	Not Applicable	Circulation or storage space.
B0D1 - R4001 - Home Base - (59.22 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4003 - Practical Activities - (20.41 SQM)	Student Space (9)	
B0D1 - R4004 - Withdrawal Space - 2hb - (11.8 SQM)	Student Space (5)	
B0D1 - R4005 - Home Base - (59.9 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4006 - Practical Activities - (21.04 SQM)	Student Space (9)	
B0D1 - R4008 - Home Base - (59.87 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4010 - Practical Activities - (21.08 SQM)	Student Space (9)	
B0D1 - R4011 - Withdrawal Space - 2hb - (11.8 SQM)	Student Space (5)	
B0D1 - R4012 - Home Base - (59.76 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4013 - Practical Activities - (21.05 SQM)	Student Space (9)	
B0D1 - R4015 - Home Base - (59.95 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4017 - Practical Activities - (21.01 SQM)	Student Space (9)	
B0D1 - R4018 - Withdrawal Space - 2hb - (11.77 SQM)	Student Space (5)	
B0D1 - R4019 - Home Base - (59.86 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4020 - Practical Activities - (21.15 SQM)	Student Space (9)	
B0D1 - R4026 - Home Base - (55.6 SQM) - Teaching Space: 1	Student Space (25)	
B0D1 - R4028 - Practical Activities - (22.62 SQM)	Student Space (10)	
B0D1 - R4029 - Withdrawal Space - 1hb - (7.82 SQM)	Student Space (3)	
B0D1 - R4030 - Home Base - (59.27 SQM) - Teaching Space: 1	Student Space (27)	
B0D1 - R4032 - Practical Activities - (20.74 SQM)	Student Space (9)	
B0D1 - R4033 - Withdrawal Space - 2hb - (11.84 SQM)	Student Space (5)	
B0D1 - R4034 - Home Base - (60.43 SQM) - Teaching Space: 1	Student Space (28)	
B0D1 - R4035 - Practical Activities - (21.2 SQM)	Student Space (9)	
B0D1 - R4040 - Movement - (19.4 SQM)	Not Applicable	Circulation or storage space.