


VENTILATION AUDIT REPORT

SCHOOL:	Auburn West Public School (1075)
AMU REGION:	South Western Sydney
STATE ELECTORATE:	Auburn
LOCAL GOVERNMENT AREA:	Cumberland

1075 - Auburn West Public School
Site Plan (12295)




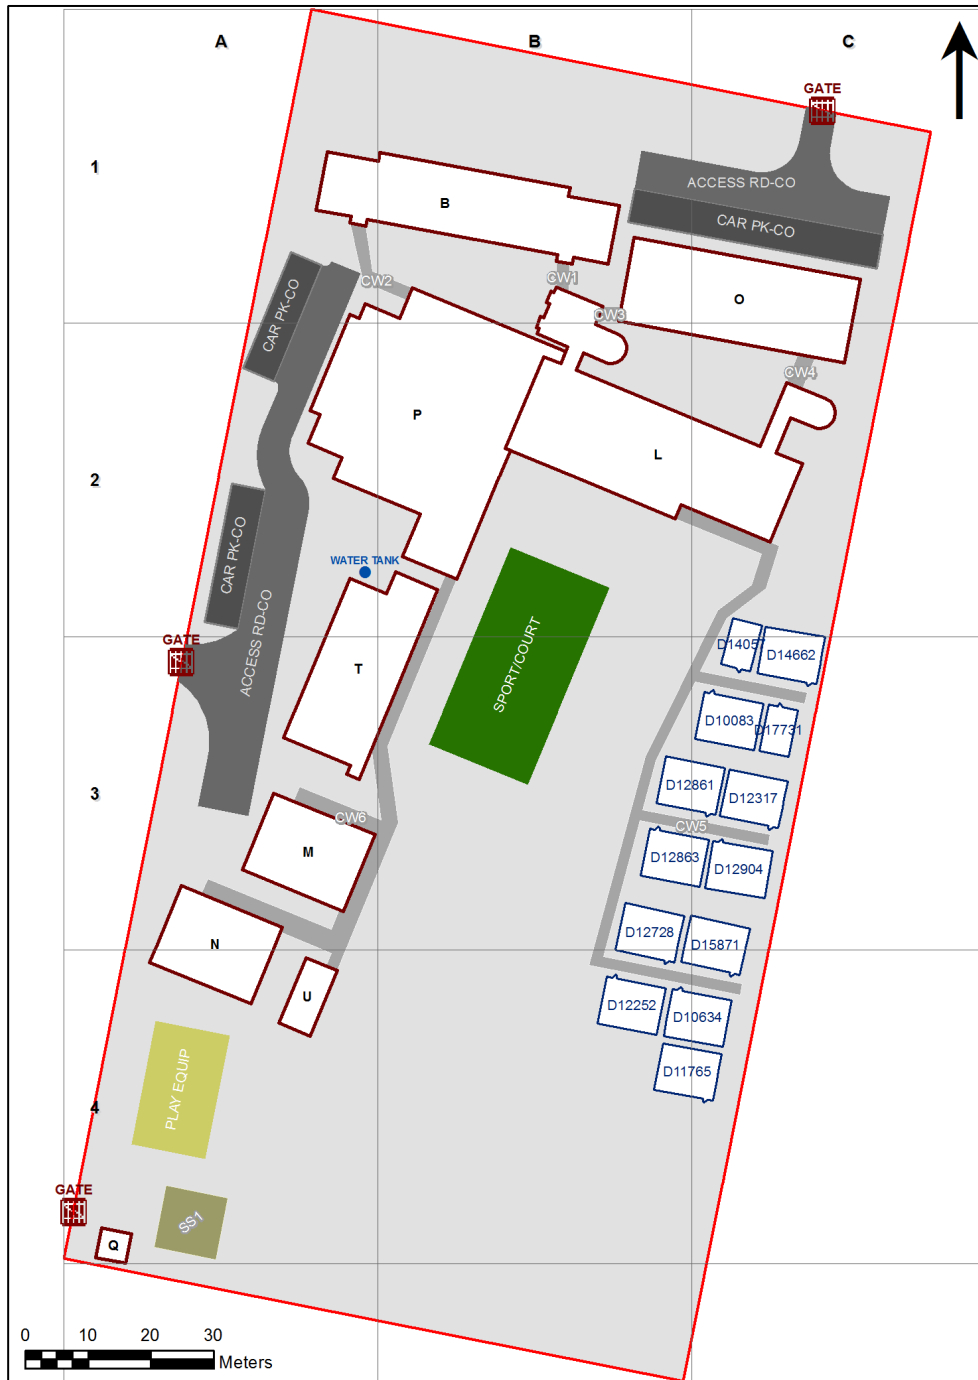





1:799



















Printed: 12-Jun-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R0016 - Interview - (13.29 SQM)	 Office (3)	
B00B - R0018 - Entry Vestibule - (28.05 SQM)	Not Applicable	Circulation or storage space.
B00B - R0019 - Movement - (10.63 SQM)	Not Applicable	Circulation or storage space.
B00B - R0020 - Duplicating Workroom - (20.94 SQM)	 Office (5)	
B00B - R0023 - Sick Bay - (9.92 SQM)	 Student Space (4)	
B00B - R0031 - Deputy Principal - (13.15 SQM)	 Office (3)	
B00B - R0032 - Deputy Principal - (13.11 SQM)	 Office (3)	
B00B - R0033 - Principal - (16.83 SQM)	 Office (4)	
B00B - R0034 - Clerical Office - (9.18 SQM)	 Office (2)	
B00B - R0035 - Clerical Office - (37.2 SQM)	 Office (9)	
B00B - R0036 - Movement - (43.28 SQM)	Not Applicable	Circulation or storage space.
B00B - R0037 - Staff Room - (71.26 SQM)	 Office (17)	
B00B - R0038 - Movement - (24.29 SQM)	Not Applicable	Circulation or storage space.
B00B - R0040 - Staff Room Annexe - (23.19 SQM)	 Office (5)	
B00B - R1005 - Special Programs Room - (31.25 SQM)	 Student Space (14)	
B00B - R1013 - Movement - (13.22 SQM)	Not Applicable	Circulation or storage space.
B00B - R1020 - Special Programs Room - (56.57 SQM)	 Student Space (26)	
B00B - R1021 - Reading Area - (228.74 SQM)	 Student Space (106)	
B00L - R0006 - Practical Activities - 1hb - (19.04 SQM)	 Student Space (8)	
B00L - R0007 - Home Base - (60.05 SQM) - Teaching Space: 1	 Student Space (27)	
B00L - R0008 - Withdrawal Space - 2hb - (11.57 SQM)	 Student Space (5)	
B00L - R0009 - Home Base - (59.82 SQM) - Teaching Space: 1	 Student Space (27)	
B00L - R0010 - Practical Activities - 1hb - (18.81 SQM)	 Student Space (8)	
B00L - R0013 - Home Base - (59.98 SQM) - Teaching Space: 1	 Student Space (27)	
B00L - R0014 - Practical Activities - 1hb - (18.71 SQM)	 Student Space (8)	
B00L - R0015 - Withdrawal Space - 2hb - (11.54 SQM)	 Student Space (5)	
B00L - R0016 - Home Base - (60.19 SQM) - Teaching Space: 1	 Student Space (27)	
B00L - R0017 - Practical Activities - 1hb - (19.16 SQM)	 Student Space (8)	
B00L - R0019 - Movement - (176.45 SQM)	Not Applicable	Circulation or storage space.
B00L - R0025 - Movement - (65.77 SQM)	Not Applicable	Circulation or storage space.
B00L - R1001 - Special Programs Room - (45.56 SQM)	 Student Space (21)	
B00L - R1006 - Practical Activities - 1hb - (19.13 SQM)	 Student Space (8)	
B00L - R1007 - Home Base - (60.71 SQM) - Teaching Space: 1	 Student Space (28)	
B00L - R1008 - Withdrawal Space - 2hb - (11.3 SQM)	 Student Space (5)	
B00L - R1009 - Home Base - (60.66 SQM) - Teaching Space: 1	 Student Space (28)	
B00L - R1010 - Practical Activities - 1hb - (18.32 SQM)	 Student Space (8)	
B00L - R1013 - Home Base - (60.49 SQM) - Teaching Space: 1	 Student Space (28)	
B00L - R1014 - Practical Activities - 1hb - (18.77 SQM)	 Student Space (8)	
B00L - R1015 - Withdrawal Space - 2hb - (11.3 SQM)	 Student Space (5)	
B00L - R1016 - Home Base - (60.57 SQM) - Teaching Space: 1	 Student Space (28)	
B00L - R1018 - Practical Activities - 1hb - (19.19 SQM)	 Student Space (8)	
B00L - R1019 - Movement - (208.29 SQM)	Not Applicable	Circulation or storage space.
B00M - R0001 - Movement - (38.47 SQM)	Not Applicable	Circulation or storage space.
B00M - R0002 - Practical Activities - 1hb - (19.39 SQM)	 Student Space (8)	
B00M - R0004 - Home Base - (59.2 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0005 - Withdrawal Space - 2hb - (11.36 SQM)	 Student Space (5)	
B00M - R0006 - Home Base - (59.2 SQM) - Teaching Space: 1	 Student Space (27)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00M - R0008 - Practical Activities - 1hb - (19.4 SQM)	● Student Space (9)	
B00N - R0001 - Movement - (38.47 SQM)	Not Applicable	Circulation or storage space.
B00N - R0002 - Practical Activities - 1hb - (19.39 SQM)	● Student Space (8)	
B00N - R0004 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00N - R0005 - Withdrawal Space - 2hb - (11.36 SQM)	● Student Space (5)	
B00N - R0006 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00N - R0008 - Practical Activities - 1hb - (19.4 SQM)	● Student Space (9)	
B00O - R0002 - Practical Activities - 1hb - (19.18 SQM)	● Student Space (8)	
B00O - R0003 - Home Base - (60.98 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R0004 - Withdrawal Space - 2hb - (11.85 SQM)	● Student Space (5)	
B00O - R0005 - Home Base - (61.07 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R0006 - Practical Activities - 1hb - (18.73 SQM)	● Student Space (8)	
B00O - R0010 - Practical Activities - 1hb - (18.73 SQM)	● Student Space (8)	
B00O - R0011 - Home Base - (61.07 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R0012 - Withdrawal Space - 2hb - (11.85 SQM)	● Student Space (5)	
B00O - R0013 - Home Base - (61.07 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R0014 - Practical Activities - 1hb - (19.18 SQM)	● Student Space (8)	
B00O - R0016 - Movement - (89.37 SQM)	Not Applicable	Circulation or storage space.
B00O - R1002 - Practical Activities - 1hb - (19.27 SQM)	● Student Space (8)	
B00O - R1003 - Home Base - (60.92 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R1004 - Withdrawal Space - 2hb - (11.79 SQM)	● Student Space (5)	
B00O - R1005 - Home Base - (60.98 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R1006 - Practical Activities - 1hb - (18.81 SQM)	● Student Space (8)	
B00O - R1010 - Practical Activities - 1hb - (18.8 SQM)	● Student Space (8)	
B00O - R1011 - Home Base - (60.98 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R1012 - Withdrawal Space - 2hb - (11.79 SQM)	● Student Space (5)	
B00O - R1013 - Home Base - (60.92 SQM) - Teaching Space: 1	● Student Space (28)	
B00O - R1014 - Practical Activities - 1hb - (19.27 SQM)	● Student Space (8)	
B00O - R1016 - Movement - (87.32 SQM)	Not Applicable	Circulation or storage space.
B00P - R0008 - Movement - (6.26 SQM)	Not Applicable	Circulation or storage space.
B00P - R0009 - Raised Platform - (58.09 SQM)	Not Applicable	Circulation or storage space.
B00P - R0010 - Movement - (23.88 SQM)	Not Applicable	Circulation or storage space.
B00P - R0017 - Communal Space - (206.92 SQM)	● Student Space (96)	
B00P - R0018 - Canteen - (43.94 SQM)	Not Applicable	Circulation or storage space.
B00P - R0023 - Movement - (469.2 SQM)	Not Applicable	Circulation or storage space.
B00T - R0001 - Practical Activities - (19.23 SQM)	● Student Space (8)	
B00T - R0002 - Home Base - (59.07 SQM) - Teaching Space: 1	● Student Space (27)	
B00T - R0004 - Withdrawal Space - 1hb - (7.68 SQM)	● Student Space (3)	
B00T - R0005 - Practical Activities - (18.51 SQM)	● Student Space (8)	
B00T - R0006 - Home Base - (60.38 SQM) - Teaching Space: 1	● Student Space (28)	
B00T - R0008 - Withdrawal Space - 1hb - (11.78 SQM)	● Student Space (5)	
B00T - R0009 - Practical Activities - (19.07 SQM)	● Student Space (8)	
B00T - R0010 - Home Base - (60.28 SQM) - Teaching Space: 1	● Student Space (27)	
B00T - R1001 - Home Base - (59.21 SQM) - Teaching Space: 1	● Student Space (27)	
B00T - R1003 - Withdrawal Space - 1hb - (7.68 SQM)	● Student Space (3)	
B00T - R1004 - Practical Activities - (19.1 SQM)	● Student Space (8)	
B00T - R1005 - Home Base - (60.38 SQM) - Teaching Space: 1	● Student Space (28)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00T - R1007 - Withdrawal Space - 1hb - (11.78 SQM)	 Student Space (5)	
B00T - R1008 - Practical Activities - (19.04 SQM)	 Student Space (8)	
B00T - R1009 - Home Base - (60.28 SQM) - Teaching Space: 1	 Student Space (27)	
B00T - R1011 - Practical Activities - (19.23 SQM)	 Student Space (8)	
B00U - R0002 - Special Programs Room - Type 2 - (38.18 SQM)	 Student Space (17)	
OS 602 10634 - OS 602 10634 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 11765 - OS 602 11765 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 12252 - OS 602 12252 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 603 10083 - OS 603 10083 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 12317 - OS 603 12317 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 12728 - OS 603 12728 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 12861 - OS 603 12861 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 12863 - OS 603 12863 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 12904 - OS 603 12904 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 14662 - OS 603 14662 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 15871 - OS 603 15871 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 750 14057 - OS 750 14057 - Learning Unit - ESL - (38 SQM)	 Student Space (17)	
OS 750 17731 - OS 750 17731 - Learning Unit - ESL - (38 SQM)	 Student Space (17)	