


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Bermagui Public School (1204)</b>
<b>AMU REGION:</b>	<b>Southern NSW</b>
<b>STATE ELECTORATE:</b>	<b>Bega</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Bega Valley</b>

1204 - Bermagui Public School  
Site Plan (12331)

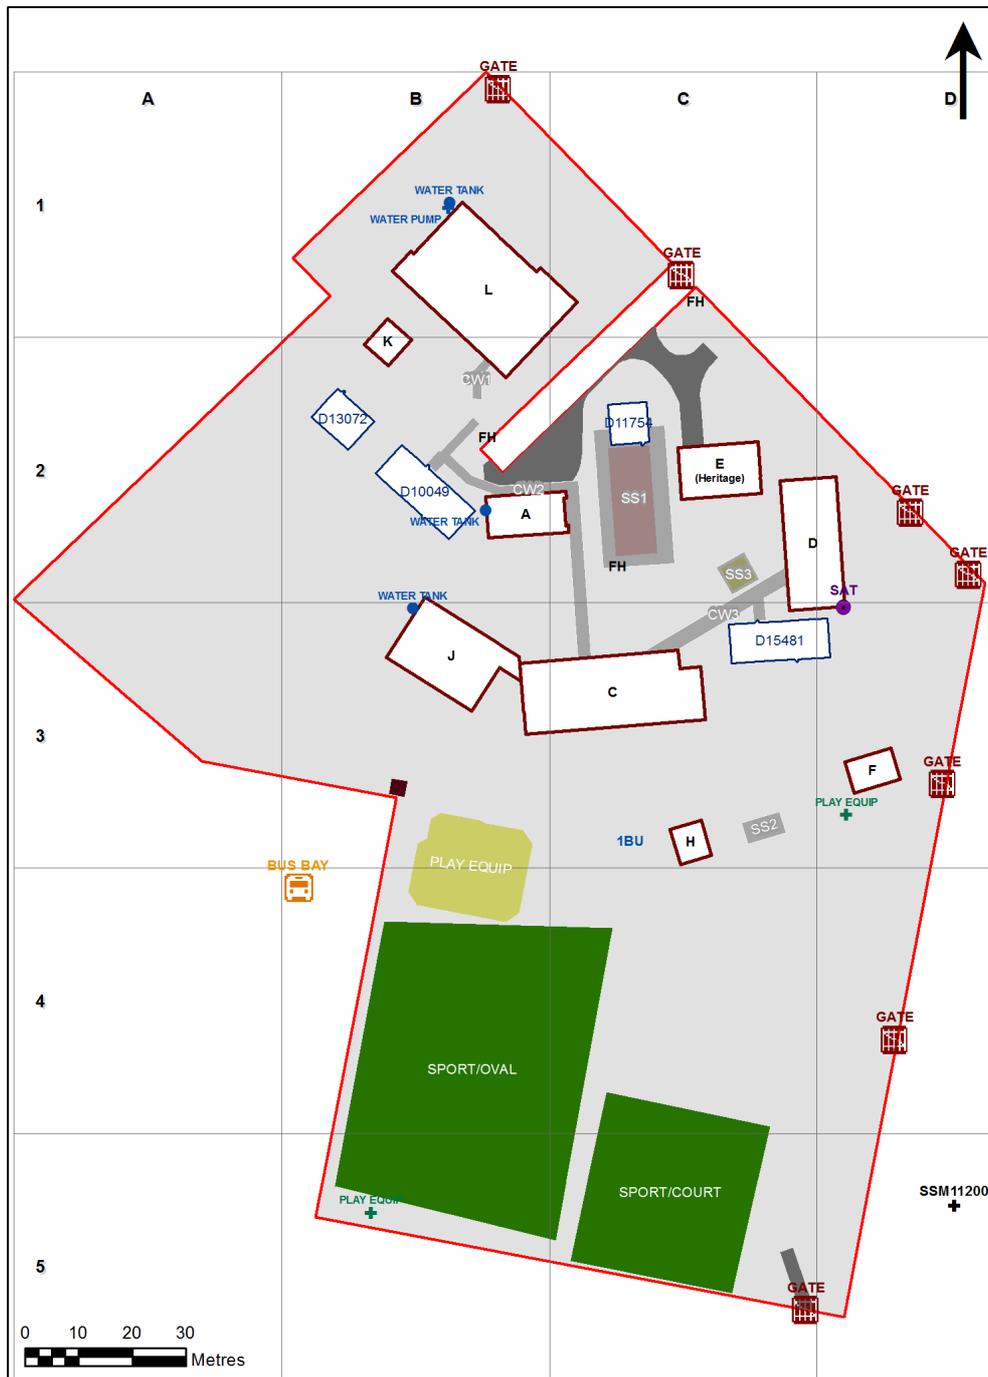

1:942

Printed: 31-Jul-2021

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0005 - Movement - (8.36 SQM)	Not Applicable	Circulation or storage space.
B00A - R0006 - Movement - (11.51 SQM)	Not Applicable	Circulation or storage space.
B00C - R0002 - Withdrawal Space - 1hb - (6.98 SQM)	● Student Space (3)	
B00C - R0003 - Withdrawal Space - 1hb - (18.65 SQM)	● Student Space (8)	
B00C - R0004 - Home Base - (52.02 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R0005 - Home Base - (51.87 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R0006 - Home Base - (52.6 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R0010 - Home Base - (53.16 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R0011 - Movement - (155.76 SQM)	Not Applicable	Circulation or storage space.
B00C - R9002 - Movement - (10.48 SQM)	Not Applicable	Circulation or storage space.
B00C - R9004 - Special Programs Room - (17.18 SQM)	● Student Space (7)	
B00C - R9005 - Special Programs Room - (32.56 SQM)	● Student Space (15)	
B00C - R9009 - Movement - (6.04 SQM)	Not Applicable	Circulation or storage space.
B00D - R0001 - Sick Bay - (18.78 SQM)	● Student Space (8)	
B00D - R0003 - Entry Vestibule - (14.69 SQM)	Not Applicable	Circulation or storage space.
B00D - R0004 - Principal - (14.65 SQM)	● Office (3)	
B00D - R0005 - Clerical Office - (13.02 SQM)	● Office (3)	
B00D - R0011 - Movement - (6.73 SQM)	Not Applicable	Circulation or storage space.
B00D - R0015 - Withdrawal Space - 1hb - (9.59 SQM)	● Student Space (4)	
B00D - R0016 - Movement - (45.48 SQM)	Not Applicable	Circulation or storage space.
B00D - R0018 - Home Base - (72.39 SQM)	● Student Space (33)	
B00E - R0001 - Communal Space - (94.3 SQM)	● Student Space (43)	
B00E - R0002 - Movement - (28.75 SQM)	Not Applicable	Circulation or storage space.
B00H - R0002 - Movement - (12.69 SQM)	Not Applicable	Circulation or storage space.
B00J - R0001 - Practical Activities - 1hb - (18.29 SQM)	● Student Space (8)	
B00J - R0002 - Home Base - (60.91 SQM) - Teaching Space: 1	● Student Space (28)	
B00J - R0004 - Home Base - (60.82 SQM) - Teaching Space: 1	● Student Space (28)	
B00J - R0006 - Practical Activities - 1hb - (19.11 SQM)	● Student Space (8)	
B00J - R0007 - Withdrawal Space - 2hb - (11.88 SQM)	● Student Space (5)	
B00J - R0008 - Movement - (57.79 SQM)	Not Applicable	Circulation or storage space.
B00L - R0001 - Movement - (11.19 SQM)	Not Applicable	Circulation or storage space.
B00L - R0002 - Movement - (6.18 SQM)	Not Applicable	Circulation or storage space.
B00L - R0003 - Raised Platform - (62.22 SQM)	Not Applicable	Circulation or storage space.
B00L - R0004 - Movement - (12.83 SQM)	Not Applicable	Circulation or storage space.
B00L - R0005 - Communal Space - (142.79 SQM)	● Student Space (66)	
OS 502 15481 - OS 502 15481 - Admin Staff/Principal/Clerk/Dup/Clinic - (152 SQM)	● Office (38)	
OS 534 10049 - OS 534 10049 - Library/Group Study/Office/A V Store - (152 SQM)	● Student Space (70)	
OS 534 13598 - OS 534 13598 - Library/Group Study/Office/A V Store - (152 SQM)	● Student Space (70)	
OS 602 13072 - OS 602 13072 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 801 11754 - OS 801 11754 - FSU - (57 SQM)	Not Applicable	Circulation or storage space.