


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Blackwell Public School (4559)</b>
<b>AMU REGION:</b>	<b>Western Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Mulgoa</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Penrith</b>

4559 - Blackwell Public School  
Site Plan (10898)

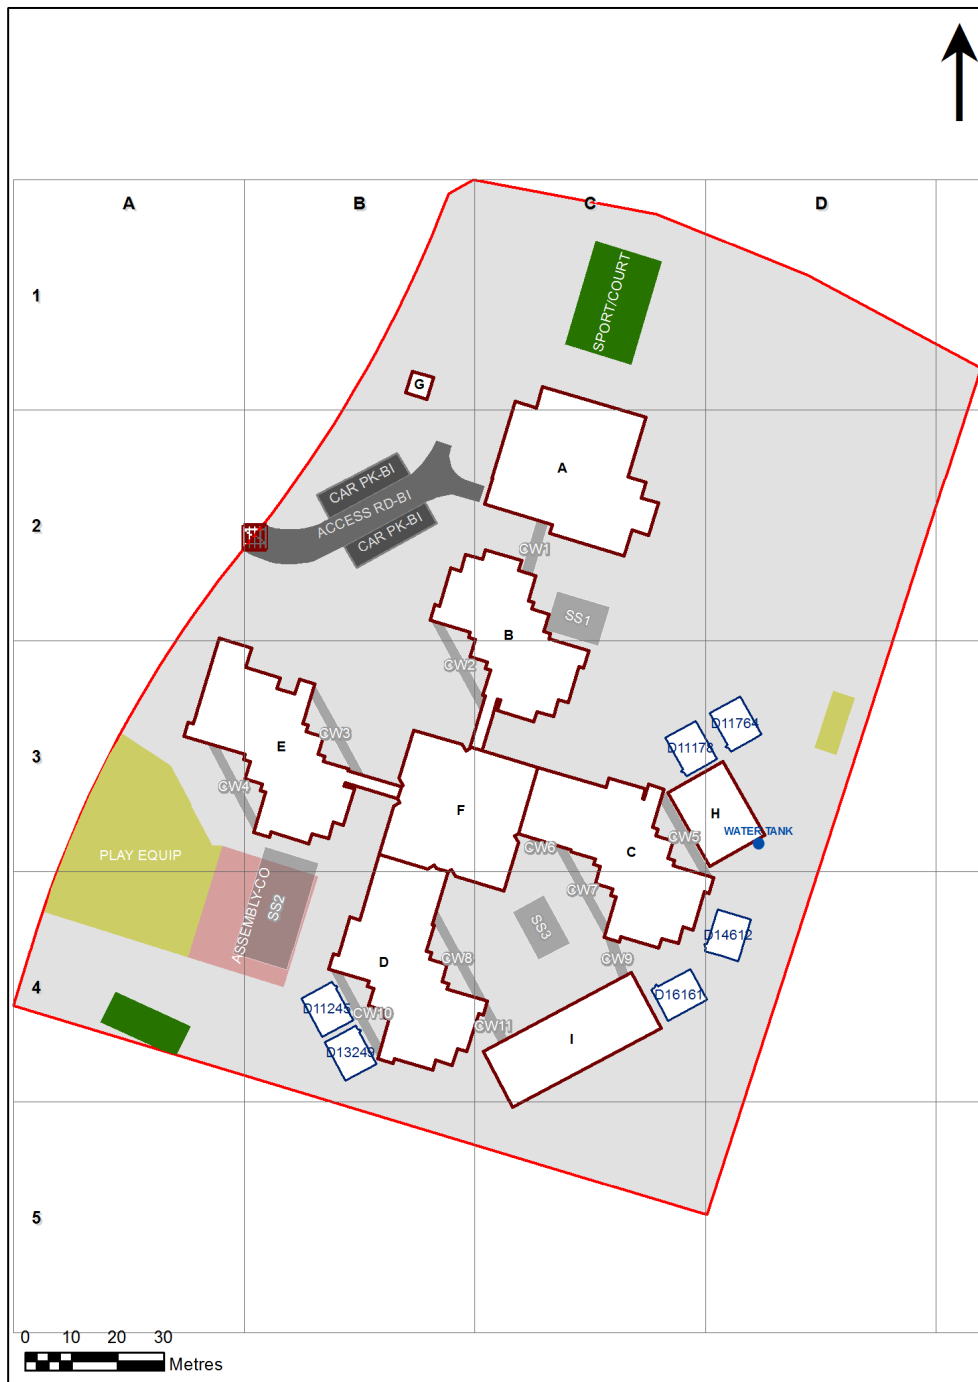

1:1,087











Printed: 11-Dec-2020

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0003 - Movement - (203.83 SQM)	Not Applicable	Circulation or storage space.
B00A - R0004 - Canteen - (42.87 SQM)	Not Applicable	Circulation or storage space.
B00A - R0007 - Communal Space - (342.65 SQM)	● Student Space (158)	
B00A - R0008 - Raised Platform - (43.08 SQM)	Not Applicable	Circulation or storage space.
B00A - R0014 - Movement - (11.23 SQM)	Not Applicable	Circulation or storage space.
B00A - R0020 - Movement - (11.72 SQM)	Not Applicable	Circulation or storage space.
B00B - R0001 - Movement - (13.62 SQM)	Not Applicable	Circulation or storage space.
B00B - R0004 - Movement - (9.95 SQM)	Not Applicable	Circulation or storage space.
B00B - R0006 - Movement - (11.54 SQM)	Not Applicable	Circulation or storage space.
B00B - R0007 - Home Base - (57.54 SQM) - Teaching Space: 1	● Student Space (26)	
B00B - R0008 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00B - R0009 - Home Base - (57.7 SQM) - Teaching Space: 1	● Student Space (26)	
B00B - R0010 - Movement - (12.43 SQM)	Not Applicable	Circulation or storage space.
B00B - R0013 - Movement - (49.32 SQM)	Not Applicable	Circulation or storage space.
B00B - R0014 - Practical Activities - 1hb - (121.32 SQM)	● Student Space (56)	
B00B - R0015 - Movement - (13.62 SQM)	Not Applicable	Circulation or storage space.
B00B - R0018 - Movement - (6.7 SQM)	Not Applicable	Circulation or storage space.
B00B - R0020 - Movement - (11.54 SQM)	Not Applicable	Circulation or storage space.
B00B - R0021 - Home Base - (58.27 SQM) - Teaching Space: 1	● Student Space (27)	
B00B - R0022 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00B - R0023 - Home Base - (57.61 SQM) - Teaching Space: 1	● Student Space (26)	
B00B - R0025 - Movement - (25.35 SQM)	Not Applicable	Circulation or storage space.
B00B - R0026 - Movement - (11.13 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Movement - (9.33 SQM)	Not Applicable	Circulation or storage space.
B00C - R0004 - Movement - (13.92 SQM)	Not Applicable	Circulation or storage space.
B00C - R0005 - Practical Activities - 1hb - (120.33 SQM)	● Student Space (55)	
B00C - R0006 - Movement - (25.82 SQM)	Not Applicable	Circulation or storage space.
B00C - R0007 - Movement - (9.33 SQM)	Not Applicable	Circulation or storage space.
B00C - R0009 - Home Base - (58.41 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R0010 - Movement - (11.55 SQM)	Not Applicable	Circulation or storage space.
B00C - R0011 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00C - R0012 - Home Base - (59.18 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R0013 - Movement - (11.55 SQM)	Not Applicable	Circulation or storage space.
B00C - R0016 - Movement - (10.63 SQM)	Not Applicable	Circulation or storage space.
B00C - R0018 - Movement - (13.8 SQM)	Not Applicable	Circulation or storage space.
B00C - R0019 - Movement - (52.35 SQM)	Not Applicable	Circulation or storage space.
B00C - R0020 - Movement - (136.44 SQM)	Not Applicable	Circulation or storage space.
B00C - R0022 - Home Base - (59.36 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R0023 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00C - R0024 - Movement - (11.38 SQM)	Not Applicable	Circulation or storage space.
B00C - R0025 - Home Base - (59.33 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0001 - Movement - (52.77 SQM)	Not Applicable	Circulation or storage space.
B00D - R0002 - Movement - (13.62 SQM)	Not Applicable	Circulation or storage space.
B00D - R0005 - Movement - (9.39 SQM)	Not Applicable	Circulation or storage space.
B00D - R0006 - Home Base - (59.16 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0008 - Movement - (11.65 SQM)	Not Applicable	Circulation or storage space.
B00D - R0009 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00D - R0010 - Movement - (11.65 SQM)	Not Applicable	Circulation or storage space.
B00D - R0012 - Home Base - (59.16 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0014 - Movement - (10.82 SQM)	Not Applicable	Circulation or storage space.
B00D - R0015 - Practical Activities - 1hb - (118.41 SQM)	● Student Space (54)	
B00D - R0016 - Movement - (13.62 SQM)	Not Applicable	Circulation or storage space.
B00D - R0017 - Movement - (25.17 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R0020 - Movement - (6.7 SQM)	Not Applicable	Circulation or storage space.
B00D - R0021 - Home Base - (59.32 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0023 - Movement - (11.54 SQM)	Not Applicable	Circulation or storage space.
B00D - R0024 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00D - R0025 - Home Base - (59.15 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0027 - Movement - (139.85 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Movement - (9.27 SQM)	Not Applicable	Circulation or storage space.
B00E - R0005 - Movement - (6.29 SQM)	Not Applicable	Circulation or storage space.
B00E - R0006 - Movement - (13.62 SQM)	Not Applicable	Circulation or storage space.
B00E - R0007 - Practical Activities - 1hb - (121.06 SQM)	● Student Space (56)	
B00E - R0008 - Movement - (52.94 SQM)	Not Applicable	Circulation or storage space.
B00E - R0009 - Home Base - (59.06 SQM) - Teaching Space: 1	● Student Space (27)	
B00E - R0011 - Movement - (11.38 SQM)	Not Applicable	Circulation or storage space.
B00E - R0012 - Withdrawal Space - 1hb - (12.96 SQM)	● Student Space (6)	
B00E - R0013 - Home Base - (59.07 SQM) - Teaching Space: 1	● Student Space (27)	
B00E - R0014 - Movement - (11.49 SQM)	Not Applicable	Circulation or storage space.
B00E - R0016 - Movement - (6.2 SQM)	Not Applicable	Circulation or storage space.
B00E - R0017 - Movement - (10.57 SQM)	Not Applicable	Circulation or storage space.
B00E - R0020 - Movement - (13.62 SQM)	Not Applicable	Circulation or storage space.
B00E - R0021 - Entry Vestibule - (17.38 SQM)	Not Applicable	Circulation or storage space.
B00E - R0022 - Movement - (32.93 SQM)	Not Applicable	Circulation or storage space.
B00E - R0026 - Entry Vestibule - (15.29 SQM)	Not Applicable	Circulation or storage space.
B00E - R0027 - Clerical Office - (11.99 SQM)	○ Office (2)	
B00E - R0028 - Duplicating Workroom - (30.22 SQM)	○ Office (7)	
B00E - R0029 - Sick Bay - (9.57 SQM)	● Student Space (4)	
B00E - R0030 - Interview - (13.11 SQM)	○ Office (3)	
B00E - R0031 - Deputy Principal - (13.27 SQM)	○ Office (3)	
B00E - R0032 - Deputy Principal - (12.78 SQM)	○ Office (3)	
B00E - R0033 - Principal - (17.73 SQM)	○ Office (4)	
B00E - R0034 - Movement - (10.17 SQM)	Not Applicable	Circulation or storage space.
B00E - R0035 - Staff Room - (63.45 SQM)	○ Office (15)	
B00E - R0036 - Staff Room Annexe - (25.52 SQM)	○ Office (6)	
B00E - R0037 - Movement - (32.63 SQM)	Not Applicable	Circulation or storage space.
B00F - R0002 - Movement - (74.21 SQM)	Not Applicable	Circulation or storage space.
B00F - R0003 - Reading Area - (424.46 SQM)	● Student Space (196)	
B00F - R0006 - Movement - (6.32 SQM)	Not Applicable	Circulation or storage space.
B00F - R0010 - Interview - (14.49 SQM)	○ Office (3)	
B00F - R0012 - Movement - (14.28 SQM)	Not Applicable	Circulation or storage space.
B00F - R0017 - Special Programs Room - (42.47 SQM)	● Student Space (19)	
B00H - R0003 - Home Base - (60.46 SQM) - Teaching Space: 1	● Student Space (28)	
B00H - R0004 - Withdrawal Space - 2hb - (11.38 SQM)	● Student Space (5)	
B00H - R0005 - Home Base - (60.46 SQM) - Teaching Space: 1	● Student Space (28)	
B00H - R0007 - Practical Activities - (18.82 SQM)	● Student Space (8)	
B00H - R0008 - Practical Activities - (18.82 SQM)	● Student Space (8)	
B00I - R0003 - Home Base - (60.46 SQM) - Teaching Space: 1	● Student Space (28)	
B00I - R0004 - Withdrawal Space - 2hb - (11.26 SQM)	● Student Space (5)	
B00I - R0005 - Home Base - (60.46 SQM) - Teaching Space: 1	● Student Space (28)	
B00I - R0008 - Home Base - (60.46 SQM) - Teaching Space: 1	● Student Space (28)	
B00I - R0009 - Withdrawal Space - 2hb - (11.26 SQM)	● Student Space (5)	
B00I - R0010 - Home Base - (60.46 SQM) - Teaching Space: 1	● Student Space (28)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00I - R0012 - Practical Activities - (18.87 SQM)	 Student Space (8)	
B00I - R0013 - Practical Activities - (18.86 SQM)	 Student Space (8)	
B00I - R0014 - Practical Activities - (18.87 SQM)	 Student Space (8)	
B00I - R0015 - Practical Activities - (18.86 SQM)	 Student Space (8)	
OS 602 11178 - OS 602 11178 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 11245 - OS 602 11245 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 11764 - OS 602 11764 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 13249 - OS 602 13249 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 14612 - OS 602 14612 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 603 16161 - OS 603 16161 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	