


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Bondi Beach Public School (1292)</b>
<b>AMU REGION:</b>	<b>Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Vaucluse</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Waverley</b>

1292 - Bondi Beach Public School  
Site Plan (12356)

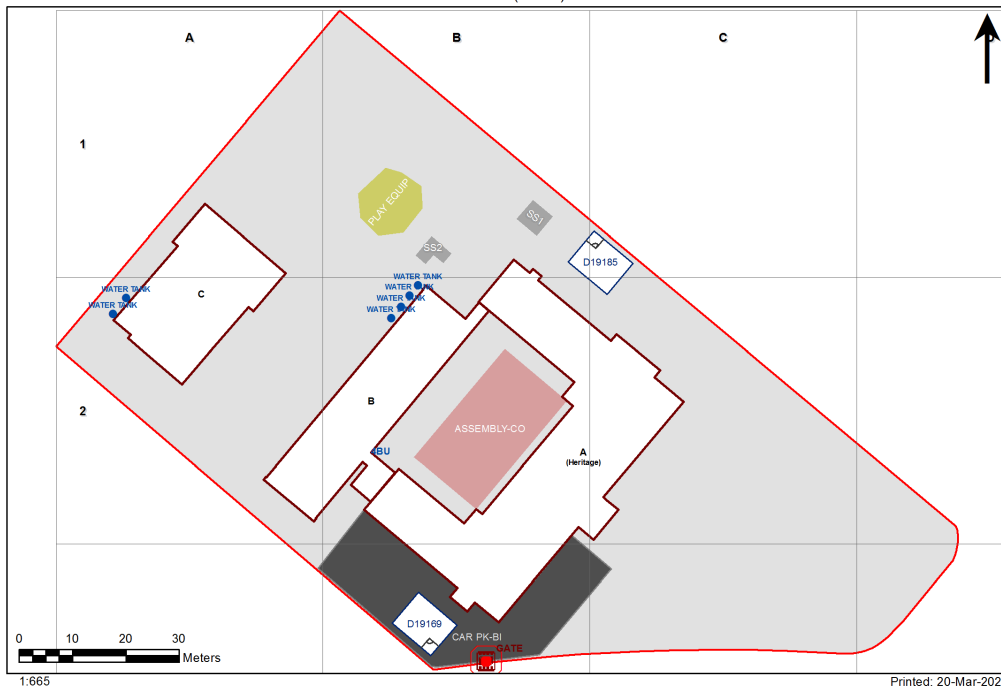

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0005 - Movement - (22.68 SQM)	Not Applicable	Circulation or storage space.
B00A - R0006 - Practical Activities - 1hb - (40.54 SQM)	● Student Space (18)	
B00A - R0007 - Home Base - (47.46 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0008 - Home Base - (47.46 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0009 - Movement - (23.15 SQM)	Not Applicable	Circulation or storage space.
B00A - R0010 - Home Base - (53.55 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0011 - Practical Activities - 1hb - (8.49 SQM)	● Student Space (3)	
B00A - R0012 - Movement - (73.25 SQM)	Not Applicable	Circulation or storage space.
B00A - R0016 - Practical Activities - 1hb - (25.55 SQM)	● Student Space (11)	
B00A - R0018 - Staff Room - (47.09 SQM)	● Office (11)	
B00A - R0019 - Sick Bay - (14.81 SQM)	● Student Space (6)	
B00A - R0021 - Clerical Office - (14.97 SQM)	● Office (3)	
B00A - R0022 - Entry Vestibule - (12.28 SQM)	Not Applicable	Circulation or storage space.
B00A - R0023 - Movement - (19.83 SQM)	Not Applicable	Circulation or storage space.
B00A - R0024 - Movement - (35.33 SQM)	Not Applicable	Circulation or storage space.
B00A - R0025 - Home Base - (46.95 SQM) - Teaching Space: 1	● Student Space (21)	
B00A - R0026 - Home Base - (46.95 SQM) - Teaching Space: 1	● Student Space (21)	
B00A - R0027 - Home Base - (47.44 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0028 - Movement - (105.91 SQM)	Not Applicable	Circulation or storage space.
B00A - R0029 - Home Base - (47.44 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0030 - Home Base - (96.52 SQM) - Teaching Space: 1	● Student Space (44)	
B00A - R0035 - Interview - (15 SQM)	● Office (3)	
B00A - R0037 - Staff Room Annexe - (17.6 SQM)	● Office (4)	
B00A - R0038 - Principal - (22.55 SQM)	● Office (5)	
B00A - R0043 - Movement - (7.99 SQM)	Not Applicable	Circulation or storage space.
B00A - R1002 - Movement - (18.06 SQM)	Not Applicable	Circulation or storage space.
B00A - R1005 - Home Base - (46.95 SQM) - Teaching Space: 1	● Student Space (21)	
B00A - R1007 - Home Base - (47.81 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1008 - Home Base - (62.04 SQM) - Teaching Space: 1	● Student Space (28)	
B00A - R1009 - Practical Activities - 1hb - (16.56 SQM)	● Student Space (7)	
B00A - R1010 - Home Base - (48.9 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1011 - Movement - (42.88 SQM)	Not Applicable	Circulation or storage space.
B00A - R1012 - Home Base - (48.9 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1013 - Home Base - (46.95 SQM) - Teaching Space: 1	● Student Space (21)	
B00A - R1014 - Home Base - (53.28 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R1015 - Home Base - (48.9 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1016 - Home Base - (48.41 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1017 - Home Base - (48.9 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1019 - Home Base - (47.44 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1020 - Home Base - (47.44 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1021 - Home Base - (47.44 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1022 - Movement - (81.81 SQM)	Not Applicable	Circulation or storage space.
B00A - R1024 - Communal Space - (146.46 SQM)	● Student Space (67)	
B00A - R1025 - Raised Platform - (17.36 SQM)	Not Applicable	Circulation or storage space.
B00B - R0006 - Movement - (278.31 SQM)	Not Applicable	Circulation or storage space.
B00B - R0007 - Canteen - (43.38 SQM)	Not Applicable	Circulation or storage space.
B00B - R1001 - Movement - (8.66 SQM)	Not Applicable	Circulation or storage space.
B00B - R1002 - Staff Room Annexe - (12.38 SQM)	● Office (3)	
B00B - R1006 - Movement - (9.31 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R1007 - Home Base - (74.75 SQM) - Teaching Space: 1	● Student Space (34)	
B00B - R1009 - Home Base - (82.39 SQM) - Teaching Space: 1	● Student Space (38)	
B00B - R1022 - Movement - (79.21 SQM)	Not Applicable	Circulation or storage space.
B00B - R1025 - Reading Area - (196.18 SQM)	● Student Space (91)	
B00C - R0001 - Communal Space - (238.2 SQM)	● Student Space (110)	
OS 606 19169 - OS 606 19169 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19185 - OS 606 19185 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	