


VENTILATION AUDIT REPORT

SCHOOL:	Brewarrina Central School (1350)
AMU REGION:	North Western NSW
STATE ELECTORATE:	Barwon
LOCAL GOVERNMENT AREA:	Brewarrina



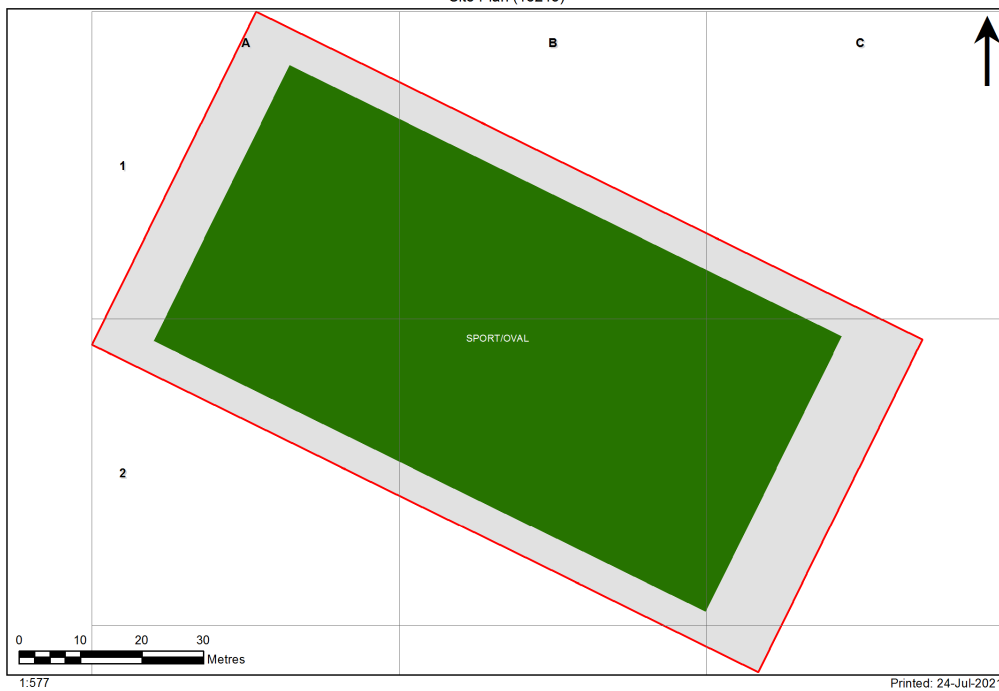






1350 - Brewarrina Central School
Site Plan (13245)



Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0002 - Canteen - (44.86 SQM)	Not Applicable	Circulation or storage space.
B00A - R0012 - Home Base - (64.51 SQM) - Teaching Space: 1	● Student Space (29)	
B00A - R1003 - Staff Room Annexe - (18.98 SQM)	● Office (4)	
B00A - R1004 - Home Base - (67.12 SQM) - Teaching Space: 1	● Student Space (31)	
B00A - R1005 - Home Base - (53.47 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R1008 - Home Base - (53.62 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R1009 - Home Base - (53.76 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R1010 - Withdrawal Space - 1hb - (16.39 SQM)	● Student Space (7)	
B00A - R1014 - Withdrawal Space - 2hb - (11.7 SQM)	● Student Space (5)	
B00A - R1015 - Practical Activities - 2hb - (10.2 SQM)	● Student Space (4)	
B00B - R1002 - Withdrawal Space - 1hb - (9.32 SQM)	● Student Space (4)	
B00B - R1003 - Deputy Principal - (12.68 SQM)	● Office (3)	
B00B - R1004 - Home Base - (53.7 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1005 - Home Base - (53.77 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1006 - Home Base - (53.63 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1009 - Home Base - (53.62 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1012 - Withdrawal Space - 1hb - (12.84 SQM)	● Student Space (5)	
B00B - R1015 - Withdrawal Space - 2hb - (11.66 SQM)	● Student Space (5)	
B00B - R1016 - Practical Activities - 2hb - (10.17 SQM)	● Student Space (4)	
B00D - R0002 - Staff Study - (72.9 SQM)	● Office (18)	
B00D - R0003 - Staff Room Annexe - (12.84 SQM)	● Office (3)	
B00D - R0006 - General Learning Space - (52.82 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0007 - Darkroom Space - (27.98 SQM)	● Office (6)	
B00D - R0008 - Movement - (7.08 SQM)	Not Applicable	Circulation or storage space.
B00D - R0014 - Computer Learning Space - (52.82 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0016 - Staff Room Annexe - (12.77 SQM)	● Office (3)	
B00D - R0017 - Food Technology L.S. - (66.15 SQM) - Teaching Space: 1	● Student Space (30)	
B00D - R0032 - General Learning Space - (51.58 SQM) - Teaching Space: 1	● Student Space (23)	
B00D - R0038 - Preparation - (23.97 SQM)	Not Applicable	Circulation or storage space.
B00D - R0039 - Laboratory L.S. - (79.04 SQM) - Teaching Space: 1	● Student Space (36)	
B00D - R0053 - Workshop Area - (137.65 SQM)	● Student Space (63)	
B00D - R0062 - General Learning Space - (82.4 SQM) - Teaching Space: 1	● Student Space (38)	
B00D - R0063 - Study Space - (15.09 SQM)	Not Applicable	Circulation or storage space.
B00D - R0064 - Study Space - (15.09 SQM)	Not Applicable	Circulation or storage space.
B00D - R0065 - Art Learning Space - (78.46 SQM) - Teaching Space: 1	● Student Space (36)	
B00D - R0070 - Kitchen - Type 2 - (13.13 SQM)	● Student Space (6)	
B00K - R0001 - Entry Vestibule - (18.04 SQM)	Not Applicable	Circulation or storage space.
B00K - R0002 - Clerical Office - (34.19 SQM)	● Office (8)	
B00K - R0003 - Principal Office - (22.07 SQM)	● Office (5)	
B00K - R0004 - Staff Room - (64.64 SQM)	● Office (16)	
B00K - R0005 - Staff Room - (28.63 SQM)	● Office (7)	
B00K - R0013 - Sick Bay - (5.41 SQM)	● Student Space (2)	
B00K - R0014 - Sick Bay - (5.85 SQM)	● Student Space (2)	
B00K - R0015 - Movement - (41.16 SQM)	Not Applicable	Circulation or storage space.
B00K - R0016 - Deputy Principal Office - (14.58 SQM)	● Office (3)	
B00K - R0017 - Deputy Principal - (12.59 SQM)	● Office (3)	
B00K - R0018 - Reading Area - (90.28 SQM)	● Student Space (41)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00K - R0022 - Seminar/Study - (15.47 SQM)	 Office (3)	
B00K - R0023 - Seminar/Study - (15.51 SQM)	 Office (3)	
B00K - R0028 - General Learning Space - (77.67 SQM) - Teaching Space: 1	 Student Space (36)	
B00K - R0031 - Deputy Principal Office - (12.15 SQM)	 Office (3)	
B00K - R0032 - Duplicating Workroom - (24.19 SQM)	 Office (6)	
B00K - R0033 - Movement - (13.16 SQM)	Not Applicable	Circulation or storage space.
B00K - R0036 - Movement - (11.14 SQM)	Not Applicable	Circulation or storage space.
B00L - R0002 - Communal Space - (113.94 SQM)	 Student Space (52)	
B00Q - R0003 - Movement - (5.17 SQM)	Not Applicable	Circulation or storage space.
B00R - R0002 - Interview/Office - Type 3 - (13.56 SQM)	 Office (3)	
B00R - R0003 - Interview/Office - Type 3 - (13.52 SQM)	 Office (3)	
B00R - R0010 - Movement - (27.24 SQM)	Not Applicable	Circulation or storage space.
OS 510 10749 - OS 510 10749 - Staff Common Room - (114 SQM)	 Office (28)	