


VENTILATION AUDIT REPORT

SCHOOL:	Bundarra Central School (1415)
AMU REGION:	North Western NSW
STATE ELECTORATE:	Northern Tablelands
LOCAL GOVERNMENT AREA:	Uralla

1415 - Bundarra Central School
Site Plan (13129)

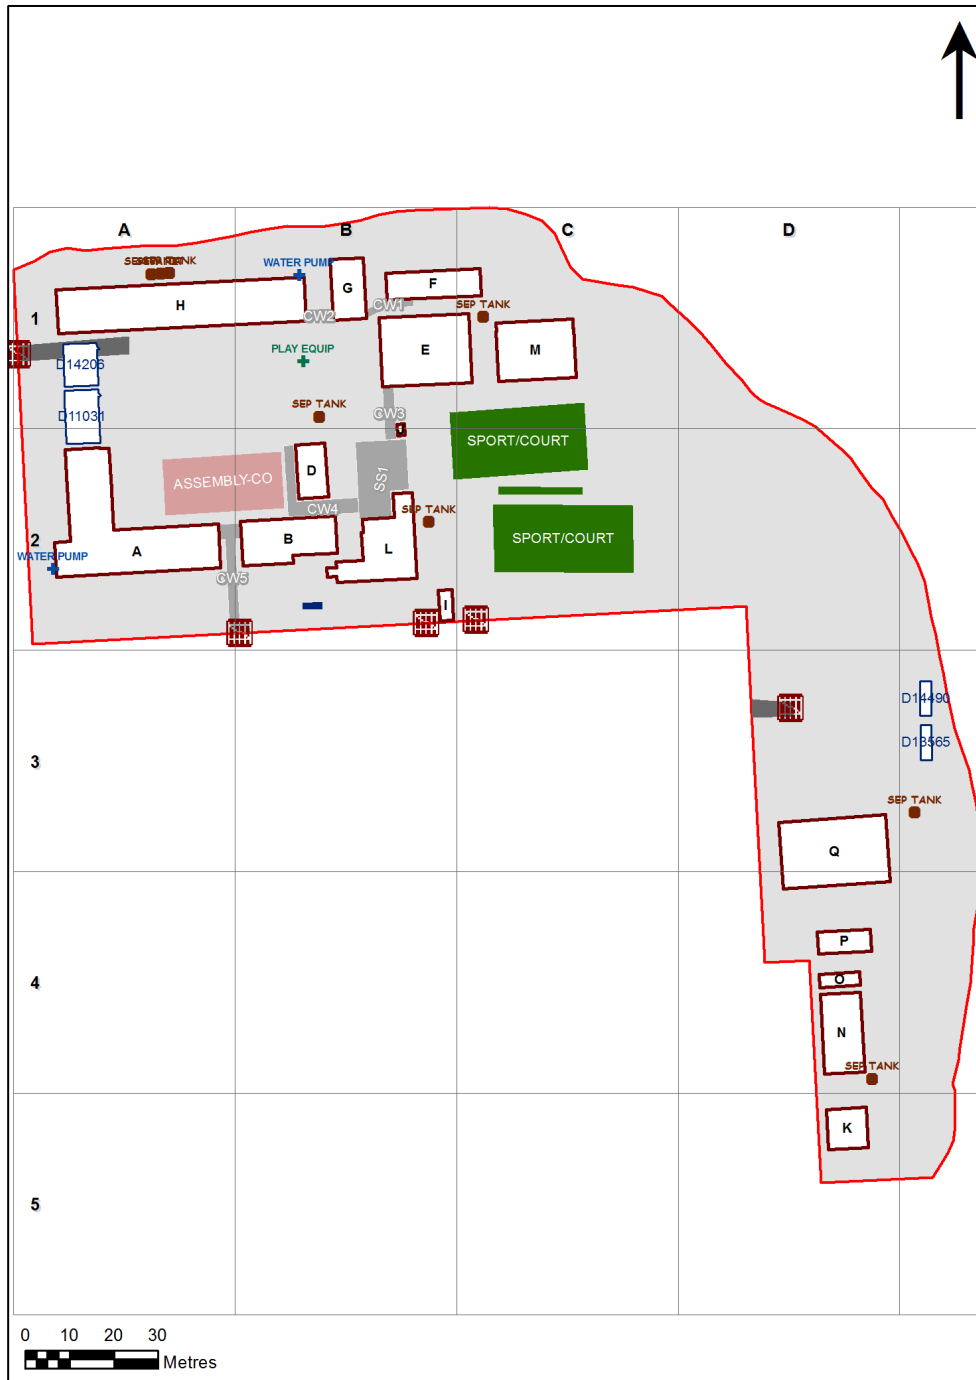

1:1,132

Printed: 11-Jun-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0003 - Home Base - (52.42 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0004 - Home Base - (52.42 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0016 - Entry Vestibule - (8.33 SQM)	Not Applicable	Circulation or storage space.
B00A - R0020 - Sick Bay - (6.54 SQM)	● Student Space (3)	
B00A - R0023 - Reading Area - (53.43 SQM)	● Student Space (24)	
B00A - R0024 - Reading Area - (47.7 SQM)	● Student Space (22)	
B00A - R0029 - Home Base - (52.56 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0030 - Staff Room - (52.56 SQM)	● Office (13)	
B00B - R0002 - General Learning Space - (53.65 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R0003 - Special Programs Room - (26.79 SQM)	● Student Space (12)	
B00B - R0005 - General Learning Space - (65.01 SQM) - Teaching Space: 1	● Student Space (30)	
B00E - R0003 - Raised Platform - (35.53 SQM)	Not Applicable	Circulation or storage space.
B00E - R0004 - Movement - (5.15 SQM)	Not Applicable	Circulation or storage space.
B00E - R0007 - Communal Space - (135.64 SQM)	● Student Space (62)	
B00E - R0008 - Movement - (75.8 SQM)	Not Applicable	Circulation or storage space.
B00E - R0009 - Staff Kitchen - (9.76 SQM)	● Office (2)	
B00F - R0004 - Workshop - (34.81 SQM)	● Student Space (16)	
B00G - R0002 - Home Base - (56.35 SQM) - Teaching Space: 1	● Student Space (26)	
B00G - R0004 - Withdrawal Space - 1hb - (10.7 SQM)	● Student Space (4)	
B00H - R0004 - Staff Room Annexe - (26.43 SQM)	● Office (6)	
B00H - R0007 - Laboratory L.S. - (79.64 SQM) - Teaching Space: 1	● Student Space (36)	
B00H - R0009 - Canteen - (28.49 SQM)	Not Applicable	Circulation or storage space.
B00H - R0013 - Metal Technology Bay - (15.84 SQM)	Not Applicable	Circulation or storage space.
B00H - R0014 - Materials Technology L.S. - (68.85 SQM) - Teaching Space: 1	● Student Space (31)	
B00H - R0018 - Seminar - Type 1 - (22.7 SQM)	● Office (5)	
B00H - R0019 - Kitchen - Type 1 - (58.54 SQM)	● Student Space (27)	
B00H - R0020 - Preparation - Materials - (12.26 SQM)	Not Applicable	Circulation or storage space.
B00K - R0002 - Movement - (25.43 SQM)	Not Applicable	Circulation or storage space.
B00L - R0011 - Movement - (5.84 SQM)	Not Applicable	Circulation or storage space.
B00L - R0012 - Movement - (22.17 SQM)	Not Applicable	Circulation or storage space.
B00L - R0014 - Visitors Office - (24.84 SQM)	● Office (6)	
B00M - R0004 - Reading Area - (121.13 SQM)	● Student Space (56)	
B00N - R0002 - Workshop Area - (124.81 SQM)	● Student Space (57)	
B00P - R0002 - Workshop Area - (27.64 SQM)	● Student Space (12)	
B00Q - R0002 - Gymnasium - (70.59 SQM)	● Student Space (32)	
B00Q - R0003 - Workshop Area - (142.97 SQM)	● Student Space (66)	
B00Q - R0005 - Lecture Space - (44.34 SQM) - Teaching Space: 2	● Student Space (20)	
OS 603 14206 - OS 603 14206 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	● Student Space (35)	