


VENTILATION AUDIT REPORT

SCHOOL:	Cammeraygal High School (8910)
AMU REGION:	Northern Sydney
STATE ELECTORATE:	North Shore
LOCAL GOVERNMENT AREA:	North Sydney

8910 - Cammeraygal High School
Site Plan (13182)

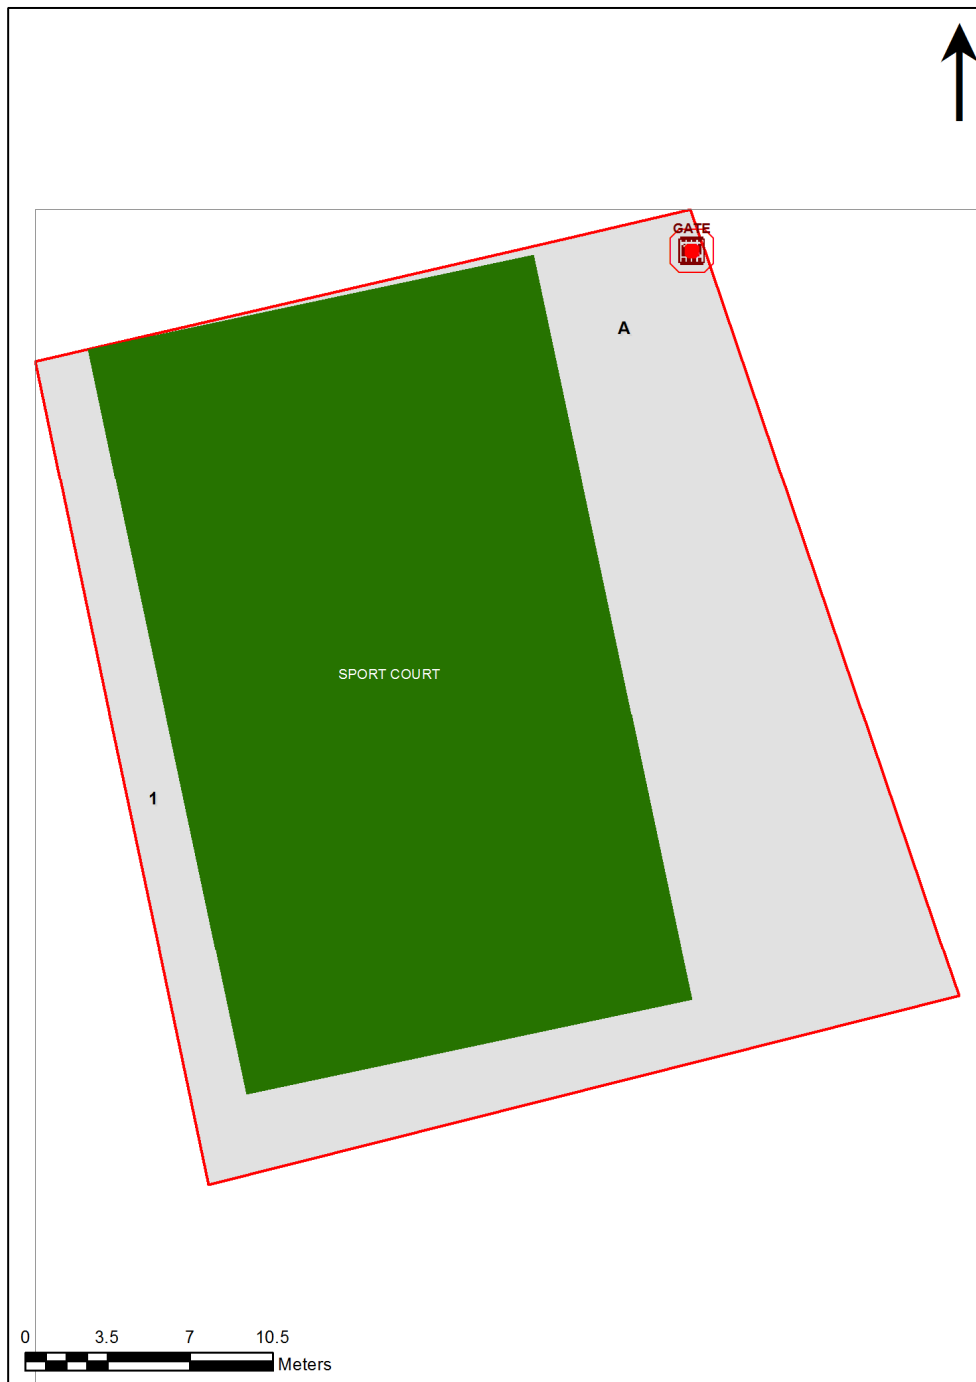

1:213

Printed: 21-Mar-2020

Ventilation Audit Key







Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R2008 - Student Canteen - (22.84 SQM)	Not Applicable	Circulation or storage space.
B00A - R3002 - Seminar - (32.01 SQM)	Office (8)	
B00A - R3003 - Seminar - (36.76 SQM)	Office (9)	
B00A - R3004 - Seminar - (36.35 SQM)	Office (9)	
B00A - R3005 - Interview/Meeting - (40.06 SQM)	Office (10)	
B00A - R3006 - Interview/Meeting - (25.49 SQM)	Office (6)	
B00A - R3008 - Public Reception - (22.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R3009 - Administration - Clerical - (26.2 SQM)	Office (6)	
B00A - R3010 - Student Reception - (25.93 SQM)	Not Applicable	Circulation or storage space.
B00A - R3011 - Interview/Office - Type 2 - (28.11 SQM)	Office (7)	
B00A - R3012 - Visitors Office - (14.5 SQM)	Office (3)	
B00A - R3013 - Movement - (64.1 SQM)	Not Applicable	Circulation or storage space.
B00A - R3015 - Tea Room - (17.13 SQM)	Not Applicable	Circulation or storage space.
B00A - R3016 - Principal Office - (27.69 SQM)	Office (6)	
B00A - R3017 - Deputy Principal Office - (15.02 SQM)	Office (3)	
B00A - R3024 - Deputy Principal Office - (18.33 SQM)	Office (4)	
B00A - R3026 - Clinic - Girls - (16.83 SQM)	Office (4)	
B00A - R3027 - Clinic - Boys - (17.42 SQM)	Office (4)	
B00A - R3028 - Movement - (35.82 SQM)	Not Applicable	Circulation or storage space.
B00A - R3029 - Entry - (21.06 SQM)	Not Applicable	Circulation or storage space.
B00A - R3030 - Entry - (14.77 SQM)	Not Applicable	Circulation or storage space.
B00A - R3031 - Movement - (30.07 SQM)	Not Applicable	Circulation or storage space.
B00A - R3033 - Administration - Clerical - (28.89 SQM)	Office (7)	
B00A - R3038 - Movement - (12.82 SQM)	Not Applicable	Circulation or storage space.
B00A - R4001 - Performance Workspace - (157.11 SQM) - Teaching Space: 1	Student Space (72)	
B00A - R4003 - Performance Workshop - (39.84 SQM)	Student Space (18)	
B00A - R4004 - Seminar - Type 2 - (28.67 SQM)	Office (7)	
B00A - R4005 - Multi Media Studio - (6.67 SQM)	Not Applicable	Circulation or storage space.
B00A - R4006 - Multi Media Studio - (6.7 SQM)	Not Applicable	Circulation or storage space.
B00A - R4007 - Movement - (92.69 SQM)	Not Applicable	Circulation or storage space.
B00A - R4009 - Performance Workshop - (81.22 SQM)	Student Space (37)	
B00A - R4010 - Performance Workshop - (53.32 SQM)	Student Space (24)	
B00A - R4013 - Practical Activities - (19.25 SQM)	Student Space (8)	
B00A - R4014 - General Learning Space - Type 1 - (52.65 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R4015 - General Learning Space - Type 1 - (53.06 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R4016 - General Learning Space - Type 1 - (52.72 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1001 - Multi-Purpose Space - (305.32 SQM)	Student Space (141)	
B00B - R1005 - Movement - (6.07 SQM)	Not Applicable	Circulation or storage space.
B00B - R1011 - Movement - (13.26 SQM)	Not Applicable	Circulation or storage space.
B00B - R2008 - Student Canteen - (26.64 SQM)	Not Applicable	Circulation or storage space.
B00B - R2013 - Movement - (12.62 SQM)	Not Applicable	Circulation or storage space.
B00B - R2014 - Movement - (6.08 SQM)	Not Applicable	Circulation or storage space.
B00B - R2019 - Outdoor Learning Space - Type 1 - (71.81 SQM)	Not Applicable	Circulation or storage space.
B00B - R2020 - Movement - (7.8 SQM)	Not Applicable	Circulation or storage space.
B00B - R2021 - Movement - (54.24 SQM)	Not Applicable	Circulation or storage space.
B00B - R2029 - Movement - (19.33 SQM)	Not Applicable	Circulation or storage space.
B00B - R3001 - Movement - (13.41 SQM)	Not Applicable	Circulation or storage space.
B00B - R3002 - Movement - (5.03 SQM)	Not Applicable	Circulation or storage space.
B00B - R3006 - Welding Area - (12.82 SQM)	Not Applicable	Circulation or storage space.
B00B - R3008 - Materials Workshop - Type 2 - (106.13 SQM)	Student Space (49)	
B00B - R3011 - Practical Activity Area - (10.43 SQM)	Student Space (4)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R3012 - General Learning Space - Type 8 - (40.69 SQM) - Teaching Space: 1	● Student Space (18)	
B00B - R3013 - Preparation - Materials - (14.91 SQM)	Not Applicable	Circulation or storage space.
B00B - R3014 - Movement - (8.92 SQM)	Not Applicable	Circulation or storage space.
B00B - R3016 - General Learning Space - Type 9 - (53.17 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R3019 - Staff Study - (85.44 SQM)	○ Office (21)	
B00B - R3022 - General Learning Space - Type 1 - (52.49 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R3025 - Movement - (72.29 SQM)	Not Applicable	Circulation or storage space.
B00B - R3028 - General Learning Space - Type 1 - (52.43 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R3029 - General Learning Space - Type 1 - (52.42 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R3032 - General Learning Space - Type 1 - (52.15 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R3034 - Movement - (13.72 SQM)	Not Applicable	Circulation or storage space.
B00B - R3037 - Practical Activities - (37.55 SQM)	● Student Space (17)	
B00B - R3038 - General Learning Space - Type 1 - (52.79 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R3041 - General Learning Space - Type 1 - (54.05 SQM) - Teaching Space: 1	● Student Space (25)	
B00B - R4004 - Visual Arts Workshop - (52.36 SQM)	● Student Space (24)	
B00B - R4005 - Visual Arts Workshop - (52.07 SQM)	● Student Space (24)	
B00B - R4008 - Visual Arts Workshop - (105.31 SQM)	● Student Space (48)	
B00B - R4012 - General Learning Space - Type 1 - (63.43 SQM) - Teaching Space: 1	● Student Space (29)	
B00B - R4015 - Staff Study - (52.5 SQM)	○ Office (13)	
B00B - R4016 - General Learning Space - Type 1 - (78.06 SQM) - Teaching Space: 1	● Student Space (36)	
B00B - R4022 - Movement - (17.64 SQM)	Not Applicable	Circulation or storage space.
B00B - R4027 - Practical Activity Area - (16.24 SQM)	● Student Space (7)	
B00B - R5005 - Food/Research Space - (16.35 SQM)	Not Applicable	Circulation or storage space.
B00B - R5006 - Food Technology L.S. - (97.12 SQM) - Teaching Space: 1	● Student Space (45)	
B00B - R5007 - Food Technology L.S. - (60.26 SQM) - Teaching Space: 1	● Student Space (27)	
B00B - R5008 - Food Technology L.S. - (43.45 SQM) - Teaching Space: 1	● Student Space (20)	
B00B - R5014 - Practical Activity Area - (14.97 SQM)	● Student Space (6)	
B00B - R5018 - Movement - (19.09 SQM)	Not Applicable	Circulation or storage space.
B00C - R1001 - Seminar - (26.96 SQM)	○ Office (6)	
B00C - R1002 - Seminar - (27.03 SQM)	○ Office (6)	
B00C - R1003 - Main Area - (186.86 SQM)	Not Applicable	Circulation or storage space.
B00C - R1005 - Movement - (17.88 SQM)	Not Applicable	Circulation or storage space.
B00C - R1008 - Computer Learning Space - (58.41 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R1009 - Movement - (39.38 SQM)	Not Applicable	Circulation or storage space.
B00C - R1010 - Laboratory L.S. - (116.02 SQM) - Teaching Space: 1	● Student Space (53)	
B00C - R1011 - Preparation - (27.66 SQM)	Not Applicable	Circulation or storage space.
B00C - R1012 - Movement - (17.41 SQM)	Not Applicable	Circulation or storage space.
B00C - R1013 - Clinic - Girls - (17.17 SQM)	○ Office (4)	
B00C - R1015 - Clinic - Boys - (8.87 SQM)	○ Office (2)	
B00C - R2001 - Staff Lounge - (73.41 SQM)	○ Office (18)	
B00C - R2005 - Staff Study - (66.78 SQM)	○ Office (16)	
B00C - R2006 - Movement - (102.79 SQM)	Not Applicable	Circulation or storage space.
B00C - R2007 - Deputy Principal Office - (14.91 SQM)	○ Office (3)	
B00C - R2008 - Principal Office - (14.97 SQM)	○ Office (3)	
B00C - R2009 - Computer Room - (93.79 SQM)	● Student Space (43)	
B00C - R2012 - General Learning Space - (47.47 SQM) - Teaching Space: 1	● Student Space (22)	
B00C - R2016 - Movement - (11.09 SQM)	Not Applicable	Circulation or storage space.
B00C - R2019 - Staff Kitchen - (17.06 SQM)	○ Office (4)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00C - R2020 - Music Learning Space - (69.9 SQM) - Teaching Space: 1	● Student Space (32)	
B00C - R2021 - Practical Activity Area - (17.8 SQM)	● Student Space (8)	
B00C - R2022 - Practical Activity Area - (13.76 SQM)	● Student Space (6)	
B00C - R2023 - Science Laboratory - (58.74 SQM)	● Student Space (27)	
B00D - R0001 - Public Reception - (102.18 SQM)	Not Applicable	Circulation or storage space.
B00D - R0003 - Movement - (6.03 SQM)	Not Applicable	Circulation or storage space.
B00D - R0007 - Administration - Clerical - (37.64 SQM)	● Office (9)	
B00D - R0008 - Administration - Executive - (19.76 SQM)	● Office (4)	
B00D - R0010 - Clinic - Boys - (8.82 SQM)	● Office (2)	
B00D - R0012 - Clinic - Girls - (9.51 SQM)	● Office (2)	
B00D - R0014 - Principal Office - (19.07 SQM)	● Office (4)	
B00D - R0015 - Deputy Principal Office - (14.16 SQM)	● Office (3)	
B00D - R0016 - Deputy Principal Office - (14.24 SQM)	● Office (3)	
B00D - R0017 - Administration - Clerical - (36.76 SQM)	● Office (9)	
B00D - R0019 - Interview/Office - Type 1 - (9.96 SQM)	● Office (2)	
B00D - R0021 - Interview/Meeting - (12.01 SQM)	● Office (3)	
B00D - R0024 - Interview/Office - Type 1 - (12.39 SQM)	● Office (3)	
B00D - R0027 - Interview/Office - Type 1 - (13.43 SQM)	● Office (3)	
B00D - R0028 - Interview/Office - Type 1 - (12.72 SQM)	● Office (3)	
B00D - R0029 - Staff Study - (143.62 SQM)	● Office (35)	
B00D - R0031 - Staff Lounge - (64.36 SQM)	● Office (16)	
B00D - R0032 - Movement - (524.46 SQM)	Not Applicable	Circulation or storage space.
B00D - R0035 - General Learning Space - (70.86 SQM) - Teaching Space: 1	● Student Space (32)	
B00D - R0036 - Seminar - (23.04 SQM)	● Office (5)	
B00D - R0038 - Seminar - (23.01 SQM)	● Office (5)	
B00D - R0039 - General Learning Space - (64.81 SQM) - Teaching Space: 1	● Student Space (30)	
B00D - R0040 - General Learning Space - (68.73 SQM) - Teaching Space: 1	● Student Space (31)	
B00D - R0051 - Independent Learning Space - (45.46 SQM) - Teaching Space: 1	● Student Space (21)	
B00D - R0052 - Stage - (65.52 SQM)	Not Applicable	Circulation or storage space.
B00D - R0053 - Multi Media Studio - (24.83 SQM)	Not Applicable	Circulation or storage space.
B00D - R0056 - Performance Workshop - (132.91 SQM)	● Student Space (61)	
B00D - R0059 - General Learning Space - (96.15 SQM) - Teaching Space: 1	● Student Space (44)	
B00D - R0062 - General Learning Space - (57.85 SQM) - Teaching Space: 1	● Student Space (26)	
B00D - R0064 - Student Canteen - (22.55 SQM)	Not Applicable	Circulation or storage space.
B00D - R0067 - Staff Kitchen - (35.56 SQM)	● Office (8)	
B00D - R0070 - Movement Studio - (147.98 SQM)	Not Applicable	Circulation or storage space.
B00D - R0073 - Fitness Laboratory - (63.29 SQM)	● Student Space (29)	
B00D - R0074 - General Learning Space - Type 13 - (59.3 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0076 - Seminar - (35.53 SQM)	● Office (8)	
B00D - R0079 - Movement - (158.66 SQM)	Not Applicable	Circulation or storage space.
B00D - R0091 - Movement - (65.42 SQM)	Not Applicable	Circulation or storage space.
B00D - R0096 - Stage - (19.7 SQM)	Not Applicable	Circulation or storage space.
B00D - R0099 - Movement - (51.99 SQM)	Not Applicable	Circulation or storage space.
B00D - R1007 - General Learning Space - (66.95 SQM) - Teaching Space: 1	● Student Space (31)	
B00D - R1008 - General Learning Space - (67.19 SQM) - Teaching Space: 1	● Student Space (31)	
B00D - R1009 - Design/Technology L.S. - (67.12 SQM) - Teaching Space: 1	● Student Space (31)	
B00D - R1010 - Movement - (241.58 SQM)	Not Applicable	Circulation or storage space.
B00D - R1014 - General Learning Space - (77.79 SQM) - Teaching Space: 1	● Student Space (36)	
B00D - R1015 - Interview/Meeting - (16.47 SQM)	● Office (4)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R1016 - General Learning Space - (76.89 SQM) - Teaching Space: 1	Student Space (35)	
B00D - R1017 - Seminar - (19.39 SQM)	Office (4)	
B00D - R1019 - General Learning Space - (76.9 SQM) - Teaching Space: 1	Student Space (35)	
B00D - R1021 - General Learning Space - (49.98 SQM) - Teaching Space: 1	Student Space (23)	
B00D - R1024 - General Learning Space - Type 2 - (34.4 SQM) - Teaching Space: 1	Student Space (15)	
B00D - R1025 - Seminar - Type 1 - (32.12 SQM)	Office (8)	
B00D - R1026 - General Learning Space - (132.52 SQM) - Teaching Space: 1	Student Space (61)	
B00D - R1027 - General Learning Space - (121.58 SQM) - Teaching Space: 1	Student Space (56)	
B00D - R1028 - Staff Study - (12.71 SQM)	Office (3)	
B00D - R1031 - General Learning Space - (88.39 SQM) - Teaching Space: 1	Student Space (41)	
B00D - R1032 - Kitchen - Type 1 - (111.97 SQM)	Student Space (51)	
B00D - R1037 - Independent Learning Space - (10.75 SQM) - Teaching Space: 1	Student Space (4)	
B00D - R1038 - Movement - (159.44 SQM)	Not Applicable	Circulation or storage space.
B00D - R1047 - Entry - (45.97 SQM)	Not Applicable	Circulation or storage space.
B00D - R1052 - Interview/Meeting - (10.01 SQM)	Office (2)	
B00D - R1053 - Interview/Meeting - (9.81 SQM)	Office (2)	
B00D - R1058 - Seminar/Study - (15.42 SQM)	Office (3)	
B00D - R1060 - Movement - (31.42 SQM)	Not Applicable	Circulation or storage space.
B00D - R1065 - Staff Kitchen - (9.72 SQM)	Office (2)	
B00D - R1076 - Outdoor Learning Area - (253.76 SQM)	Not Applicable	Circulation or storage space.
B00D - R1079 - Independent Learning Space - (10.75 SQM) - Teaching Space: 1	Student Space (4)	
B00D - R1080 - Independent Learning Space - (11.89 SQM) - Teaching Space: 1	Student Space (5)	
B00D - R1081 - Independent Learning Space - (11.41 SQM) - Teaching Space: 1	Student Space (5)	
B00D - R1082 - Independent Learning Space - (11.83 SQM) - Teaching Space: 1	Student Space (5)	
B00D - R1083 - Movement - (128.43 SQM)	Not Applicable	Circulation or storage space.
B00D - R1084 - Design/Technology L.S. - (63.55 SQM) - Teaching Space: 1	Student Space (29)	
B00D - R2001 - Movement - (53.14 SQM)	Not Applicable	Circulation or storage space.
B00D - R2007 - Senior Study - (30.03 SQM)	Office (7)	
B00D - R2008 - Interview/Meeting - (16.96 SQM)	Office (4)	
B00D - R2010 - Movement - (98.87 SQM)	Not Applicable	Circulation or storage space.
B00D - R2013 - Independent Learning Space - (123.93 SQM) - Teaching Space: 1	Student Space (57)	
B00D - R2014 - General Learning Space - (183.02 SQM) - Teaching Space: 1	Student Space (84)	
B00D - R2015 - General Learning Space - (68.08 SQM) - Teaching Space: 1	Student Space (31)	
B00D - R2016 - Senior Study - (191.06 SQM)	Office (47)	
B00D - R2017 - Seminar - (35.39 SQM)	Office (8)	
B00D - R2018 - Movement - (197.24 SQM)	Not Applicable	Circulation or storage space.
B00D - R2019 - Seminar - Type 1 - (19.27 SQM)	Office (4)	
B00D - R2020 - General Learning Space - (59.79 SQM) - Teaching Space: 1	Student Space (27)	
B00D - R2023 - Movement - (8.68 SQM)	Not Applicable	Circulation or storage space.
B00D - R2024 - Seminar - Type 1 - (31.43 SQM)	Office (7)	
B00D - R2025 - Science Laboratory - (99.51 SQM)	Student Space (46)	
B00D - R2026 - Preparation - (41.02 SQM)	Not Applicable	Circulation or storage space.
B00D - R2029 - Science Laboratory - (85.67 SQM)	Student Space (39)	
B00D - R9001 - Wood Technology Bay - (106.76 SQM)	Not Applicable	Circulation or storage space.
B00D - R9006 - Movement - (47.8 SQM)	Not Applicable	Circulation or storage space.
B00D - R9007 - Metal Technology Bay - (104.03 SQM)	Not Applicable	Circulation or storage space.
B00D - R9013 - Movement - (88.02 SQM)	Not Applicable	Circulation or storage space.
B00D - R9018 - General Learning Space - (59.7 SQM) - Teaching Space: 1	Student Space (27)	
B00D - R9019 - General Assistants - (12.41 SQM)	Office (3)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R9021 - Movement - (108.49 SQM)	Not Applicable	Circulation or storage space.
B00D - R9022 - Interview/Office - Type 1 - (13.55 SQM)	 Office (3)	
B00D - R9023 - Seminar - Type 1 - (27.23 SQM)	 Office (6)	
B00D - R9025 - Staff Study - (12.76 SQM)	 Office (3)	
B00D - R9027 - Dark Room - (25.43 SQM)	 Office (6)	
B00D - R9030 - Multi Media Workshop - (91.09 SQM)	Not Applicable	Circulation or storage space.
B00D - R9032 - Art Learning Space - (120.74 SQM) - Teaching Space: 1	 Student Space (56)	
B00D - R9047 - Movement - (8.5 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Movement - (11.4 SQM)	Not Applicable	Circulation or storage space.
B00E - R9001 - Gymnasium - (669.38 SQM)	 Student Space (310)	
B00E - R9002 - Stage - (106.58 SQM)	Not Applicable	Circulation or storage space.
B00E - R9004 - Movement - (17.45 SQM)	Not Applicable	Circulation or storage space.
B00E - R9005 - Movement - (18.22 SQM)	Not Applicable	Circulation or storage space.
B00E - R9011 - Movement - (7.38 SQM)	Not Applicable	Circulation or storage space.
B00E - R9024 - Movement - (6.45 SQM)	Not Applicable	Circulation or storage space.
B00E - R9028 - Movement - (10.95 SQM)	Not Applicable	Circulation or storage space.