


VENTILATION AUDIT REPORT

| | |
|-------------------------------|--|
| SCHOOL: | Canterbury Girls High School (8806) |
| AMU REGION: | Sydney |
| STATE ELECTORATE: | Canterbury |
| LOCAL GOVERNMENT AREA: | Canterbury-Bankstown |

8806 - Canterbury Girls High School
Site Plan (12213)

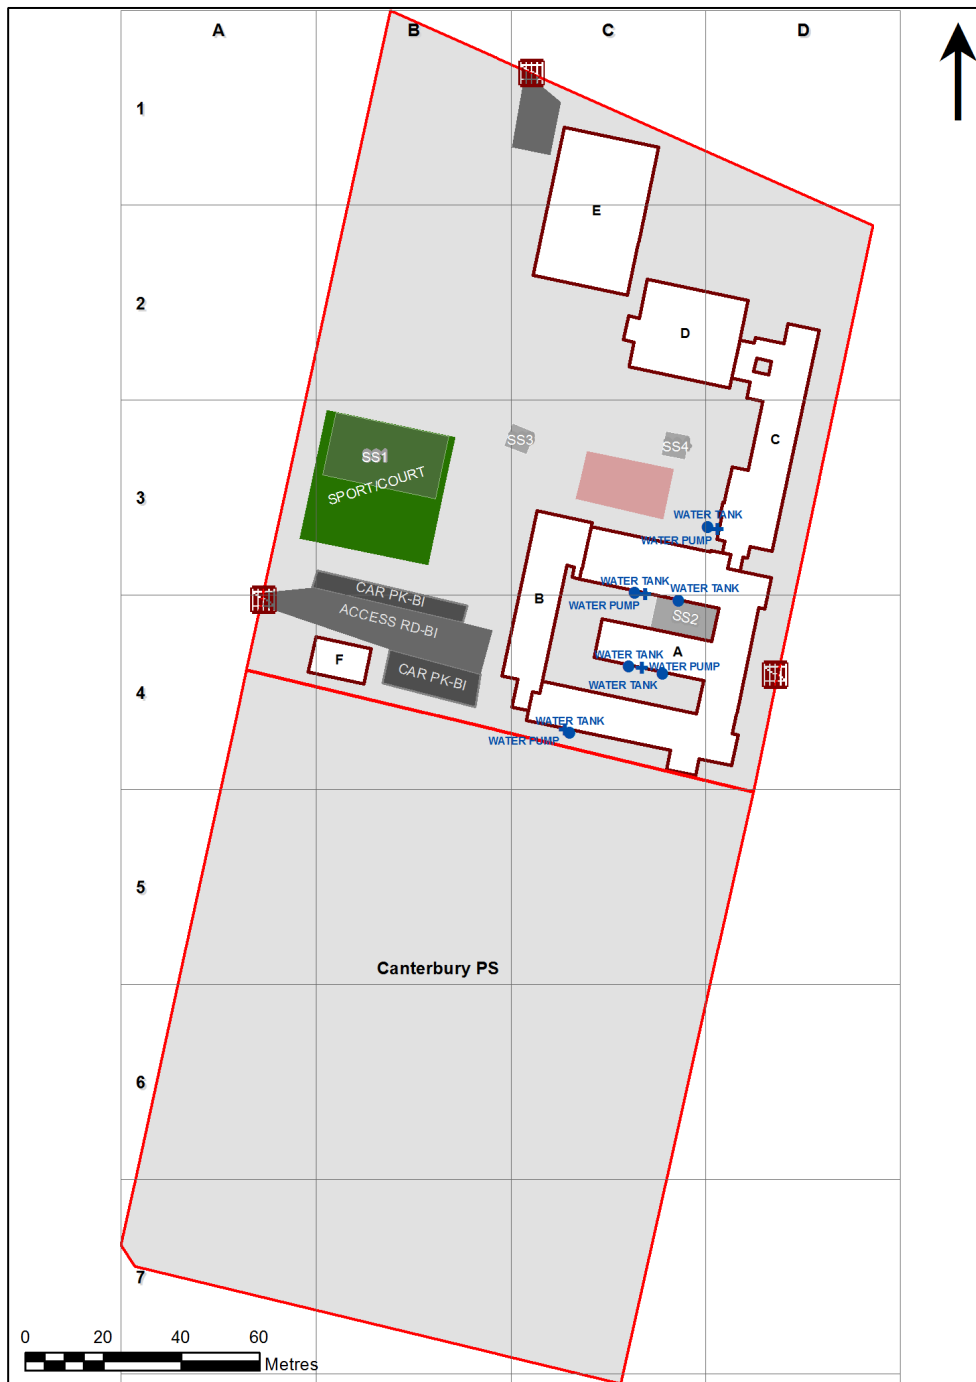

1:1,287

Printed: 11-Sep-2021

Ventilation Audit Key

| Category | Description |
|---|--|
|  | Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings. |
|  | Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces. |

| Entity Location | Audit Condition Classification (Capacity) | Comment |
|---|---|-------------------------------|
| B00A - R0001 - Staff Study - (45.3 SQM) | Office (11) | |
| B00A - R0003 - Computer Learning Space - (48.7 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0004 - Computer Learning Space - (48.7 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0005 - Public Entry - (13.12 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R0006 - Public Entry - (7.27 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R0007 - Administration - Clerical - (48.63 SQM) | Office (12) | |
| B00A - R0008 - Principal Office - (48.63 SQM) | Office (12) | |
| B00A - R0009 - General Learning Space - (59.54 SQM) - Teaching Space: 1 | Student Space (27) | |
| B00A - R0012 - Leading Teacher - (8.86 SQM) | Office (2) | |
| B00A - R0014 - General Learning Space - (48.49 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0015 - General Learning Space - (48.48 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0016 - General Learning Space - (48.48 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0017 - General Learning Space - (48.62 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0018 - General Learning Space - (48.48 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R0020 - Interview/Office - Type 1 - (10.18 SQM) | Office (2) | |
| B00A - R0021 - Multi-Purpose Space - (159.96 SQM) | Student Space (74) | |
| B00A - R0022 - Movement - (5.06 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R0023 - Stage - (34.08 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R0024 - Clinic - Girls - (9.07 SQM) | Office (2) | |
| B00A - R0025 - Administration - Clerical - (5.73 SQM) | Office (1) | |
| B00A - R0026 - Interview/Office - Type 1 - (9.28 SQM) | Office (2) | |
| B00A - R0028 - Duplicating Workroom - (13.11 SQM) | Office (3) | |
| B00A - R0031 - Public Entry - (9.12 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R0032 - Design L.S. - (66.32 SQM) - Teaching Space: 1 | Student Space (30) | |
| B00A - R0033 - Design L.S. - (65.46 SQM) - Teaching Space: 1 | Student Space (30) | |
| B00A - R0034 - Design L.S. - (64.04 SQM) - Teaching Space: 1 | Student Space (29) | |
| B00A - R0035 - Staff Study - (30.16 SQM) | Office (7) | |
| B00A - R0039 - Leading Teacher - (10.33 SQM) | Office (2) | |
| B00A - R0040 - Staff Study - (28.2 SQM) | Office (7) | |
| B00A - R0043 - Movement - (340.65 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R1002 - Music Learning Space - (60.28 SQM) - Teaching Space: 1 | Student Space (27) | |
| B00A - R1003 - General Learning Space - (49.5 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R1004 - General Learning Space - (49.65 SQM) - Teaching Space: 1 | Student Space (23) | |
| B00A - R1005 - Staff Study - (21.55 SQM) | Office (5) | |
| B00A - R1006 - General Learning Space - (49.51 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R1007 - Music Learning Space - (49.64 SQM) - Teaching Space: 1 | Student Space (23) | |
| B00A - R1009 - Music Learning Space - (60.11 SQM) - Teaching Space: 1 | Student Space (27) | |
| B00A - R1010 - Staff Study - (8.11 SQM) | Office (2) | |
| B00A - R1012 - General Learning Space - (49.43 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R1013 - General Learning Space - (49.49 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R1014 - General Learning Space - (49.36 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R1015 - General Learning Space - (49.49 SQM) - Teaching Space: 1 | Student Space (22) | |
| B00A - R1016 - General Learning Space - (50.1 SQM) - Teaching Space: 1 | Student Space (23) | |
| B00A - R1020 - Staff Study - (6.62 SQM) | Office (1) | |
| B00A - R1021 - Preparation - (16.6 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R1022 - Laboratory L.S. - (82.19 SQM) - Teaching Space: 1 | Student Space (38) | |
| B00A - R1023 - Darkroom Space - (23.47 SQM) | Office (5) | |

| Entity Location | Audit Condition Classification (Capacity) | Comment |
|---|---|-------------------------------|
| B00A - R1024 - Darkroom Space - (29.94 SQM) | Office (7) | |
| B00A - R1025 - General Learning Space - (66.84 SQM) - Teaching Space: 1 | Student Space (31) | |
| B00A - R1026 - Movement - (305.97 SQM) | Not Applicable | Circulation or storage space. |
| B00A - R9008 - General Assistants - (10.61 SQM) | Office (2) | |
| B00A - R9009 - Movement - (6.37 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R0004 - Staff Study - (26.5 SQM) | Office (6) | |
| B00B - R0005 - General Learning Space - (51.83 SQM) - Teaching Space: 1 | Student Space (24) | |
| B00B - R0006 - General Learning Space - (52.99 SQM) - Teaching Space: 1 | Student Space (24) | |
| B00B - R0007 - General Learning Space - (53.36 SQM) - Teaching Space: 1 | Student Space (24) | |
| B00B - R0011 - Staff Study - (25.87 SQM) | Office (6) | |
| B00B - R0012 - Staff Lounge - (93.37 SQM) | Office (23) | |
| B00B - R1003 - Seminar - Type 1 - (26.42 SQM) | Office (6) | |
| B00B - R1005 - General Learning Space - (52.92 SQM) - Teaching Space: 1 | Student Space (24) | |
| B00B - R1007 - General Learning Space - (52.78 SQM) - Teaching Space: 1 | Student Space (24) | |
| B00B - R1008 - Tiered Learning Area - (25.45 SQM) | Student Space (11) | |
| B00B - R1011 - General Learning Space - (66.1 SQM) - Teaching Space: 1 | Student Space (30) | |
| B00B - R1012 - Study Space - (12.99 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R1013 - Staff Study - (12.25 SQM) | Office (3) | |
| B00B - R1014 - Study Space - (12.96 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R1015 - Study Space - (12.96 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R9002 - Movement - (41.49 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R9004 - Student Canteen - (42.45 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R9008 - Movement - (17.02 SQM) | Not Applicable | Circulation or storage space. |
| B00B - R9012 - Commonroom - (331.14 SQM) | Office (82) | |
| B00C - R0001 - Laboratory L.S. - (94.61 SQM) - Teaching Space: 1 | Student Space (43) | |
| B00C - R0002 - Growing/Breeding - (9.75 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R0003 - Preparation - (28.73 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R0004 - Laboratory L.S. - (93.74 SQM) - Teaching Space: 1 | Student Space (43) | |
| B00C - R0008 - Art Learning Space - (65.75 SQM) - Teaching Space: 1 | Student Space (30) | |
| B00C - R0010 - Staff Study - (37.86 SQM) | Office (9) | |
| B00C - R0011 - Leading Teacher - (12.22 SQM) | Office (3) | |
| B00C - R0012 - Deputy Principal Office - (16.84 SQM) | Office (4) | |
| B00C - R0014 - Movement - (5.59 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R0015 - Duplicating Workroom - (13.94 SQM) | Office (3) | |
| B00C - R0017 - Movement - (39.41 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R0023 - Movement - (41.21 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R0025 - Movement - (132.73 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R1001 - Laboratory L.S. - (94.47 SQM) - Teaching Space: 1 | Student Space (43) | |
| B00C - R1004 - Laboratory L.S. - (93.53 SQM) - Teaching Space: 1 | Student Space (43) | |
| B00C - R1008 - Art Learning Space - (52.05 SQM) - Teaching Space: 1 | Student Space (24) | |
| B00C - R1010 - Art Learning Space - (57.87 SQM) - Teaching Space: 1 | Student Space (26) | |
| B00C - R1013 - Movement - (39.24 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R1017 - Movement - (25.11 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R1019 - Preparation - Science - (39 SQM) | Not Applicable | Circulation or storage space. |
| B00C - R1020 - Movement - (136.58 SQM) | Not Applicable | Circulation or storage space. |
| B00D - M1002 - Main Area - (151.16 SQM) | Not Applicable | Circulation or storage space. |
| B00D - M1003 - Seminar - (13.25 SQM) | Office (3) | |
| B00D - R0003 - Food Technology L.S. - (81.53 SQM) - Teaching Space: 1 | Student Space (37) | |
| B00D - R0006 - Food/Research Space - (15.46 SQM) | Not Applicable | Circulation or storage space. |
| B00D - R0007 - Food/Research Space - (15.99 SQM) | Not Applicable | Circulation or storage space. |

| Entity Location | Audit Condition Classification (Capacity) | Comment |
|---|---|-------------------------------|
| B00D - R0008 - Food Technology L.S. - (82.17 SQM) - Teaching Space: 1 | ● Student Space (38) | |
| B00D - R0009 - Food Technology L.S. - (82.45 SQM) - Teaching Space: 1 | ● Student Space (38) | |
| B00D - R0010 - Food/Research Space - (15.51 SQM) | Not Applicable | Circulation or storage space. |
| B00D - R0012 - Seminar/Technology Space - (32.15 SQM) | ● Office (8) | |
| B00D - R0013 - Staff Study - (31.01 SQM) | ● Office (7) | |
| B00D - R0015 - General Learning Space - (49.22 SQM) - Teaching Space: 1 | ● Student Space (22) | |
| B00D - R0016 - Movement - (62.49 SQM) | Not Applicable | Circulation or storage space. |
| B00D - R0020 - Movement - (6.58 SQM) | Not Applicable | Circulation or storage space. |
| B00D - R1002 - Workroom - (19.73 SQM) | ● Office (4) | |
| B00D - R1003 - Audio Visual Workroom - (32.62 SQM) | ● Student Space (15) | |
| B00D - R1007 - Main Area - (407.79 SQM) | Not Applicable | Circulation or storage space. |
| B00D - R1008 - Seminar - (13.29 SQM) | ● Office (3) | |
| B00D - R1009 - Seminar - (13.62 SQM) | ● Office (3) | |
| B00D - R1012 - Seminar - (13.1 SQM) | ● Office (3) | |
| B00D - R1013 - Seminar - (16.37 SQM) | ● Office (4) | |
| B00D - R9001 - Art Learning Space - (105.61 SQM) - Teaching Space: 1 | ● Student Space (48) | |
| B00E - R0004 - Multi-Purpose Space - (518.28 SQM) | ● Student Space (240) | |
| B00E - R0005 - Student Canteen - (15.24 SQM) | Not Applicable | Circulation or storage space. |
| B00E - R0006 - Staff Study - (9.08 SQM) | ● Office (2) | |
| B00E - R0007 - Staff Study - (9.12 SQM) | ● Office (2) | |
| B00E - R0013 - Movement - (67.03 SQM) | Not Applicable | Circulation or storage space. |
| B00E - R0014 - Stage - (69.11 SQM) | Not Applicable | Circulation or storage space. |
| B00F - R0002 - Multi-Purpose Space - (92.19 SQM) | ● Student Space (42) | |
| B00F - R0003 - Movement - (10.64 SQM) | Not Applicable | Circulation or storage space. |