


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Carlton South Public School (1513)</b>
<b>AMU REGION:</b>	<b>Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Kogarah</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Georges River</b>

1513 - Carlton South Public School  
Site Plan (12225)

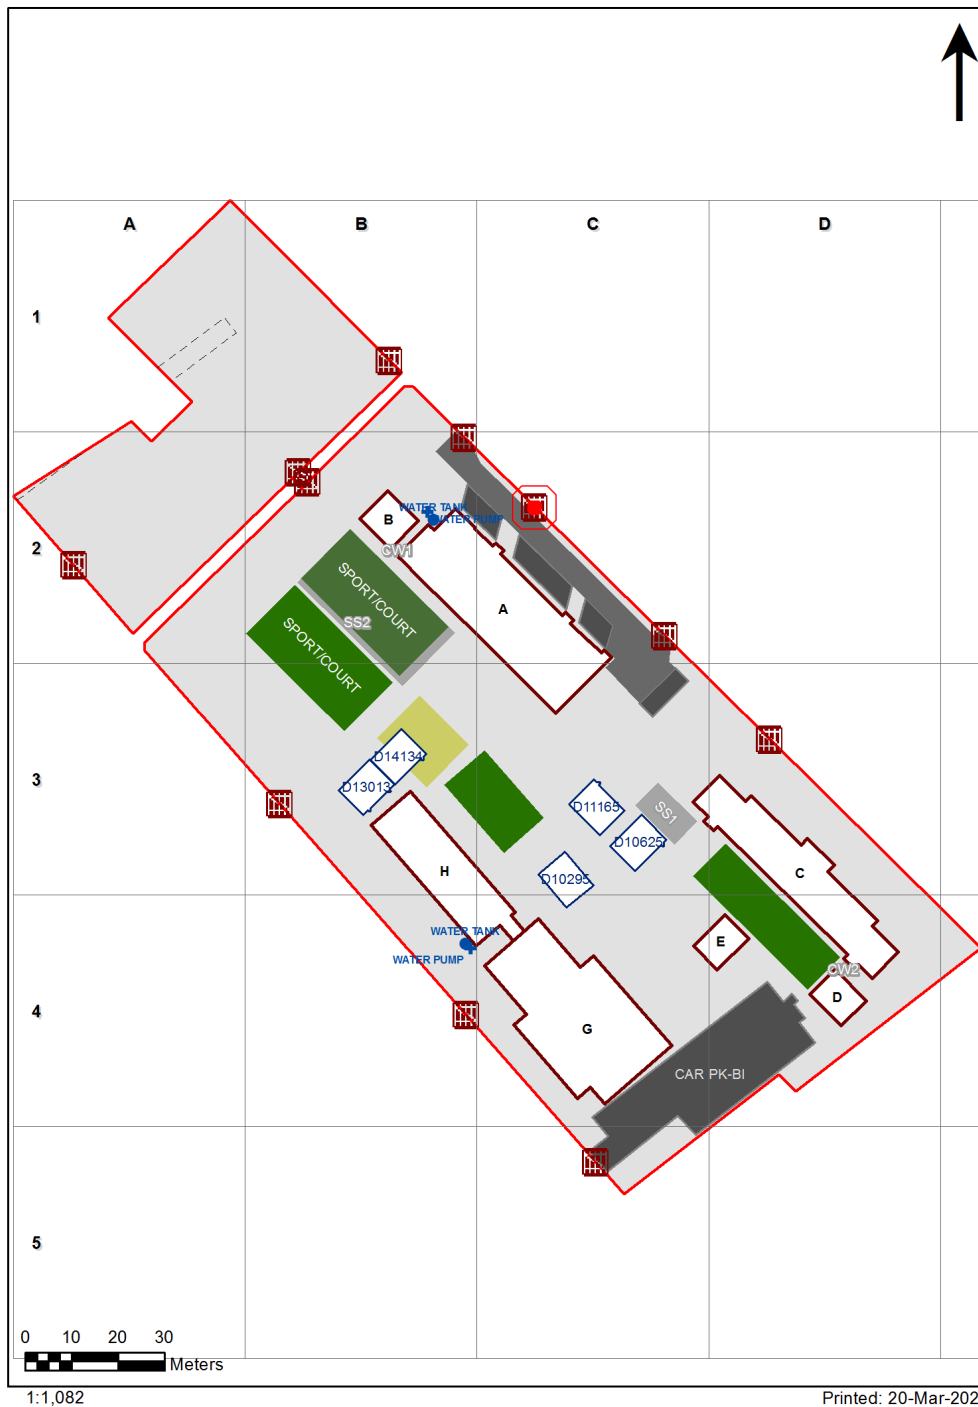

1:1,082

Printed: 20-Mar-2020

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0005 - Home Base - (47.38 SQM) - Teaching Space: 1	● Student Space (21)	
B00A - R0006 - Home Base - (47.86 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0007 - Home Base - (47.86 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0008 - Home Base - (47.69 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0009 - Home Base - (47.69 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0010 - Home Base - (47.38 SQM) - Teaching Space: 1	● Student Space (21)	
B00A - R0017 - Entry Vestibule - (15.28 SQM)	Not Applicable	Circulation or storage space.
B00A - R0018 - Sick Bay - (7.6 SQM)	● Student Space (3)	
B00A - R0020 - Clerical Office/Workroom - (34.07 SQM)	● Office (8)	
B00A - R0021 - Principal - (20.82 SQM)	● Office (5)	
B00A - R0022 - Clerical Office - (20.65 SQM)	● Office (5)	
B00A - R0023 - Movement - (54.53 SQM)	Not Applicable	Circulation or storage space.
B00A - R0024 - Movement - (15.79 SQM)	Not Applicable	Circulation or storage space.
B00A - R0026 - Withdrawal Space - 2hb - (87.72 SQM)	● Student Space (40)	
B00A - R0031 - Duplicating Workroom - (7.26 SQM)	● Office (1)	
B00A - R0032 - Sick Bay - (7.77 SQM)	● Student Space (3)	
B00A - R1003 - Home Base - (50.62 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1004 - Home Base - (50.48 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1005 - Home Base - (49.08 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1007 - Home Base - (50.2 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1008 - Home Base - (49.86 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1009 - Movement - (21.92 SQM)	Not Applicable	Circulation or storage space.
B00A - R1014 - Movement - (42.89 SQM)	Not Applicable	Circulation or storage space.
B00A - R1017 - Home Base - (48.05 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1018 - Withdrawal Space - 2hb - (11.92 SQM)	● Student Space (5)	
B00A - R1020 - Home Base - (62.75 SQM) - Teaching Space: 1	● Student Space (29)	
B00A - R1021 - Home Base - (49.89 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1022 - Practical Activities - (46.17 SQM)	● Student Space (21)	
B00A - R1023 - Staff Room - (83.81 SQM)	● Office (20)	
B00C - R0009 - Home Base - (47.34 SQM) - Teaching Space: 1	● Student Space (21)	
B00C - R0010 - Home Base - (47.27 SQM) - Teaching Space: 1	● Student Space (21)	
B00C - R0011 - Home Base - (61.31 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0012 - Home Base - (47.47 SQM) - Teaching Space: 1	● Student Space (22)	
B00C - R0013 - Special Programs Room - (45.46 SQM)	● Student Space (21)	
B00C - R0017 - Staff Room Annexe - (8.77 SQM)	● Office (2)	
B00C - R0021 - Movement - (116.41 SQM)	Not Applicable	Circulation or storage space.
B00C - R1001 - Withdrawal Space - 1hb - (27.23 SQM)	● Student Space (12)	
B00C - R1004 - Home Base - (48.19 SQM) - Teaching Space: 1	● Student Space (22)	
B00C - R1005 - Home Base - (48.2 SQM) - Teaching Space: 1	● Student Space (22)	
B00C - R1008 - Home Base - (48.06 SQM) - Teaching Space: 1	● Student Space (22)	
B00C - R1009 - Home Base - (48.06 SQM) - Teaching Space: 1	● Student Space (22)	
B00C - R1011 - Staff Room - (22.78 SQM)	● Office (5)	
B00C - R1013 - Movement - (107.41 SQM)	Not Applicable	Circulation or storage space.
B00C - R1016 - Breakout Area - (48.35 SQM)	Not Applicable	Circulation or storage space.
B00E - R0003 - Canteen - (38.04 SQM)	Not Applicable	Circulation or storage space.
B00G - R0001 - Communal Space - (201.89 SQM)	● Student Space (93)	
B00G - R0002 - Raised Platform - (54.19 SQM)	Not Applicable	Circulation or storage space.
B00G - R0011 - Movement - (10.81 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00G - R0012 - Movement - (26.52 SQM)	Not Applicable	Circulation or storage space.
B00H - R0001 - Reading Area - (231.75 SQM)	● Student Space (107)	
OS 602 10625 - OS 602 10625 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 602 11165 - OS 602 11165 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 603 14134 - OS 603 14134 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	● Student Space (35)	
OS 606 10295 - OS 606 10295 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 751 13013 - OS 751 13013 - Learning Unit - ESL - (76 SQM)	● Student Space (35)	