


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Cartwright Public School (4360)</b>
<b>AMU REGION:</b>	<b>South Western Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Liverpool</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Liverpool</b>

4360 - Cartwright Public School  
Site Plan (10254)

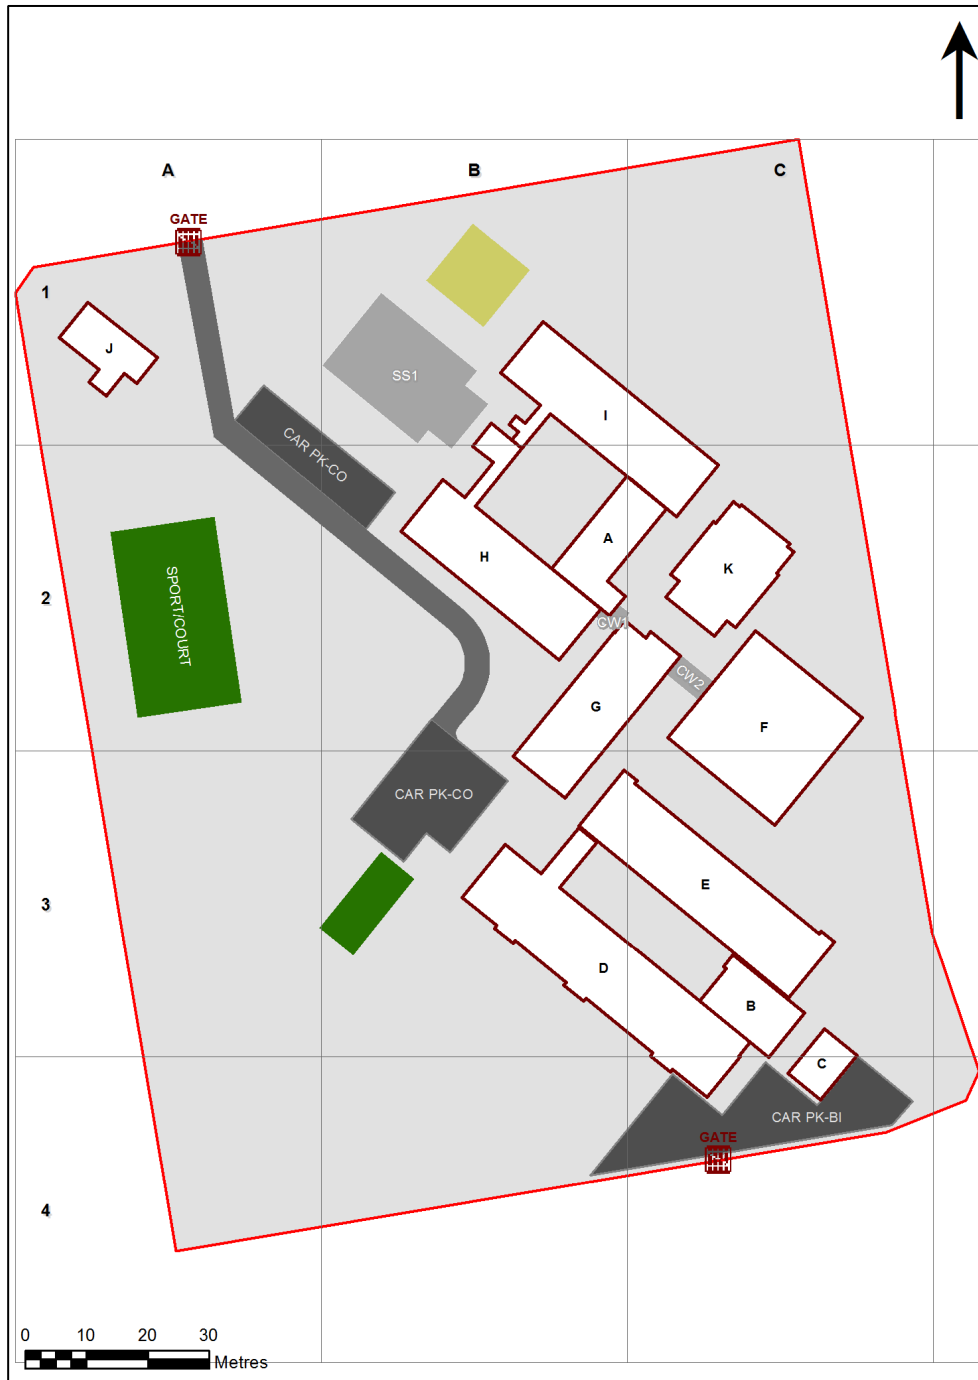

1:820

Printed: 10-May-2021

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0005 - Movement - (42.75 SQM)	Not Applicable	Circulation or storage space.
B00A - R1005 - Movement - (46.53 SQM)	Not Applicable	Circulation or storage space.
B00B - R0008 - Breakout Area - (21.75 SQM)	Not Applicable	Circulation or storage space.
B00B - R0009 - Home Base - M - (42.07 SQM) - Teaching Space: 1	● Student Space (19)	
B00B - R0010 - Practical Activities - M - 1hb - (17.82 SQM)	● Student Space (8)	
B00B - R0013 - Withdrawal - M - (9.47 SQM)	● Student Space (4)	
B00D - R0025 - Practical Activities - (16.81 SQM)	● Student Space (7)	
B00D - R0026 - Home Base - M - (38.65 SQM) - Teaching Space: 1	● Student Space (17)	
B00D - R0027 - Movement - (7.8 SQM)	Not Applicable	Circulation or storage space.
B00D - R0029 - Withdrawal Space - 2hb - (11.5 SQM)	● Student Space (5)	
B00D - R0030 - Practical Activities - 1hb - (17.05 SQM)	● Student Space (7)	
B00D - R0031 - Home Base - M - (39.06 SQM) - Teaching Space: 1	● Student Space (18)	
B00D - R0032 - Deputy Principal - Type 1 - (12.38 SQM)	● Office (3)	
B00D - R0033 - Staff Room - (14.75 SQM)	● Office (3)	
B00D - R0034 - Movement - (21.81 SQM)	Not Applicable	Circulation or storage space.
B00D - R0037 - Practical Activities - M - 1hb - (52.48 SQM)	● Student Space (24)	
B00D - R0038 - Practical Activities - M - 1hb - (17.05 SQM)	● Student Space (7)	
B00D - R0039 - Home Base/Practical Activities - M - (39.06 SQM) - Teaching Space: 1	● Student Space (18)	
B00D - R0040 - Movement - (7.8 SQM)	Not Applicable	Circulation or storage space.
B00D - R0042 - Withdrawal Space - 2hb - (11.66 SQM)	● Student Space (5)	
B00D - R0043 - Practical Activities - M - 1hb - (16.81 SQM)	● Student Space (7)	
B00D - R0044 - Home Base - M - (38.65 SQM) - Teaching Space: 1	● Student Space (17)	
B00D - R0046 - Staff Kitchen - (6.02 SQM)	● Office (1)	
B00E - R0001 - Movement - (0.39 SQM)	Not Applicable	Circulation or storage space.
B00E - R0002 - Movement - (1.07 SQM)	Not Applicable	Circulation or storage space.
B00E - R0010 - Movement - (0.86 SQM)	Not Applicable	Circulation or storage space.
B00E - R0011 - Movement - (0.37 SQM)	Not Applicable	Circulation or storage space.
B00E - R0012 - Movement - (0.37 SQM)	Not Applicable	Circulation or storage space.
B00E - R0013 - Movement - (0.87 SQM)	Not Applicable	Circulation or storage space.
B00E - R0015 - Movement - (2.47 SQM)	Not Applicable	Circulation or storage space.
B00E - R0016 - Home Base - (58.88 SQM) - Teaching Space: 1	● Student Space (27)	
B00E - R0017 - Home Base - (80.83 SQM) - Teaching Space: 1	● Student Space (37)	
B00E - R0019 - Movement - (1.63 SQM)	Not Applicable	Circulation or storage space.
B00E - R0021 - Movement - (1.07 SQM)	Not Applicable	Circulation or storage space.
B00E - R0022 - Movement - (0.38 SQM)	Not Applicable	Circulation or storage space.
B00E - R0023 - Movement - (119.67 SQM)	Not Applicable	Circulation or storage space.
B00E - R0025 - Practical Activities - 1hb - (10.3 SQM)	● Student Space (4)	
B00E - R0026 - Home Base - (69.04 SQM) - Teaching Space: 1	● Student Space (32)	
B00E - R0027 - Home Base - (72.99 SQM) - Teaching Space: 1	● Student Space (33)	
B00E - R0028 - Practical Activities - 1hb - (7.28 SQM)	● Student Space (3)	
B00F - R0001 - Movement - (1.44 SQM)	Not Applicable	Circulation or storage space.
B00F - R0006 - Movement - (1.44 SQM)	Not Applicable	Circulation or storage space.
B00F - R0007 - Seminar/Study - (12.4 SQM)	● Office (3)	
B00F - R0009 - Entry Vestibule - (25.39 SQM)	Not Applicable	Circulation or storage space.
B00F - R0012 - Reading Area - (236.82 SQM)	● Student Space (109)	
B00F - R0013 - Movement - (156.52 SQM)	Not Applicable	Circulation or storage space.
B00G - R0004 - Movement - (23.79 SQM)	Not Applicable	Circulation or storage space.
B00G - R0005 - Canteen - (24.11 SQM)	Not Applicable	Circulation or storage space.
B00G - R0011 - Home Base - (113.93 SQM) - Teaching Space: 1	● Student Space (52)	
B00G - R0013 - Practical Activities - 1hb - (18.44 SQM)	● Student Space (8)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00H - R0007 - Movement - (1.75 SQM)	Not Applicable	Circulation or storage space.
B00H - R0008 - Movement - (1.59 SQM)	Not Applicable	Circulation or storage space.
B00H - R0010 - Sick Bay - (6.7 SQM)	● Student Space (3)	
B00H - R0012 - Sick Bay - (10.18 SQM)	● Student Space (4)	
B00H - R0018 - Movement - (3.35 SQM)	Not Applicable	Circulation or storage space.
B00H - R0019 - Movement - (1.91 SQM)	Not Applicable	Circulation or storage space.
B00H - R0021 - Home Base - (56.87 SQM) - Teaching Space: 1	● Student Space (26)	
B00H - R0022 - Movement - (104.57 SQM)	Not Applicable	Circulation or storage space.
B00H - R0027 - Deputy Principal - (12.4 SQM)	● Office (3)	
B00H - R0029 - Principal - (23.62 SQM)	● Office (5)	
B00H - R0033 - Entry Vestibule - (28.49 SQM)	Not Applicable	Circulation or storage space.
B00H - R0034 - Clerical Office - (30.73 SQM)	● Office (7)	
B00H - R0035 - Movement - (4.21 SQM)	Not Applicable	Circulation or storage space.
B00H - R0036 - Movement - (21.47 SQM)	Not Applicable	Circulation or storage space.
B00H - R1002 - Interview - (13.84 SQM)	● Office (3)	
B00H - R1003 - Duplicating Workroom - (40.21 SQM)	● Office (10)	
B00H - R1004 - Movement - (20.82 SQM)	Not Applicable	Circulation or storage space.
B00H - R1007 - Movement - (1.58 SQM)	Not Applicable	Circulation or storage space.
B00H - R1010 - Staff Room - (58.48 SQM)	● Office (14)	
B00H - R1014 - Movement - (1.91 SQM)	Not Applicable	Circulation or storage space.
B00H - R1017 - Movement - (85.55 SQM)	Not Applicable	Circulation or storage space.
B00I - R0001 - Home Base - (56.75 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R0007 - Home Base - (57.14 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R0008 - Home Base - (57.06 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R0014 - Home Base - (56.75 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R0016 - Withdrawal Space - 2hb - (5.78 SQM)	● Student Space (2)	
B00I - R0017 - Practical Activities/Movement - 2hb - (13.98 SQM)	● Student Space (6)	
B00I - R0018 - Withdrawal Space - 2hb - (5.8 SQM)	● Student Space (2)	
B00I - R0019 - Practical Activities/Movement - 2hb - (13.92 SQM)	● Student Space (6)	
B00I - R1001 - Home Base - (56.64 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R1007 - Home Base - (56.69 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R1008 - Home Base - (56.41 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R1014 - Home Base - (56.69 SQM) - Teaching Space: 1	● Student Space (26)	
B00I - R1015 - Movement - (103.45 SQM)	Not Applicable	Circulation or storage space.
B00I - R1016 - Withdrawal Space - 2hb - (5.78 SQM)	● Student Space (2)	
B00I - R1017 - Practical Activities/Movement - 2hb - (14.09 SQM)	● Student Space (6)	
B00I - R1018 - Withdrawal Space - 2hb - (5.38 SQM)	● Student Space (2)	
B00I - R1019 - Practical Activities/Movement - 2hb - (13.99 SQM)	● Student Space (6)	
B00J - R0001 - Movement - (1.48 SQM)	Not Applicable	Circulation or storage space.
B00J - R0002 - Entry Vestibule - (15.97 SQM)	Not Applicable	Circulation or storage space.
B00J - R0006 - Staff Room - (11.67 SQM)	● Office (2)	
B00J - R0007 - Movement - (5.31 SQM)	Not Applicable	Circulation or storage space.
B00J - R0011 - Darkroom Space - (2.45 SQM)	● Office (0)	
B00J - R0014 - Clerical Office - (9.86 SQM)	● Office (2)	
B00J - R0015 - Movement - (8.69 SQM)	Not Applicable	Circulation or storage space.
B00K - R0003 - Movement - (8.38 SQM)	Not Applicable	Circulation or storage space.
B00K - R0005 - Staff Kitchen - (5.45 SQM)	● Office (1)	
B00K - R0012 - Raised Platform - (45.59 SQM)	Not Applicable	Circulation or storage space.
B00K - R0014 - Communal Space - (141.41 SQM)	● Student Space (65)	