


VENTILATION AUDIT REPORT

SCHOOL:	Daceyville Public School (7413)
AMU REGION:	Sydney
STATE ELECTORATE:	Maroubra
LOCAL GOVERNMENT AREA:	Bayside

7413 - Daceyville Public School
Site Plan (10617)



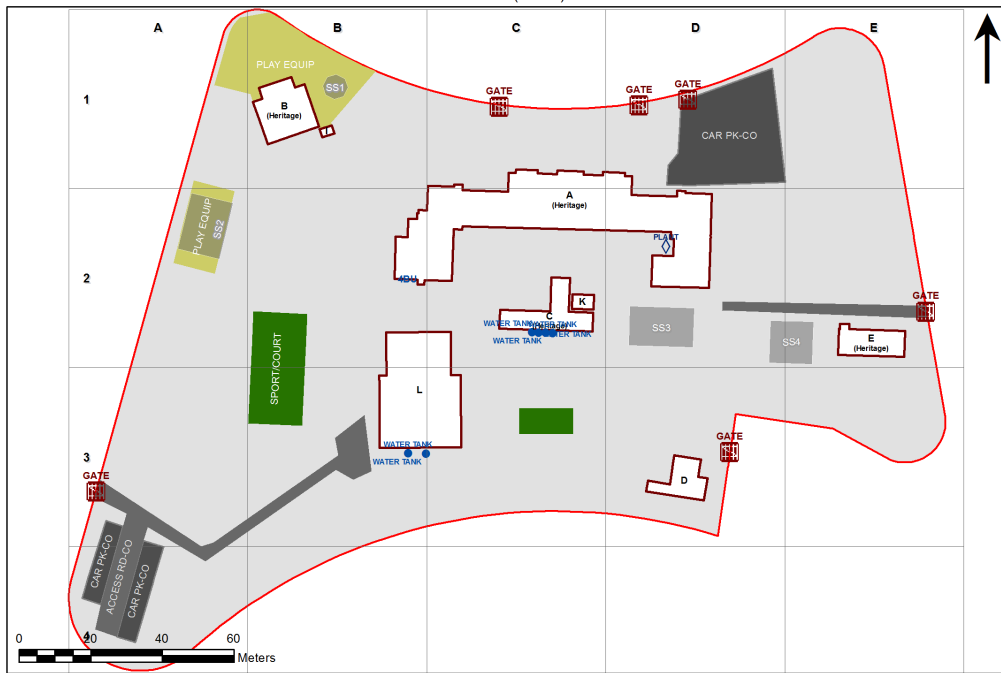











1:991

Printed: 07-Apr-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0002 - Duplicating Workroom - (45.43 SQM)	Office (11)	
B00A - R0007 - Home Base - (42.92 SQM) - Teaching Space: 1	Student Space (19)	
B00A - R0008 - Home Base - (46.14 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0013 - Movement - (9.52 SQM)	Not Applicable	Circulation or storage space.
B00A - R0014 - Movement - (54.41 SQM)	Not Applicable	Circulation or storage space.
B00A - R0015 - Entry Vestibule - (35.45 SQM)	Not Applicable	Circulation or storage space.
B00A - R0016 - Home Base - (45.31 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0019 - Movement - (7.4 SQM)	Not Applicable	Circulation or storage space.
B00A - R0021 - Staff Room - (45.8 SQM)	Office (11)	
B00A - R0022 - Home Base - (45.55 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0023 - Home Base - (45.49 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0024 - Home Base - (45.49 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0025 - Home Base - (45.42 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0027 - Home Base - (46.85 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0028 - Home Base - (46.86 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R0030 - Canteen - (22.29 SQM)	Not Applicable	Circulation or storage space.
B00A - R0034 - Movement - (9.1 SQM)	Not Applicable	Circulation or storage space.
B00A - R0035 - Movement - (125.6 SQM)	Not Applicable	Circulation or storage space.
B00A - R0039 - Practical Activities - 1hb - (5.32 SQM)	Student Space (2)	
B00A - R0040 - Movement - (9.25 SQM)	Not Applicable	Circulation or storage space.
B00A - R0044 - Practical Activities - 1hb - (13.3 SQM)	Student Space (6)	
B00A - R0045 - Deputy Principal - (14.57 SQM)	Office (3)	
B00A - R0046 - Staff Kitchen - (14.52 SQM)	Office (3)	
B00A - R0049 - Staff Room Annexe - (13.21 SQM)	Office (3)	
B00A - R0052 - Movement - (9.49 SQM)	Not Applicable	Circulation or storage space.
B00A - R0053 - Movement - (85.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R0056 - Interview/Office - Type 3 - (18.34 SQM)	Office (4)	
B00A - R0057 - Deputy Principal - Type 1 - (12.3 SQM)	Office (3)	
B00A - R0058 - Deputy Principal - Type 1 - (13.83 SQM)	Office (3)	
B00A - R0059 - Clerical Office/Workroom - (37.78 SQM)	Office (9)	
B00A - R0063 - Principal - (23.88 SQM)	Office (5)	
B00A - R1003 - Reading Area - (100.45 SQM)	Student Space (46)	
B00A - R1007 - Movement - (45.73 SQM)	Not Applicable	Circulation or storage space.
B00A - R1008 - Home Base - (48.14 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1009 - Home Base - (47.6 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1010 - Home Base - (48.86 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1011 - Home Base - (48.4 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1012 - Home Base - (48.25 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1013 - Home Base - (48.09 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1014 - Home Base - (48.35 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1015 - Home Base - (48.15 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1016 - Home Base - (48.47 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1017 - Home Base - (48.67 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1019 - Withdrawal Space - 1hb - (17.07 SQM)	Student Space (7)	
B00A - R1022 - Home Base - (49.53 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1023 - Movement - (133.71 SQM)	Not Applicable	Circulation or storage space.
B00A - R1027 - Communal Space - (125.72 SQM)	Student Space (58)	
B00A - R1028 - Raised Platform - (18.37 SQM)	Not Applicable	Circulation or storage space.
B00A - R1029 - Movement - (7.33 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R1030 - Staff Room Annexe - (8.88 SQM)	 Office (2)	
B00A - R1031 - Movement - (54.27 SQM)	Not Applicable	Circulation or storage space.
B00D - R0001 - Dental Clinic - (12.08 SQM)	 Office (3)	
B00D - R0003 - Dental Clinic - (5.29 SQM)	 Office (1)	
B00D - R0006 - Dental Clinic - (7.53 SQM)	 Office (1)	
B00D - R0007 - Dental Clinic - (7.43 SQM)	 Office (1)	
B00D - R0008 - Dental Clinic - (7.49 SQM)	 Office (1)	
B00D - R0010 - Dental Clinic - (6.75 SQM)	 Office (1)	
B00D - R0011 - Dental Clinic - (5.26 SQM)	 Office (1)	
B00D - R0014 - Dental Clinic - (8.45 SQM)	 Office (2)	
B00E - R0001 - Practical Activities - 1hb - (101.06 SQM)	 Student Space (46)	
B00E - R0004 - Movement - (5.38 SQM)	Not Applicable	Circulation or storage space.
B00L - R0001 - Communal Space - (138.39 SQM)	 Student Space (64)	
B00L - R0002 - Raised Platform - (67.74 SQM)	Not Applicable	Circulation or storage space.
B00L - R0003 - Movement - (7.87 SQM)	Not Applicable	Circulation or storage space.
B00L - R0004 - Movement - (13.03 SQM)	Not Applicable	Circulation or storage space.
B00L - R0017 - Movement - (5.97 SQM)	Not Applicable	Circulation or storage space.
B00L - R0023 - Special Programs Room - (33.51 SQM)	 Student Space (15)	