


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Dundas Public School (4029)</b>
<b>AMU REGION:</b>	<b>Western Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Parramatta</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Parramatta</b>

4029 - Dundas Public School  
Site Plan (11996)

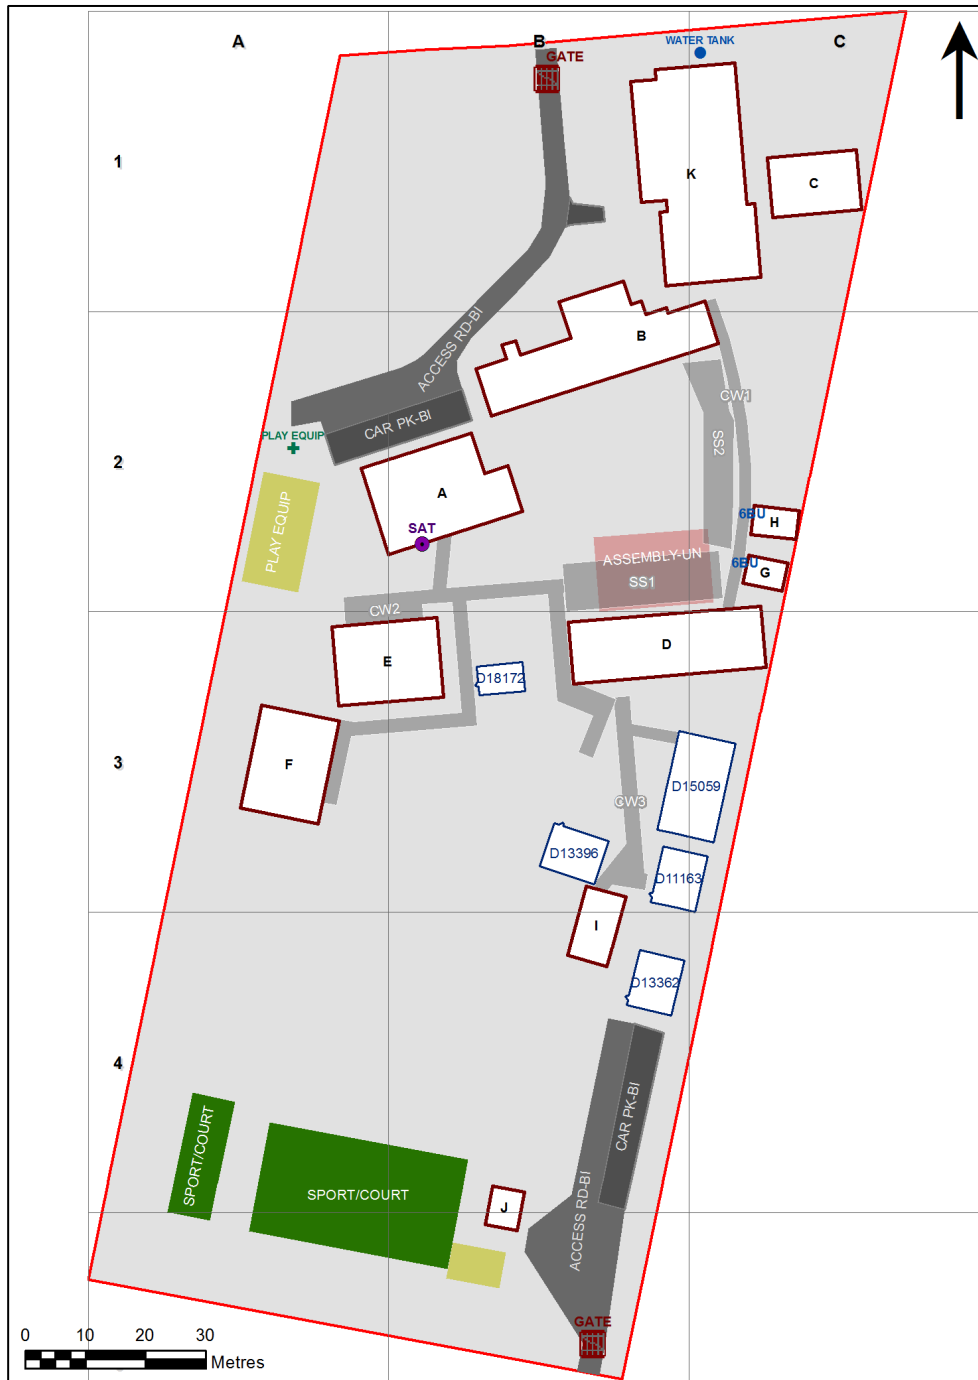

1:834

Printed: 12-Jun-2021

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Movement - (18.44 SQM)	Not Applicable	Circulation or storage space.
B00A - R0003 - Staff Room - (45.61 SQM)	Office (11)	
B00A - R0004 - Practical Activities - 1hb - (18 SQM)	Student Space (8)	
B00A - R0005 - Home Base - (57.71 SQM) - Teaching Space: 1	Student Space (26)	
B00A - R0006 - Movement - (34.49 SQM)	Not Applicable	Circulation or storage space.
B00A - R0011 - Deputy Principal - (14.87 SQM)	Office (3)	
B00A - R0014 - Sick Bay - (6.5 SQM)	Student Space (3)	
B00A - R0015 - Clerical Office/Workroom - (12.84 SQM)	Office (3)	
B00A - R0016 - Principal - (18.7 SQM)	Office (4)	
B00A - R1002 - Movement - (14.3 SQM)	Not Applicable	Circulation or storage space.
B00A - R1003 - Movement - (24.09 SQM)	Not Applicable	Circulation or storage space.
B00A - R1007 - Reading Area - (130.41 SQM)	Student Space (60)	
B00B - R0001 - Movement - (18.47 SQM)	Not Applicable	Circulation or storage space.
B00B - R0009 - Home Base - (78.76 SQM) - Teaching Space: 1	Student Space (36)	
B00B - R0011 - Home Base - (56.9 SQM) - Teaching Space: 1	Student Space (26)	
B00B - R0016 - Movement - (15.21 SQM)	Not Applicable	Circulation or storage space.
B00B - R0018 - Special Programs Room - (21.71 SQM)	Student Space (10)	
B00B - R0021 - Movement - (72.22 SQM)	Not Applicable	Circulation or storage space.
B00B - R0023 - Canteen - (25.17 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Movement - (23.23 SQM)	Not Applicable	Circulation or storage space.
B00C - R0003 - Communal Space - (53.29 SQM)	Student Space (24)	
B00C - R0004 - Communal Space - (53.36 SQM)	Student Space (24)	
B00D - R0005 - Home Base - (53.58 SQM) - Teaching Space: 1	Student Space (24)	
B00D - R0006 - Home Base - (53.58 SQM) - Teaching Space: 1	Student Space (24)	
B00D - R0007 - Home Base - (53.58 SQM) - Teaching Space: 1	Student Space (24)	
B00D - R0012 - Movement - (59.58 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Movement - (38.48 SQM)	Not Applicable	Circulation or storage space.
B00E - R0002 - Practical Activities - 1hb - (19.39 SQM)	Student Space (8)	
B00E - R0004 - Home Base - (59.19 SQM) - Teaching Space: 1	Student Space (27)	
B00E - R0005 - Withdrawal Space - 2hb - (11.36 SQM)	Student Space (5)	
B00E - R0006 - Home Base - (59.2 SQM) - Teaching Space: 1	Student Space (27)	
B00E - R0008 - Practical Activities - 1hb - (19.41 SQM)	Student Space (9)	
B00F - R0001 - Movement - (38.47 SQM)	Not Applicable	Circulation or storage space.
B00F - R0002 - Practical Activities - 1hb - (19.4 SQM)	Student Space (9)	
B00F - R0004 - Home Base - (59.2 SQM) - Teaching Space: 1	Student Space (27)	
B00F - R0005 - Withdrawal Space - 2hb - (11.35 SQM)	Student Space (5)	
B00F - R0006 - Home Base - (59.19 SQM) - Teaching Space: 1	Student Space (27)	
B00F - R0008 - Practical Activities - 1hb - (19.4 SQM)	Student Space (9)	
B00I - R0002 - Special Programs Room - (62.68 SQM)	Student Space (29)	
B00K - R0001 - Communal Space - (200.78 SQM)	Student Space (93)	
B00K - R0002 - Raised Platform - (59.83 SQM)	Not Applicable	Circulation or storage space.
B00K - R0016 - Movement - (6.28 SQM)	Not Applicable	Circulation or storage space.
B00K - R0017 - Movement - (15.41 SQM)	Not Applicable	Circulation or storage space.
NS 101 15059 - NS 101 15059 - Learning Unit - Double Primary/PAA - (133 SQM)	Student Space (61)	
OS 602 11163 - OS 602 11163 - Learning Unit - Standard With P.A.A. - (76 SQM)	Student Space (35)	
OS 602 13362 - OS 602 13362 - Learning Unit - Standard With P.A.A. - (76 SQM)	Student Space (35)	
OS 602 13396 - OS 602 13396 - Learning Unit - Standard With P.A.A. - (76 SQM)	Student Space (35)	
OS 750 18172 - OS 750 18172 - Learning Unit - ESL - (38 SQM)	Student Space (17)	