


VENTILATION AUDIT REPORT

SCHOOL:	Erskine Park High School (8590)
AMU REGION:	Western Sydney
STATE ELECTORATE:	Mulgoa
LOCAL GOVERNMENT AREA:	Penrith

8590 - Erskine Park High School
Site Plan (10440)

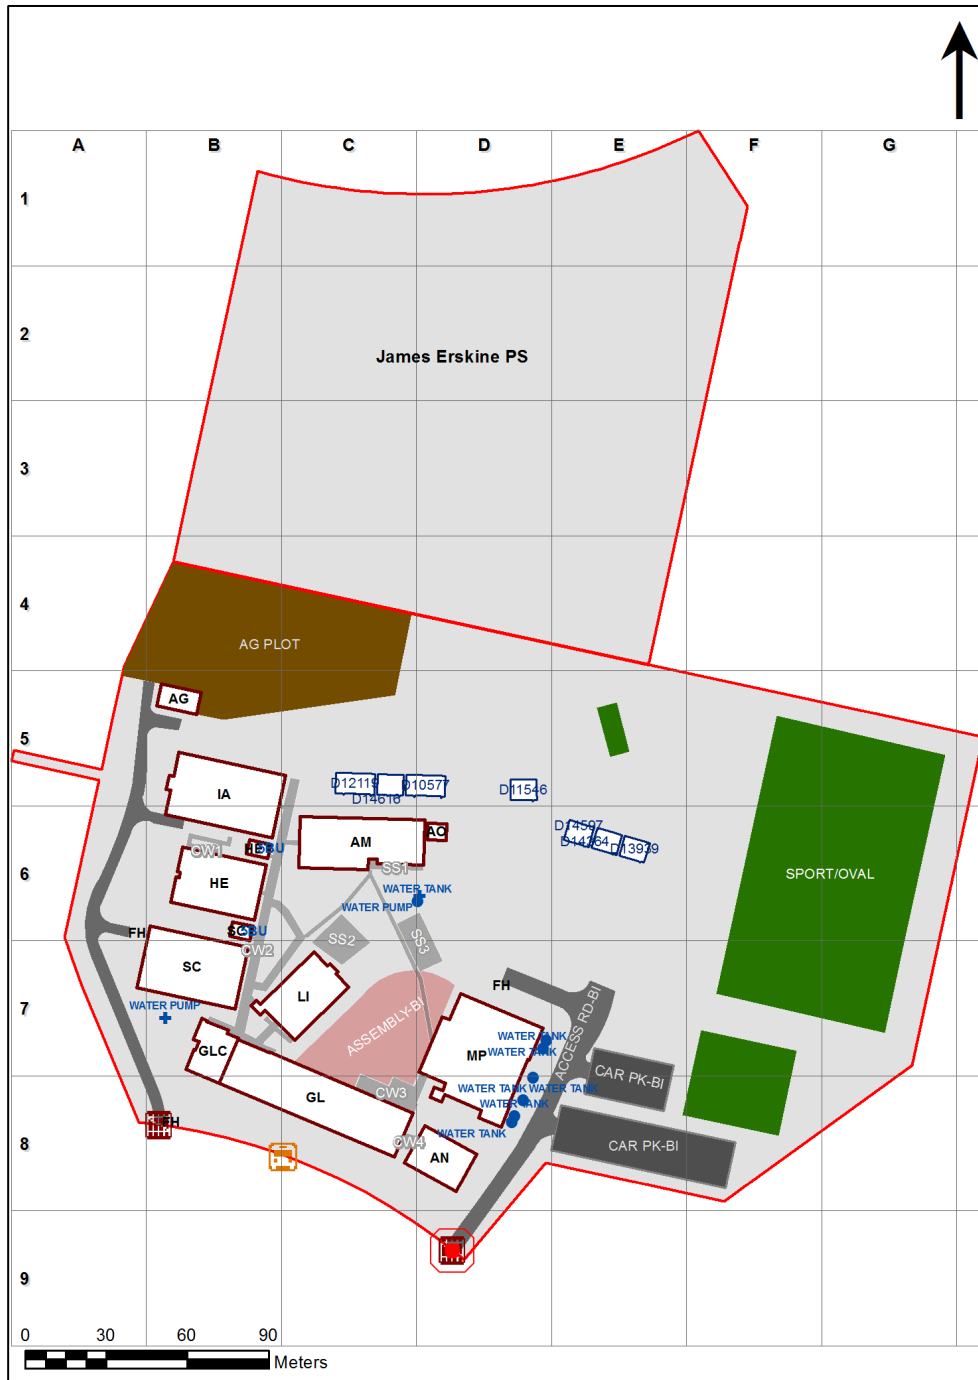

1:1,857

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
BOAM - R0001 - Music Learning Space - (56.84 SQM) - Teaching Space: 1	● Student Space (26)	
BOAM - R0002 - Practice/Seminar - (23.22 SQM)	Not Applicable	Circulation or storage space.
BOAM - R0003 - Movement - (94.3 SQM)	Not Applicable	Circulation or storage space.
BOAM - R0006 - Staff Study - (29.17 SQM)	● Office (7)	
BOAM - R0008 - Art Learning Space - (63.35 SQM) - Teaching Space: 1	● Student Space (29)	
BOAM - R0016 - Music Learning Space - (77.07 SQM) - Teaching Space: 1	● Student Space (35)	
BOAM - R0018 - Movement - (16.85 SQM)	Not Applicable	Circulation or storage space.
BOAM - R0019 - Art Learning Space - (61.38 SQM) - Teaching Space: 1	● Student Space (28)	
BOAM - R0021 - Art Learning Space - (61.02 SQM) - Teaching Space: 1	● Student Space (28)	
BOAM - R0022 - Darkroom Space - (28.25 SQM)	● Office (7)	
BOAN - R0001 - Principal Office - (19.5 SQM)	● Office (4)	
BOAN - R0002 - Interview/Office - Type 1 - (11.63 SQM)	● Office (2)	
BOAN - R0005 - Interview/Office - Type 1 - (11.76 SQM)	● Office (2)	
BOAN - R0006 - Deputy Principal Office - (17.19 SQM)	● Office (4)	
BOAN - R0007 - Movement - (12.6 SQM)	Not Applicable	Circulation or storage space.
BOAN - R0009 - Duplicating Workroom - (23.06 SQM)	● Office (5)	
BOAN - R0010 - Interview/Office - Type 1 - (11.68 SQM)	● Office (2)	
BOAN - R0011 - Clinic - Boys - (13.88 SQM)	● Office (3)	
BOAN - R0014 - Ancillary Staff - (13.17 SQM)	● Office (3)	
BOAN - R0015 - Interview/Office - Type 1 - (23.89 SQM)	● Office (5)	
BOAN - R0017 - Movement - (8.57 SQM)	Not Applicable	Circulation or storage space.
BOAN - R0018 - Movement - (57.6 SQM)	Not Applicable	Circulation or storage space.
BOAN - R0020 - Administration - Clerical - (39.31 SQM)	● Office (9)	
BOAO - R0001 - General Assistants - (40.47 SQM)	● Office (10)	
BOGL - R0001 - General Learning Space - (52.29 SQM) - Teaching Space: 1	● Student Space (24)	
BOGL - R0003 - General Learning Space - (51.24 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0004 - General Learning Space - (49.7 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0005 - General Learning Space - (49.7 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0006 - General Learning Space - (49.63 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0007 - General Learning Space - (49.7 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0008 - General Learning Space - (49.7 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0009 - General Learning Space - (49.63 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R0010 - Special Learning Space - (52.39 SQM) - Teaching Space: 1	● Student Space (24)	
BOGL - R0011 - Special Learning Space - (54.02 SQM) - Teaching Space: 1	● Student Space (25)	
BOGL - R0012 - Serviced Learning Space - (52.66 SQM) - Teaching Space: 1	● Student Space (24)	
BOGL - R0013 - Study Space - (15.18 SQM)	Not Applicable	Circulation or storage space.
BOGL - R0016 - Staff Study - (23.42 SQM)	● Office (5)	
BOGL - R0017 - Interview/Office - Type 1 - (14.89 SQM)	● Office (3)	
BOGL - R0020 - Study Space - (16.66 SQM)	Not Applicable	Circulation or storage space.
BOGL - R0021 - Staff Study - (38.59 SQM)	● Office (9)	
BOGL - R0024 - Study Space - (15.31 SQM)	Not Applicable	Circulation or storage space.
BOGL - R0025 - Movement - (190.1 SQM)	Not Applicable	Circulation or storage space.
BOGL - R0026 - Movement - (109.06 SQM)	Not Applicable	Circulation or storage space.
BOGL - R0029 - Movement - (81.29 SQM)	Not Applicable	Circulation or storage space.
BOGL - R1001 - General Learning Space - (52.73 SQM) - Teaching Space: 1	● Student Space (24)	
BOGL - R1002 - General Learning Space - (51.17 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1003 - General Learning Space - (49.7 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1004 - General Learning Space - (49.84 SQM) - Teaching Space: 1	● Student Space (23)	

Entity Location	Audit Condition Classification (Capacity)	Comment
BOGL - R1005 - General Learning Space - (49.84 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1006 - General Learning Space - (49.84 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1007 - General Learning Space - (49.84 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1008 - General Learning Space - (49.84 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1009 - General Learning Space - (49.84 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1010 - Computer Learning Space - (51.24 SQM) - Teaching Space: 1	● Student Space (23)	
BOGL - R1011 - General Learning Space - (52.58 SQM) - Teaching Space: 1	● Student Space (24)	
BOGL - R1012 - Study Space - (15.6 SQM)	Not Applicable	Circulation or storage space.
BOGL - R1014 - Interview/Office - Type 1 - (13.52 SQM)	● Office (3)	
BOGL - R1015 - Staff Study - (25.3 SQM)	● Office (6)	
BOGL - R1021 - Computer Learning Space - (59.32 SQM) - Teaching Space: 1	● Student Space (27)	
BOGL - R1022 - Staff Study - (39.98 SQM)	● Office (9)	
BOGL - R1023 - Interview/Office - Type 1 - (13.7 SQM)	● Office (3)	
BOGL - R1025 - Study Space - (15.49 SQM)	Not Applicable	Circulation or storage space.
BOGL - R1026 - Movement - (178 SQM)	Not Applicable	Circulation or storage space.
BOGL - R1029 - Movement - (14.93 SQM)	Not Applicable	Circulation or storage space.
BOHE - R0003 - Movement - (16.51 SQM)	Not Applicable	Circulation or storage space.
BOHE - R0005 - Staff Study - (22 SQM)	● Office (5)	
BOHE - R0006 - Food Technology L.S. - (103.77 SQM) - Teaching Space: 1	● Student Space (48)	
BOHE - R0008 - Staff Study - (13.12 SQM)	● Office (3)	
BOHE - R0009 - Food Technology L.S. - (104.22 SQM) - Teaching Space: 1	● Student Space (48)	
BOHE - R0011 - Design L.S. - (75.26 SQM) - Teaching Space: 1	● Student Space (34)	
BOHE - R0012 - Movement - (45.61 SQM)	Not Applicable	Circulation or storage space.
BOHE - R0013 - Design L.S. - (75.33 SQM) - Teaching Space: 1	● Student Space (34)	
BOHE - R0014 - Movement - (87.09 SQM)	Not Applicable	Circulation or storage space.
BOIA - R0001 - Staff Study - (28.02 SQM)	● Office (7)	
BOIA - R0002 - Seminar/Technology Space - (27.67 SQM)	● Office (6)	
BOIA - R0003 - Design L.S. - (56.44 SQM) - Teaching Space: 1	● Student Space (26)	
BOIA - R0004 - Design L.S. - (56.26 SQM) - Teaching Space: 1	● Student Space (26)	
BOIA - R0011 - Materials Technology L.S. - (93.67 SQM) - Teaching Space: 1	● Student Space (43)	
BOIA - R0012 - Welding Area - (11.35 SQM)	Not Applicable	Circulation or storage space.
BOIA - R0013 - Metal Technology Bay - (34.96 SQM)	Not Applicable	Circulation or storage space.
BOIA - R0014 - Materials Technology L.S. - (91.61 SQM) - Teaching Space: 1	● Student Space (42)	
BOIA - R0015 - Materials Technology L.S. - (92.41 SQM) - Teaching Space: 1	● Student Space (42)	
BOIA - R0017 - Wood Technology Bay - (36.14 SQM)	Not Applicable	Circulation or storage space.
BOIA - R0018 - Materials Technology L.S. - (92.41 SQM) - Teaching Space: 1	● Student Space (42)	
BOIA - R0019 - Movement - (74.49 SQM)	Not Applicable	Circulation or storage space.
BOIA - R0020 - Movement - (14.47 SQM)	Not Applicable	Circulation or storage space.
BOIA - R0021 - Movement - (64.63 SQM)	Not Applicable	Circulation or storage space.
BOLI - R0001 - Main Area - (349.78 SQM)	Not Applicable	Circulation or storage space.
BOLI - R0006 - Entry - (10.24 SQM)	Not Applicable	Circulation or storage space.
BOLI - R0008 - Audio Visual Workroom - (26.78 SQM)	● Student Space (12)	
BOLI - R0009 - Workroom - (37.87 SQM)	● Office (9)	
BOLI - R0010 - Seminar - (41.08 SQM)	● Office (10)	
BOMP - R0004 - Movement - (10.9 SQM)	Not Applicable	Circulation or storage space.
BOMP - R0007 - Staff Study - (16.31 SQM)	● Office (4)	
BOMP - R0011 - Movement - (21.07 SQM)	Not Applicable	Circulation or storage space.
BOMP - R0016 - Student Canteen - (55.38 SQM)	Not Applicable	Circulation or storage space.
BOMP - R0017 - Multi-Purpose Space - (459.19 SQM)	● Student Space (213)	
BOMP - R0021 - Movement - (15.91 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
BOMP - R0023 - Movement - (17.6 SQM)	Not Applicable	Circulation or storage space.
BOMP - R0026 - General Assistants - (13.12 SQM)	Office (3)	
BOMP - R0028 - Movement - (167.46 SQM)	Not Applicable	Circulation or storage space.
BOMP - R0029 - Stage - (94.22 SQM)	Not Applicable	Circulation or storage space.
BOSC - R0001 - Movement - (75.97 SQM)	Not Applicable	Circulation or storage space.
BOSC - R0002 - Staff Study - (40.37 SQM)	Office (10)	
BOSC - R0003 - Laboratory L.S. - (92.03 SQM) - Teaching Space: 1	Student Space (42)	
BOSC - R0006 - Preparation - (65.68 SQM)	Not Applicable	Circulation or storage space.
BOSC - R0007 - Laboratory L.S. - (92.21 SQM) - Teaching Space: 1	Student Space (42)	
BOSC - R0008 - Movement - (8.6 SQM)	Not Applicable	Circulation or storage space.
BOSC - R0010 - Laboratory L.S. - (91.69 SQM) - Teaching Space: 1	Student Space (42)	
BOSC - R0011 - Laboratory L.S. - (92.21 SQM) - Teaching Space: 1	Student Space (42)	
BOSC - R0012 - Movement - (13.89 SQM)	Not Applicable	Circulation or storage space.
BOSC - R0013 - Laboratory L.S. - (92.03 SQM) - Teaching Space: 1	Student Space (42)	
BOSC - R0017 - Movement - (56.32 SQM)	Not Applicable	Circulation or storage space.
BGLC - R0004 - Movement - (16.58 SQM)	Not Applicable	Circulation or storage space.
BGLC - R0006 - Seminar - (12.41 SQM)	Office (3)	
BGLC - R0007 - Seminar - (13.54 SQM)	Office (3)	
BGLC - R0008 - Movement - (18.21 SQM)	Not Applicable	Circulation or storage space.
BGLC - R0010 - Interview/Office - Type 1 - (14.02 SQM)	Office (3)	
BGLC - R0011 - Interview/Office - Type 1 - (13.44 SQM)	Office (3)	
BGLC - R0012 - Senior Study - (61.73 SQM)	Office (15)	
BGLC - R1001 - Commonroom - (92.67 SQM)	Office (23)	
BGLC - R1002 - Movement - (29.3 SQM)	Not Applicable	Circulation or storage space.
BGLC - R1007 - Tiered Learning Area - (68.05 SQM)	Student Space (31)	
OS 600 14597 - OS 600 14597 - Learning Unit - Small - (57 SQM)	Student Space (26)	
OS 601 11546 - OS 601 11546 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 13939 - OS 601 13939 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 14364 - OS 601 14364 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 14616 - OS 601 14616 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 700 10577 - OS 700 10577 - Art Learning Space/Workshop/Store - (114 SQM)	Not Applicable	Circulation or storage space.
OS 700 12119 - OS 700 12119 - Art Learning Space/Workshop/Store - (114 SQM)	Not Applicable	Circulation or storage space.