


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Georges River College Oatley Senior Campus (8284)</b>
<b>AMU REGION:</b>	<b>Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Oatley</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Georges River</b>

8284 - Georges River College Oatley Senior Campus  
Site Plan (14649)

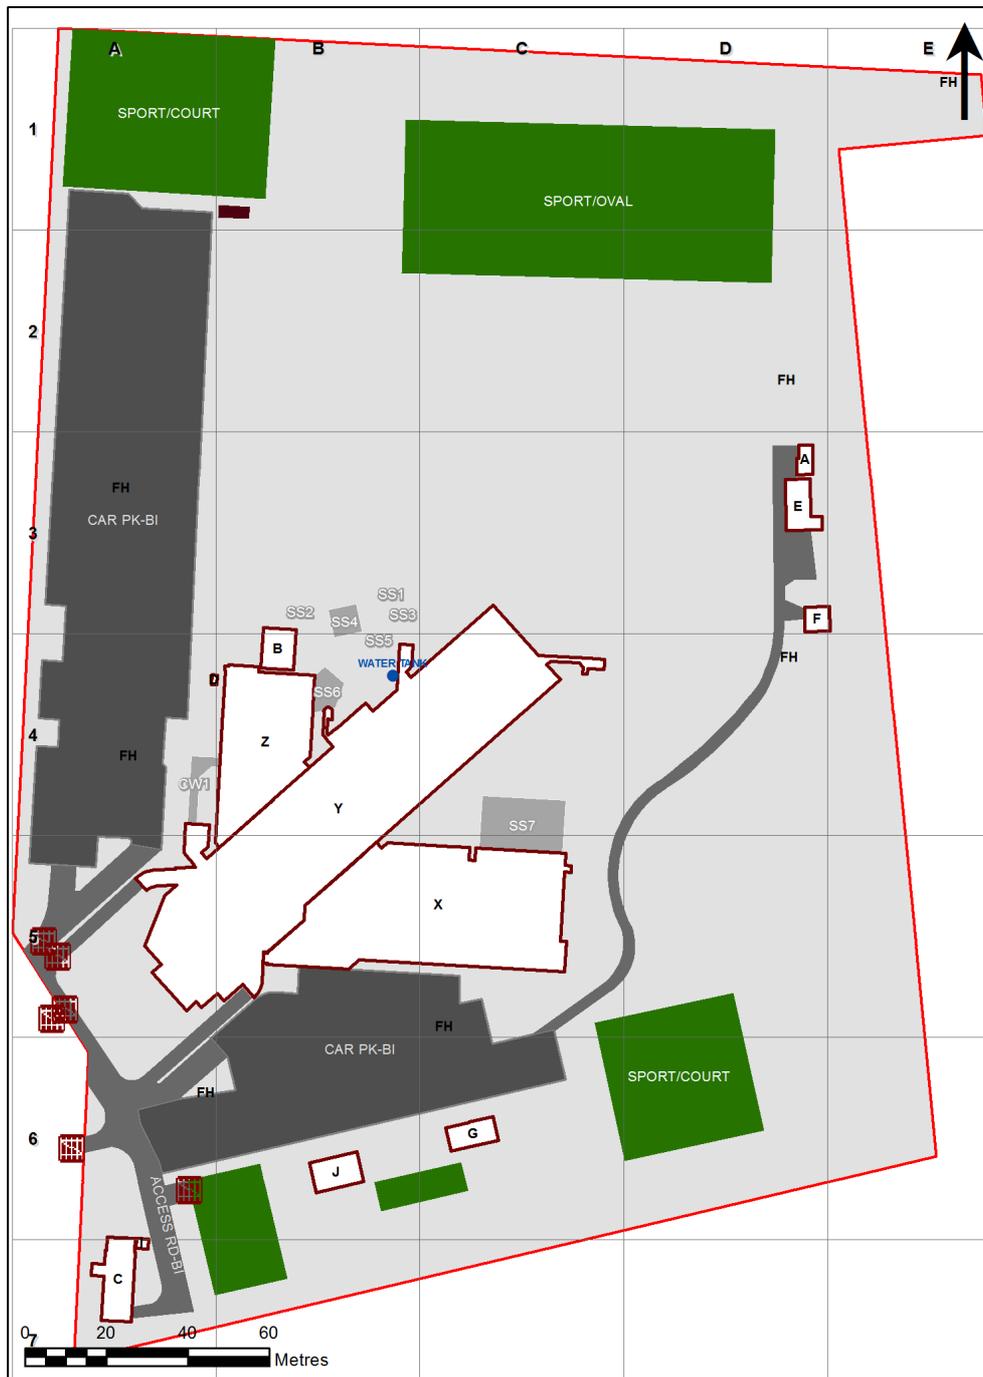

1:1,238

Printed: 06-Mar-2021

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00C - R0009 - Movement - (10.66 SQM)	Not Applicable	Circulation or storage space.
B00C - R0011 - Staff Kitchen - (6.78 SQM)	Office (1)	
B00J - R0001 - Workshop Area - (87.47 SQM)	Student Space (40)	
B00X - R0001 - Movement - (112.65 SQM)	Not Applicable	Circulation or storage space.
B00X - R0005 - General Learning Space - (57 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R0006 - General Learning Space - (50.09 SQM) - Teaching Space: 1	Student Space (23)	
B00X - R0007 - Materials Workshop - Type 3 - (116.7 SQM)	Student Space (54)	
B00X - R0010 - Movement - (9.42 SQM)	Not Applicable	Circulation or storage space.
B00X - R0011 - Wood Technology Bay - (11.35 SQM)	Not Applicable	Circulation or storage space.
B00X - R0018 - Fitness Laboratory - (102.71 SQM)	Student Space (47)	
B00X - R0019 - Wood Technology Bay - (9.1 SQM)	Not Applicable	Circulation or storage space.
B00X - R0022 - Movement - (70.01 SQM)	Not Applicable	Circulation or storage space.
B00X - R0027 - General Learning Space - (56.44 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R0034 - Movement - (5.21 SQM)	Not Applicable	Circulation or storage space.
B00X - R0036 - General Learning Space - (55.88 SQM) - Teaching Space: 1	Student Space (25)	
B00X - R0037 - General Learning Space - (56.19 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R1001 - Movement - (105.9 SQM)	Not Applicable	Circulation or storage space.
B00X - R1002 - General Learning Space - (56.59 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R1003 - Senior Study - (21.65 SQM)	Office (5)	
B00X - R1006 - General Learning Space - (56.48 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R1007 - General Learning Space - (56.53 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R1008 - General Learning Space - (49.64 SQM) - Teaching Space: 1	Student Space (23)	
B00X - R1010 - Shared Learning Space - (69.83 SQM)	Student Space (32)	
B00X - R9003 - Music Learning Space - (58.36 SQM) - Teaching Space: 1	Student Space (27)	
B00X - R9004 - General Learning Space - (57.87 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R9005 - General Learning Space - (57.49 SQM) - Teaching Space: 1	Student Space (26)	
B00X - R9006 - Performance Workshop - (105.9 SQM)	Student Space (49)	
B00X - R9008 - Multi-Purpose Space - (293.65 SQM)	Student Space (136)	
B00X - R9009 - Practice/Seminar - (18.95 SQM)	Not Applicable	Circulation or storage space.
B00X - R9015 - Movement - (35.77 SQM)	Not Applicable	Circulation or storage space.
B00X - R9016 - Movement - (20.16 SQM)	Not Applicable	Circulation or storage space.
B00X - R9017 - General Learning Space - (51.63 SQM) - Teaching Space: 1	Student Space (23)	
B00X - R9018 - Movement - (94.24 SQM)	Not Applicable	Circulation or storage space.
B00X - R9019 - Movement - (66.41 SQM)	Not Applicable	Circulation or storage space.
B00X - R9028 - Movement - (9.36 SQM)	Not Applicable	Circulation or storage space.
B00X - R9038 - Fitness Laboratory - (102.62 SQM)	Student Space (47)	
B00X - R9039 - Movement - (14 SQM)	Not Applicable	Circulation or storage space.
B00X - R9040 - Movement - (18.54 SQM)	Not Applicable	Circulation or storage space.
B00X - R9042 - Performance Workshop - (164.25 SQM)	Student Space (76)	
B00X - R9043 - Stage - (46.89 SQM)	Not Applicable	Circulation or storage space.
B00X - R9046 - Movement - (125.58 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0001 - Performance Workshop - (253.33 SQM)	Student Space (117)	
B00Y - R0004 - Movement - (58.52 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0008 - General Learning Space - (62.02 SQM) - Teaching Space: 1	Student Space (28)	
B00Y - R0009 - General Learning Space - (61.64 SQM) - Teaching Space: 1	Student Space (28)	
B00Y - R0011 - General Learning Space - (59.02 SQM) - Teaching Space: 1	Student Space (27)	
B00Y - R0013 - General Learning Space - (59.5 SQM) - Teaching Space: 1	Student Space (27)	
B00Y - R0015 - General Learning Space - (48.56 SQM) - Teaching Space: 1	Student Space (22)	
B00Y - R0016 - General Learning Space - (71.62 SQM) - Teaching Space: 1	Student Space (33)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00Y - R0017 - General Learning Space - (48.71 SQM) - Teaching Space: 1	● Student Space (22)	
B00Y - R0024 - Movement - (16.34 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0025 - Multi-Purpose Space - (41.48 SQM)	● Student Space (19)	
B00Y - R0026 - Movement - (534.19 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0055 - Movement - (5.14 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0056 - Movement - (12.69 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0061 - Movement - (9.14 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0062 - Movement - (8.76 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0063 - Movement - (220.25 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0064 - Movement - (5.77 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0070 - Movement - (80.42 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0073 - Movement - (5.95 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0074 - Movement - (102.43 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0077 - Movement - (14.01 SQM)	Not Applicable	Circulation or storage space.
B00Y - R0079 - Staff Study - (19.67 SQM)	● Office (4)	
B00Y - R0080 - Staff Study - (36.24 SQM)	● Office (9)	
B00Y - R0088 - General Learning Space - (52.34 SQM) - Teaching Space: 1	● Student Space (24)	
B00Y - R0089 - General Learning Space - (67.3 SQM) - Teaching Space: 1	● Student Space (31)	
B00Y - R0090 - Computer Learning Space - (69.32 SQM) - Teaching Space: 1	● Student Space (32)	
B00Y - R0091 - Movement - (14.55 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1009 - Preparation - (78.63 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1011 - Growing/Breeding - (15.04 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1012 - Science Laboratory - (96.94 SQM)	● Student Space (44)	
B00Y - R1013 - Science Laboratory - (96.66 SQM)	● Student Space (44)	
B00Y - R1014 - General Learning Space - (49.3 SQM) - Teaching Space: 1	● Student Space (22)	
B00Y - R1015 - General Learning Space - (47.43 SQM) - Teaching Space: 1	● Student Space (22)	
B00Y - R1016 - General Learning Space - (48.57 SQM) - Teaching Space: 1	● Student Space (22)	
B00Y - R1017 - General Learning Space - (48.59 SQM) - Teaching Space: 1	● Student Space (22)	
B00Y - R1021 - Duplicating Workroom - (41.63 SQM)	● Office (10)	
B00Y - R1022 - Interview/Office - Type 1 - (12.34 SQM)	● Office (3)	
B00Y - R1023 - Interview/Office - Type 1 - (12.34 SQM)	● Office (3)	
B00Y - R1024 - Interview/Office - Type 1 - (14.89 SQM)	● Office (3)	
B00Y - R1025 - Interview/Office - Type 1 - (14.79 SQM)	● Office (3)	
B00Y - R1026 - Staff Study - (425.48 SQM)	● Office (106)	
B00Y - R1027 - Commonroom - (89.88 SQM)	● Office (22)	
B00Y - R1034 - Staff Kitchen - (17.06 SQM)	● Office (4)	
B00Y - R1036 - Movement - (163.22 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1038 - Interview/Office - Type 1 - (11.81 SQM)	● Office (2)	
B00Y - R1041 - Movement - (18.63 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1042 - Movement - (23.43 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1051 - Art Entry/Display - (260.49 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1053 - Movement - (19.46 SQM)	Not Applicable	Circulation or storage space.
B00Y - R1057 - Staff Kitchen - (16.54 SQM)	● Office (4)	
B00Y - R1058 - Staff Kitchen - (12.34 SQM)	● Office (3)	
B00Y - R1064 - General Learning Space - (36.23 SQM) - Teaching Space: 1	● Student Space (16)	
B00Y - R2001 - Senior Study - (24.26 SQM)	● Office (6)	
B00Y - R2002 - General Learning Space - (46.84 SQM) - Teaching Space: 1	● Student Space (21)	
B00Y - R2003 - General Learning Space - (64.4 SQM) - Teaching Space: 1	● Student Space (29)	
B00Y - R2004 - General Learning Space - (69.83 SQM) - Teaching Space: 1	● Student Space (32)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00Y - R2005 - General Learning Space - (52.77 SQM) - Teaching Space: 1	Student Space (24)	
B00Y - R2007 - General Learning Space - (35.16 SQM) - Teaching Space: 1	Student Space (16)	
B00Y - R2016 - Movement - (27.15 SQM)	Not Applicable	Circulation or storage space.
B00Y - R2019 - Movement - (172.52 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8008 - Shared Learning Space - (217.78 SQM)	Student Space (101)	
B00Y - R8009 - Darkroom Space - (46.67 SQM)	Office (11)	
B00Y - R8010 - Senior Seminar - (48.32 SQM)	Office (12)	
B00Y - R8011 - Senior Seminar - (53.29 SQM)	Office (13)	
B00Y - R8012 - General Learning Space - (52.38 SQM) - Teaching Space: 1	Student Space (24)	
B00Y - R8014 - General Learning Space - (46.86 SQM) - Teaching Space: 1	Student Space (21)	
B00Y - R8015 - Multi Media Workshop - (115.59 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8016 - Seminar - (9.25 SQM)	Office (2)	
B00Y - R8018 - Movement - (9.8 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8021 - General Assistants - (8.9 SQM)	Office (2)	
B00Y - R8025 - Movement - (13.32 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8026 - Movement - (80.03 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8027 - Senior Seminar - (39.51 SQM)	Office (9)	
B00Y - R8028 - General Learning Space - (64.33 SQM) - Teaching Space: 1	Student Space (29)	
B00Y - R8029 - General Learning Space - (64.73 SQM) - Teaching Space: 1	Student Space (30)	
B00Y - R8032 - General Learning Space - (59.85 SQM) - Teaching Space: 1	Student Space (27)	
B00Y - R8033 - General Learning Space - (64.9 SQM) - Teaching Space: 1	Student Space (30)	
B00Y - R8034 - General Learning Space - (64.82 SQM) - Teaching Space: 1	Student Space (30)	
B00Y - R8035 - Movement - (9.48 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8041 - Movement - (54.65 SQM)	Not Applicable	Circulation or storage space.
B00Y - R8050 - Movement - (25.93 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9001 - Movement - (177.93 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9006 - General Learning Space - (49.72 SQM) - Teaching Space: 1	Student Space (23)	
B00Y - R9007 - General Learning Space - (48.14 SQM) - Teaching Space: 1	Student Space (22)	
B00Y - R9008 - General Learning Space - (49.12 SQM) - Teaching Space: 1	Student Space (22)	
B00Y - R9014 - Computer Learning Space - (62.35 SQM) - Teaching Space: 1	Student Space (28)	
B00Y - R9019 - General Learning Space - (47.45 SQM) - Teaching Space: 1	Student Space (22)	
B00Y - R9021 - Computer Learning Space - (63.07 SQM) - Teaching Space: 1	Student Space (29)	
B00Y - R9022 - Movement - (5.24 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9031 - Main Area - (426 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9032 - Movement - (411.42 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9033 - Staff Study - (14.53 SQM)	Office (3)	
B00Y - R9034 - Staff Study - (13.56 SQM)	Office (3)	
B00Y - R9036 - Seminar - (13.67 SQM)	Office (3)	
B00Y - R9037 - Seminar - (13.78 SQM)	Office (3)	
B00Y - R9038 - Seminar - (14.1 SQM)	Office (3)	
B00Y - R9040 - Computer Learning Space - (56.2 SQM) - Teaching Space: 1	Student Space (26)	
B00Y - R9042 - Multi-Purpose Space - (30.97 SQM)	Student Space (14)	
B00Y - R9045 - Movement - (55.83 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9052 - Movement - (8.63 SQM)	Not Applicable	Circulation or storage space.
B00Y - R9057 - General Learning Space - (49.13 SQM) - Teaching Space: 1	Student Space (22)	
B00Y - R9059 - Staff Study - (21.83 SQM)	Office (5)	
B00Y - R9060 - General Learning Space - (71.37 SQM) - Teaching Space: 1	Student Space (33)	
B00Y - R9061 - Kitchen - Type 1 - (15.23 SQM)	Student Space (7)	
B00Y - R9063 - Practical Activities - (7.02 SQM)	Student Space (3)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00Z - R0001 - Movement - (70.2 SQM)	Not Applicable	Circulation or storage space.
B00Z - R0002 - Leading Teacher - (11.1 SQM)	Office (2)	
B00Z - R0004 - Clinic - Boys - (11.13 SQM)	Office (2)	
B00Z - R0007 - Clinic - Girls - (11.03 SQM)	Office (2)	
B00Z - R0008 - Leading Teacher - (13.92 SQM)	Office (3)	
B00Z - R0009 - Deputy Principal Office - (27.26 SQM)	Office (6)	
B00Z - R0010 - Interview/Office - Type 1 - (10.07 SQM)	Office (2)	
B00Z - R0014 - Leading Teacher - (12.11 SQM)	Office (3)	
B00Z - R0017 - Interview/Meeting - (11.76 SQM)	Office (2)	
B00Z - R0018 - Interview/Meeting - (11.85 SQM)	Office (2)	
B00Z - R0019 - Principal Office - (21.07 SQM)	Office (5)	
B00Z - R0020 - Public Entry - (77.77 SQM)	Not Applicable	Circulation or storage space.
B00Z - R0027 - Movement - (5.18 SQM)	Not Applicable	Circulation or storage space.
B00Z - R0028 - Staff Kitchen - (6.68 SQM)	Office (1)	
B00Z - R0034 - Administration - Executive - (8.62 SQM)	Office (2)	
B00Z - R0035 - Administration - Clerical - (90.65 SQM)	Office (22)	
B00Z - R1001 - Movement - (98.23 SQM)	Not Applicable	Circulation or storage space.
B00Z - R1005 - Senior Study - (20.53 SQM)	Office (5)	
B00Z - R1006 - Kitchen - Type 1 - (121.64 SQM)	Student Space (56)	
B00Z - R1008 - General Learning Space - (56.61 SQM) - Teaching Space: 1	Student Space (26)	
B00Z - R1009 - General Learning Space - (56.6 SQM) - Teaching Space: 1	Student Space (26)	
B00Z - R1010 - Food/Research Space - (26.19 SQM)	Not Applicable	Circulation or storage space.
B00Z - R9003 - Art Learning Space - (56.37 SQM) - Teaching Space: 1	Student Space (26)	
B00Z - R9004 - Visual Arts Workshop - (136.58 SQM)	Student Space (63)	
B00Z - R9005 - Art Learning Space - (56.14 SQM) - Teaching Space: 1	Student Space (26)	
B00Z - R9006 - Art Learning Space - (55.5 SQM) - Teaching Space: 1	Student Space (25)	
B00Z - R9007 - Movement - (8.91 SQM)	Not Applicable	Circulation or storage space.
B00Z - R9024 - Movement - (43.61 SQM)	Not Applicable	Circulation or storage space.
B00Z - R9026 - Movement - (84.24 SQM)	Not Applicable	Circulation or storage space.
OS 760 10434 - OS 760 10434 - Woodwork/Store - (114 SQM)	Not Applicable	Circulation or storage space.