


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Goulburn High School (8116)</b>
<b>AMU REGION:</b>	<b>Southern NSW</b>
<b>STATE ELECTORATE:</b>	<b>Goulburn</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Goulburn Mulwaree</b>

8116 - Goulburn High School  
Site Plan (13399)

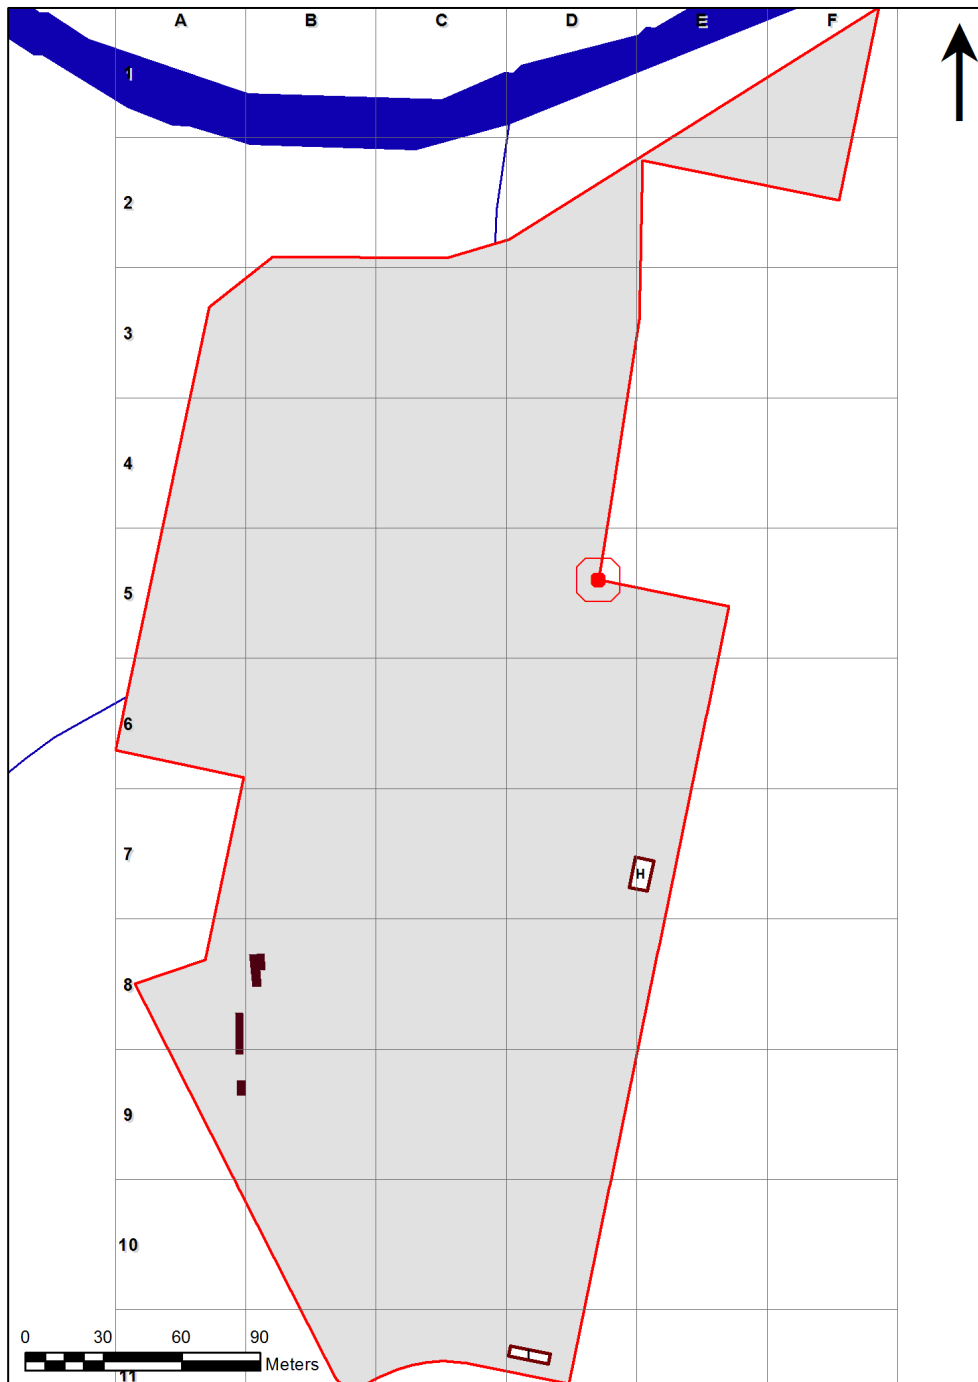

1:1,924

Printed: 21-Mar-2020

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Staff Study - (17.04 SQM)	Office (4)	
B00A - R0009 - Movement - (30.3 SQM)	Not Applicable	Circulation or storage space.
B00A - R0020 - Materials Technology L.S. - (64.78 SQM) - Teaching Space: 1	Student Space (30)	
B00A - R0021 - Wood Technology Bay - (25.4 SQM)	Not Applicable	Circulation or storage space.
B00A - R0026 - Computer Learning Space - (64.43 SQM) - Teaching Space: 1	Student Space (29)	
B00A - R0031 - Welding/Hot Metals Area - (12.03 SQM)	Not Applicable	Circulation or storage space.
B00A - R0032 - Materials Technology L.S. - (85.69 SQM) - Teaching Space: 1	Student Space (39)	
B00A - R1002 - Materials Technology L.S. - (98.47 SQM) - Teaching Space: 1	Student Space (45)	
B00A - R1009 - Movement - (17.11 SQM)	Not Applicable	Circulation or storage space.
B00B - R0010 - Staff Study - (16.54 SQM)	Office (4)	
B00B - R0011 - Preparation - (17.91 SQM)	Not Applicable	Circulation or storage space.
B00B - R0012 - Laboratory L.S. - (93.92 SQM) - Teaching Space: 1	Student Space (43)	
B00B - R0016 - General Learning Space - (97.6 SQM) - Teaching Space: 1	Student Space (45)	
B00B - R0017 - Interview/Meeting - (10.94 SQM)	Office (2)	
B00B - R0018 - Practical Activities - (50.97 SQM)	Student Space (23)	
B00B - R0023 - Movement - (36.8 SQM)	Not Applicable	Circulation or storage space.
B00B - R1001 - Design L.S. - (65.34 SQM) - Teaching Space: 1	Student Space (30)	
B00B - R1002 - Movement - (24.69 SQM)	Not Applicable	Circulation or storage space.
B00B - R1003 - Design L.S. - (51.98 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1004 - Practical Activities - (21.83 SQM)	Student Space (10)	
B00B - R1006 - Staff Study - (13.93 SQM)	Office (3)	
B00B - R1007 - Movement - (22.82 SQM)	Not Applicable	Circulation or storage space.
B00B - R1011 - Staff Study - (18.69 SQM)	Office (4)	
B00B - R1012 - Movement - (18.63 SQM)	Not Applicable	Circulation or storage space.
B00B - R1013 - General Learning Space - (51.77 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1014 - Music Learning Space - (65.59 SQM) - Teaching Space: 1	Student Space (30)	
B00C - R0006 - Staff Study - (52.27 SQM)	Office (13)	
B00C - R0016 - Preparation - (24.02 SQM)	Not Applicable	Circulation or storage space.
B00C - R0017 - Growing/Breeding - (8.12 SQM)	Not Applicable	Circulation or storage space.
B00C - R0022 - Movement - (203.24 SQM)	Not Applicable	Circulation or storage space.
B00C - R0026 - Staff Study - (25.39 SQM)	Office (6)	
B00C - R0028 - Laboratory L.S. - (82.2 SQM) - Teaching Space: 1	Student Space (38)	
B00C - R0029 - Preparation - Science - (25.68 SQM)	Not Applicable	Circulation or storage space.
B00C - R0031 - Laboratory L.S. - (82.02 SQM) - Teaching Space: 1	Student Space (38)	
B00C - R0032 - Laboratory L.S. - (82.2 SQM) - Teaching Space: 1	Student Space (38)	
B00C - R1001 - Art Learning Space - (80.04 SQM) - Teaching Space: 1	Student Space (37)	
B00C - R1009 - General Learning Space - (52.12 SQM) - Teaching Space: 1	Student Space (24)	
B00C - R1014 - Staff Study - (26.24 SQM)	Office (6)	
B00C - R1015 - Seminar - Type 1 - (12.92 SQM)	Office (3)	
B00C - R1016 - Seminar - Type 1 - (12.85 SQM)	Office (3)	
B00C - R1017 - General Learning Space - (53.59 SQM) - Teaching Space: 1	Student Space (24)	
B00C - R1020 - Staff Study - (24.6 SQM)	Office (6)	
B00C - R1021 - Computer Learning Space - (66.68 SQM) - Teaching Space: 1	Student Space (30)	
B00C - R1022 - Staff Study - (9.54 SQM)	Office (2)	
B00C - R1023 - Computer Learning Space - (52.19 SQM) - Teaching Space: 1	Student Space (24)	
B00C - R1025 - Movement - (121.8 SQM)	Not Applicable	Circulation or storage space.
B00C - R1027 - Art Learning Space - (87.5 SQM) - Teaching Space: 1	Student Space (40)	
B00D - R0003 - Food Technology L.S. - (91.66 SQM) - Teaching Space: 1	Student Space (42)	
B00D - R0004 - Staff Study - (12.32 SQM)	Office (3)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R0005 - Food Technology L.S. - (88.87 SQM) - Teaching Space: 1	● Student Space (41)	
B00D - R0008 - Movement - (34.89 SQM)	Not Applicable	Circulation or storage space.
B00D - R0010 - Food/Research Space - (20.64 SQM)	Not Applicable	Circulation or storage space.
B00D - R0011 - Staff Study - (20.47 SQM)	● Office (5)	
B00E - R0001 - Laboratory L.S. - (88.5 SQM) - Teaching Space: 1	● Student Space (41)	
B00E - R0002 - Preparation - (29.43 SQM)	Not Applicable	Circulation or storage space.
B00E - R0005 - General Learning Space - (52.64 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R0007 - General Learning Space - (52.7 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R0009 - General Learning Space - (55.41 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R0013 - General Learning Space - (55.41 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R0017 - Movement - (162.74 SQM)	Not Applicable	Circulation or storage space.
B00E - R0020 - General Assistants - (20.79 SQM)	● Office (5)	
B00E - R0032 - Computer Learning Space - (52.7 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R0033 - Staff Study - (52.63 SQM)	● Office (13)	
B00E - R0036 - Movement - (16.05 SQM)	Not Applicable	Circulation or storage space.
B00E - R0037 - Movement - (14.51 SQM)	Not Applicable	Circulation or storage space.
B00E - R0039 - Laboratory L.S. - (82.27 SQM) - Teaching Space: 1	● Student Space (38)	
B00E - R1001 - General Learning Space - (55.18 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R1002 - General Learning Space - (79.21 SQM) - Teaching Space: 1	● Student Space (36)	
B00E - R1005 - Staff Study - (26.86 SQM)	● Office (6)	
B00E - R1007 - General Learning Space - (52.49 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R1009 - General Learning Space - (55.18 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R1015 - General Learning Space - (55.05 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R1016 - General Learning Space - (52.92 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R1017 - General Learning Space - (52.99 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R1018 - Staff Study - (52.78 SQM)	● Office (13)	
B00E - R1020 - General Learning Space - (66.13 SQM) - Teaching Space: 1	● Student Space (30)	
B00E - R1021 - Staff Study - (55.11 SQM)	● Office (13)	
B00E - R1023 - Interview/Office - Type 1 - (19.09 SQM)	● Office (4)	
B00E - R1024 - Interview/Office - Type 1 - (19.25 SQM)	● Office (4)	
B00E - R1029 - General Learning Space - (63.21 SQM) - Teaching Space: 1	● Student Space (29)	
B00E - R1032 - Movement - (12.97 SQM)	Not Applicable	Circulation or storage space.
B00E - R1033 - Movement - (13.25 SQM)	Not Applicable	Circulation or storage space.
B00E - R2001 - General Learning Space - (55.12 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R2004 - General Learning Space - (52.57 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R2006 - Design L.S. - (66.36 SQM) - Teaching Space: 1	● Student Space (30)	
B00E - R2010 - Design L.S. - (65.56 SQM) - Teaching Space: 1	● Student Space (30)	
B00E - R2012 - General Learning Space - (52.57 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R2014 - General Learning Space - (55.11 SQM) - Teaching Space: 1	● Student Space (25)	
B00E - R2016 - Movement - (134.43 SQM)	Not Applicable	Circulation or storage space.
B00F - R0009 - Movement - (69.48 SQM)	Not Applicable	Circulation or storage space.
B00F - R0011 - Student Canteen - (71.22 SQM)	Not Applicable	Circulation or storage space.
B00G - R0002 - Multi-Purpose Space - (9.66 SQM)	● Student Space (4)	
B00G - R0005 - Multi-Purpose Space - (410.34 SQM)	● Student Space (190)	
B00G - R0016 - Movement - (16.16 SQM)	Not Applicable	Circulation or storage space.
B00G - R0017 - Stage - (90.84 SQM)	Not Applicable	Circulation or storage space.
B00G - R0027 - Movement - (31.74 SQM)	Not Applicable	Circulation or storage space.
B00G - R9002 - Movement - (7.61 SQM)	Not Applicable	Circulation or storage space.
B00M - M1003 - Seminar - (11.14 SQM)	● Office (2)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00M - M1004 - Seminar - (11.27 SQM)	Office (2)	
B00M - M1005 - Movement - (5.66 SQM)	Not Applicable	Circulation or storage space.
B00M - M1006 - Seminar - (9.25 SQM)	Office (2)	
B00M - M1007 - Seminar - (9.27 SQM)	Office (2)	
B00M - M1008 - Movement - (5.65 SQM)	Not Applicable	Circulation or storage space.
B00M - R0007 - Leading Teacher - (11.18 SQM)	Office (2)	
B00M - R0009 - Deputy Principal Office - (13.06 SQM)	Office (3)	
B00M - R0010 - Interview/Office - Type 1 - (16.47 SQM)	Office (4)	
B00M - R0015 - Administration - Clerical - (11.63 SQM)	Office (2)	
B00M - R0016 - Duplicating Workroom - (28.19 SQM)	Office (7)	
B00M - R0018 - General Learning Space - (49.17 SQM) - Teaching Space: 1	Student Space (22)	
B00M - R0019 - General Learning Space - (54.28 SQM) - Teaching Space: 1	Student Space (25)	
B00M - R0020 - General Learning Space - (54.34 SQM) - Teaching Space: 1	Student Space (25)	
B00M - R0021 - General Learning Space - (54.34 SQM) - Teaching Space: 1	Student Space (25)	
B00M - R0027 - Staff Study - (51.54 SQM)	Office (12)	
B00M - R0028 - Commonroom - (85.62 SQM)	Office (21)	
B00M - R0029 - Principal Office - (23.21 SQM)	Office (5)	
B00M - R0030 - Administration - Clerical - (43.55 SQM)	Office (10)	
B00M - R0032 - Clinic - Boys - (13.1 SQM)	Office (3)	
B00M - R0033 - Public Entry - (18.55 SQM)	Not Applicable	Circulation or storage space.
B00M - R0037 - Movement - (66.85 SQM)	Not Applicable	Circulation or storage space.
B00M - R0039 - Movement - (108.05 SQM)	Not Applicable	Circulation or storage space.
B00M - R0042 - Public Reception - (11.22 SQM)	Not Applicable	Circulation or storage space.
B00M - R0043 - Interview/Meeting - (10.41 SQM)	Office (2)	
B00M - R1001 - Senior Seminar - (20.29 SQM)	Office (5)	
B00M - R1002 - Movement - (12.57 SQM)	Not Applicable	Circulation or storage space.
B00M - R1005 - Workroom - (59.2 SQM)	Office (14)	
B00M - R1007 - Staff Study - (45.64 SQM)	Office (11)	
B00M - R1009 - Movement - (14.09 SQM)	Not Applicable	Circulation or storage space.
B00M - R1014 - Main Area - (373.18 SQM)	Not Applicable	Circulation or storage space.
B00M - R1022 - Outdoor Learning Area - (84.47 SQM)	Not Applicable	Circulation or storage space.
B00M - R1023 - Outdoor Learning Area - (84.85 SQM)	Not Applicable	Circulation or storage space.
B00M - R1025 - Staff Lounge - (24.21 SQM)	Office (6)	