


VENTILATION AUDIT REPORT

SCHOOL:	Hastings Secondary College Port Macquarie Campus (8364)
AMU REGION:	North Coast
STATE ELECTORATE:	Port Macquarie
LOCAL GOVERNMENT AREA:	Port Macquarie-Hastings

8364 - Hastings Secondary College Port Macquarie Campus
Site Plan (13448)

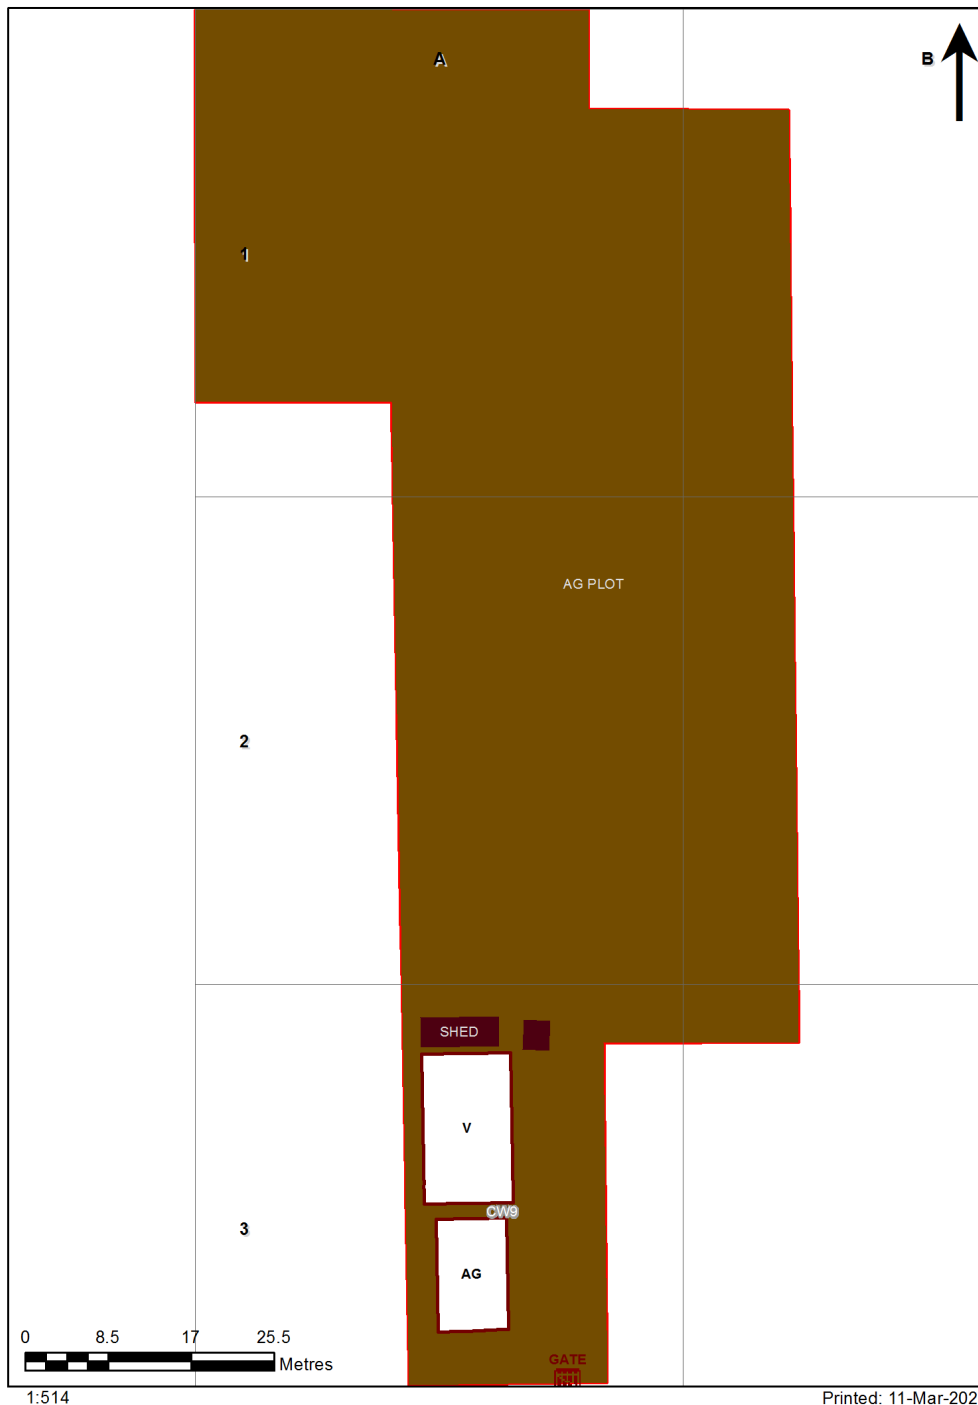

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0002 - Movement - (14.44 SQM)	Not Applicable	Circulation or storage space.
B00A - R0015 - Principal Office - (18.5 SQM)	Office (4)	
B00A - R0019 - Administration - Clerical - (16.26 SQM)	Office (4)	
B00A - R0020 - Clinic - Boys - (10.61 SQM)	Office (2)	
B00A - R0021 - Interview/Office - Type 1 - (8.41 SQM)	Office (2)	
B00A - R0022 - Movement - (37.57 SQM)	Not Applicable	Circulation or storage space.
B00A - R0035 - Food Technology L.S. - (101.64 SQM) - Teaching Space: 1	Student Space (47)	
B00A - R0036 - Interview/Office - Type 1 - (12.12 SQM)	Office (3)	
B00A - R0037 - Movement - (79.66 SQM)	Not Applicable	Circulation or storage space.
B00A - R0040 - Administration - Clerical - (13.05 SQM)	Office (3)	
B00A - R0042 - Movement - (19.59 SQM)	Not Applicable	Circulation or storage space.
B00A - R0046 - Movement - (70.05 SQM)	Not Applicable	Circulation or storage space.
B00A - R0047 - Administration - Clerical - (63.43 SQM)	Office (15)	
B00A - R0049 - Deputy Principal Office - (13.31 SQM)	Office (3)	
B00A - R0050 - Interview/Office - Type 2 - (11.7 SQM)	Office (2)	
B00A - R0058 - Kitchen - Type 1 - (108.21 SQM)	Student Space (50)	
B00A - R0061 - Preparation - (18.66 SQM)	Not Applicable	Circulation or storage space.
B00A - R0062 - Kitchen - Type 2 - (14.62 SQM)	Student Space (6)	
B00A - R0063 - Food/Research Space - (25.07 SQM)	Not Applicable	Circulation or storage space.
B00A - R0067 - Commonroom - (68.65 SQM)	Office (17)	
B00A - R0068 - Staff Kitchen - (5.33 SQM)	Office (1)	
B00A - R1003 - Materials Technology L.S. - (59.78 SQM) - Teaching Space: 1	Student Space (27)	
B00A - R1004 - Seminar/Technology Space - (12.09 SQM)	Office (3)	
B00A - R1006 - Materials Technology L.S. - (56.14 SQM) - Teaching Space: 1	Student Space (26)	
B00A - R1007 - General Learning Space - (37.96 SQM) - Teaching Space: 1	Student Space (17)	
B00A - R1008 - General Learning Space - (50.4 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1009 - General Learning Space - (50.9 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1010 - General Learning Space - (51.46 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1011 - Staff Study - (43.86 SQM)	Office (10)	
B00A - R1015 - Seminar - (24.82 SQM)	Office (6)	
B00A - R1016 - Staff Study - (12.02 SQM)	Office (3)	
B00A - R1017 - Movement - (20.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R1018 - General Learning Space - (50.47 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1019 - General Learning Space - (51.11 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1020 - Movement - (89.58 SQM)	Not Applicable	Circulation or storage space.
B00A - R1021 - Movement - (11.63 SQM)	Not Applicable	Circulation or storage space.
B00B - R0001 - Staff Study - (25.85 SQM)	Office (6)	
B00B - R0002 - General Learning Space - (52.42 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0003 - General Learning Space - (52.57 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0004 - Laboratory L.S. - (78.89 SQM) - Teaching Space: 1	Student Space (36)	
B00B - R0005 - Preparation - (12.62 SQM)	Not Applicable	Circulation or storage space.
B00B - R0006 - Preparation - (12.66 SQM)	Not Applicable	Circulation or storage space.
B00B - R0009 - Laboratory L.S. - (92.16 SQM) - Teaching Space: 1	Student Space (42)	
B00B - R0011 - Preparation - (18.85 SQM)	Not Applicable	Circulation or storage space.
B00B - R0012 - General Learning Space - (52.35 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0018 - Movement - (98.13 SQM)	Not Applicable	Circulation or storage space.
B00B - R0019 - Movement - (14.77 SQM)	Not Applicable	Circulation or storage space.
B00B - R0020 - Movement - (19.03 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R1002 - Staff Study - (26.73 SQM)	Office (6)	
B00B - R1003 - Movement - (5.43 SQM)	Not Applicable	Circulation or storage space.
B00B - R1006 - General Learning Space - (52.28 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1007 - General Learning Space - (52.28 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1008 - Music Learning Space - (65.54 SQM) - Teaching Space: 1	Student Space (30)	
B00B - R1014 - Art Learning Space - (59.35 SQM) - Teaching Space: 1	Student Space (27)	
B00B - R1016 - Art Learning Space - (52.63 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1019 - Staff Study - (25.84 SQM)	Office (6)	
B00B - R1022 - Movement - (95.31 SQM)	Not Applicable	Circulation or storage space.
B00B - R1023 - Movement - (15.39 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Administration - Clerical - (35.06 SQM)	Office (8)	
B00C - R0013 - Movement - (125.2 SQM)	Not Applicable	Circulation or storage space.
B00C - R0015 - Seminar - (70.71 SQM)	Office (17)	
B00L - R0005 - General Learning Space - (52.79 SQM) - Teaching Space: 1	Student Space (24)	
B00L - R0007 - General Learning Space - (52.86 SQM) - Teaching Space: 1	Student Space (24)	
B00L - R0010 - General Learning Space - (51.47 SQM) - Teaching Space: 1	Student Space (23)	
B00L - R0015 - Serviced Learning Space - (53.87 SQM) - Teaching Space: 1	Student Space (24)	
B00L - R0017 - Staff Study - (41.3 SQM)	Office (10)	
B00L - R0021 - Laboratory L.S. - (92.54 SQM) - Teaching Space: 1	Student Space (42)	
B00L - R0024 - Laboratory L.S. - (93.03 SQM) - Teaching Space: 1	Student Space (43)	
B00L - R0027 - Staff Study - (25.95 SQM)	Office (6)	
B00L - R0028 - Movement - (95.84 SQM)	Not Applicable	Circulation or storage space.
B00L - R0029 - Staff Study - (24.77 SQM)	Office (6)	
B00L - R0033 - Movement - (69.88 SQM)	Not Applicable	Circulation or storage space.
B00L - R0036 - General Learning Space - (52.78 SQM) - Teaching Space: 1	Student Space (24)	
B00L - R0037 - Preparation - (39.31 SQM)	Not Applicable	Circulation or storage space.
B00L - R0038 - Growing/Breeding - (24.52 SQM)	Not Applicable	Circulation or storage space.
B00L - R0039 - Movement - (33.24 SQM)	Not Applicable	Circulation or storage space.
B00L - R0041 - Performance Workspace - (117.72 SQM) - Teaching Space: 1	Student Space (54)	
B00L - R0042 - Movement - (137.38 SQM)	Not Applicable	Circulation or storage space.
B00L - R1002 - Computer Learning Space - (52.64 SQM) - Teaching Space: 1	Student Space (24)	
B00L - R1005 - General Learning Space - (39.33 SQM) - Teaching Space: 1	Student Space (18)	
B00L - R1008 - Computer Learning Space - (51.39 SQM) - Teaching Space: 1	Student Space (23)	
B00L - R1009 - Movement - (53.78 SQM)	Not Applicable	Circulation or storage space.
B00L - R1016 - Movement - (51.52 SQM)	Not Applicable	Circulation or storage space.
B00L - R1017 - General Learning Space - (54 SQM) - Teaching Space: 1	Student Space (25)	
B00L - R1019 - Movement - (7.11 SQM)	Not Applicable	Circulation or storage space.
B00L - R1022 - Interview/Office - Type 1 - (14.26 SQM)	Office (3)	
B00L - R1023 - Deputy Principal Office - (14.19 SQM)	Office (3)	
B00L - R1024 - Deputy Principal Office - (12.02 SQM)	Office (3)	
B00L - R1025 - Movement - (26.66 SQM)	Not Applicable	Circulation or storage space.
B00L - R1029 - General Learning Space - (54.16 SQM) - Teaching Space: 1	Student Space (25)	
B00L - R1031 - General Learning Space - (54.02 SQM) - Teaching Space: 1	Student Space (25)	
B00L - R1033 - General Learning Space - (52.73 SQM) - Teaching Space: 1	Student Space (24)	
B00L - R1036 - Movement - (122.54 SQM)	Not Applicable	Circulation or storage space.
B00L - R1041 - Audio Visual Workroom - (5.91 SQM)	Student Space (2)	
B00L - R1045 - Staff Kitchen - (6.69 SQM)	Office (1)	
B00L - R1054 - Main Area - (345.21 SQM)	Not Applicable	Circulation or storage space.
B00L - R1055 - Staff Study - (72.99 SQM)	Office (18)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00L - R1057 - Staff Study - (15.36 SQM)	Office (3)	
B00S - R0001 - Senior Study - (47.13 SQM)	Office (11)	
B00S - R0002 - Senior Study - (47.12 SQM)	Office (11)	
B00T - R0008 - Seminar/Technology Space - (25.98 SQM)	Office (6)	
B00T - R0009 - Design L.S. - (52.71 SQM) - Teaching Space: 1	Student Space (24)	
B00T - R0012 - Staff Study - (28 SQM)	Office (7)	
B00T - R0014 - Materials Technology L.S. - (103.24 SQM) - Teaching Space: 1	Student Space (47)	
B00T - R0015 - Workshop Area - (27.63 SQM)	Student Space (12)	
B00T - R0016 - Movement - (55.46 SQM)	Not Applicable	Circulation or storage space.
B00T - R0018 - Design/Technology L.S. - (66.11 SQM) - Teaching Space: 1	Student Space (30)	
B00T - R9001 - General Assistants - (12.62 SQM)	Office (3)	
B00T - R9003 - Workshop - (44.6 SQM)	Student Space (20)	
B00T - R9005 - Movement - (28.32 SQM)	Not Applicable	Circulation or storage space.
B00U - R0001 - Student Canteen - (50.09 SQM)	Not Applicable	Circulation or storage space.
B00U - R0006 - Movement - (15.12 SQM)	Not Applicable	Circulation or storage space.
B0AG - R0007 - Growing/Breeding - (5.84 SQM)	Not Applicable	Circulation or storage space.
BMPC - R0005 - Multi-Purpose Space - (484.04 SQM)	Student Space (224)	
BMPC - R0006 - Staff Kitchen - (15.4 SQM)	Office (3)	
BMPC - R0008 - Staff Study - (12.3 SQM)	Office (3)	
BMPC - R0009 - Staff Study - (21.15 SQM)	Office (5)	
BMPC - R0013 - Public Entry - (16.04 SQM)	Not Applicable	Circulation or storage space.
BMPC - R0022 - Stage - (68.12 SQM)	Not Applicable	Circulation or storage space.
BMPC - R0023 - Pupil Entry - (16.07 SQM)	Not Applicable	Circulation or storage space.
BMPC - R0025 - Movement - (209.85 SQM)	Not Applicable	Circulation or storage space.
BTAS - R0001 - Materials Technology L.S. - (95.79 SQM) - Teaching Space: 1	Student Space (44)	
BTAS - R0009 - Materials Technology L.S. - (96.95 SQM) - Teaching Space: 1	Student Space (44)	
BTAS - R0010 - Movement - (21.84 SQM)	Not Applicable	Circulation or storage space.
BTAS - R0011 - Movement - (10.72 SQM)	Not Applicable	Circulation or storage space.
BTAS - R0013 - Staff Study - (59.91 SQM)	Office (14)	
BTAS - R0015 - Movement - (6.37 SQM)	Not Applicable	Circulation or storage space.
OS 523 13108 - OS 523 13108 - Staff Study With Toilets - (76 SQM)	Office (19)	
OS 601 11040 - OS 601 11040 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 12782 - OS 601 12782 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 12955 - OS 601 12955 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 13043 - OS 601 13043 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 15677 - OS 601 15677 - Learning Unit - Standard/Withdrawal - (76 SQM)	Student Space (35)	
OS 601 19882 - OS 601 19882 - Learning Unit - Standard/Withdrawal - (SQM)	Student Space ()	
OS 606 19263 - OS 606 19263 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	Student Space (35)	
OS 606 19581 - OS 606 19581 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	Student Space (35)	
OS 711 15786 - OS 711 15786 - Home Science/Art/Science Dem/Computer - (95 SQM)	Student Space (44)	
OS 720 10506 - OS 720 10506 - Science Laboratory/Prep Room - (114 SQM)	Not Applicable	Circulation or storage space.
OS 760 10924 - OS 760 10924 - Woodwork/Store - (114 SQM)	Not Applicable	Circulation or storage space.
OS 760 70076 - OS 760 70076 - Woodwork/Store - (114 SQM)	Not Applicable	Circulation or storage space.
OS 770 15916 - OS 770 15916 - Technics - Metalwork/Heat Area/Store - (114 SQM)	Not Applicable	Circulation or storage space.