


VENTILATION AUDIT REPORT

SCHOOL:	Jamisontown Public School (4544)
AMU REGION:	Western Sydney
STATE ELECTORATE:	Penrith
LOCAL GOVERNMENT AREA:	Penrith

4544 - Jamisontown Public School
Site Plan (10442)

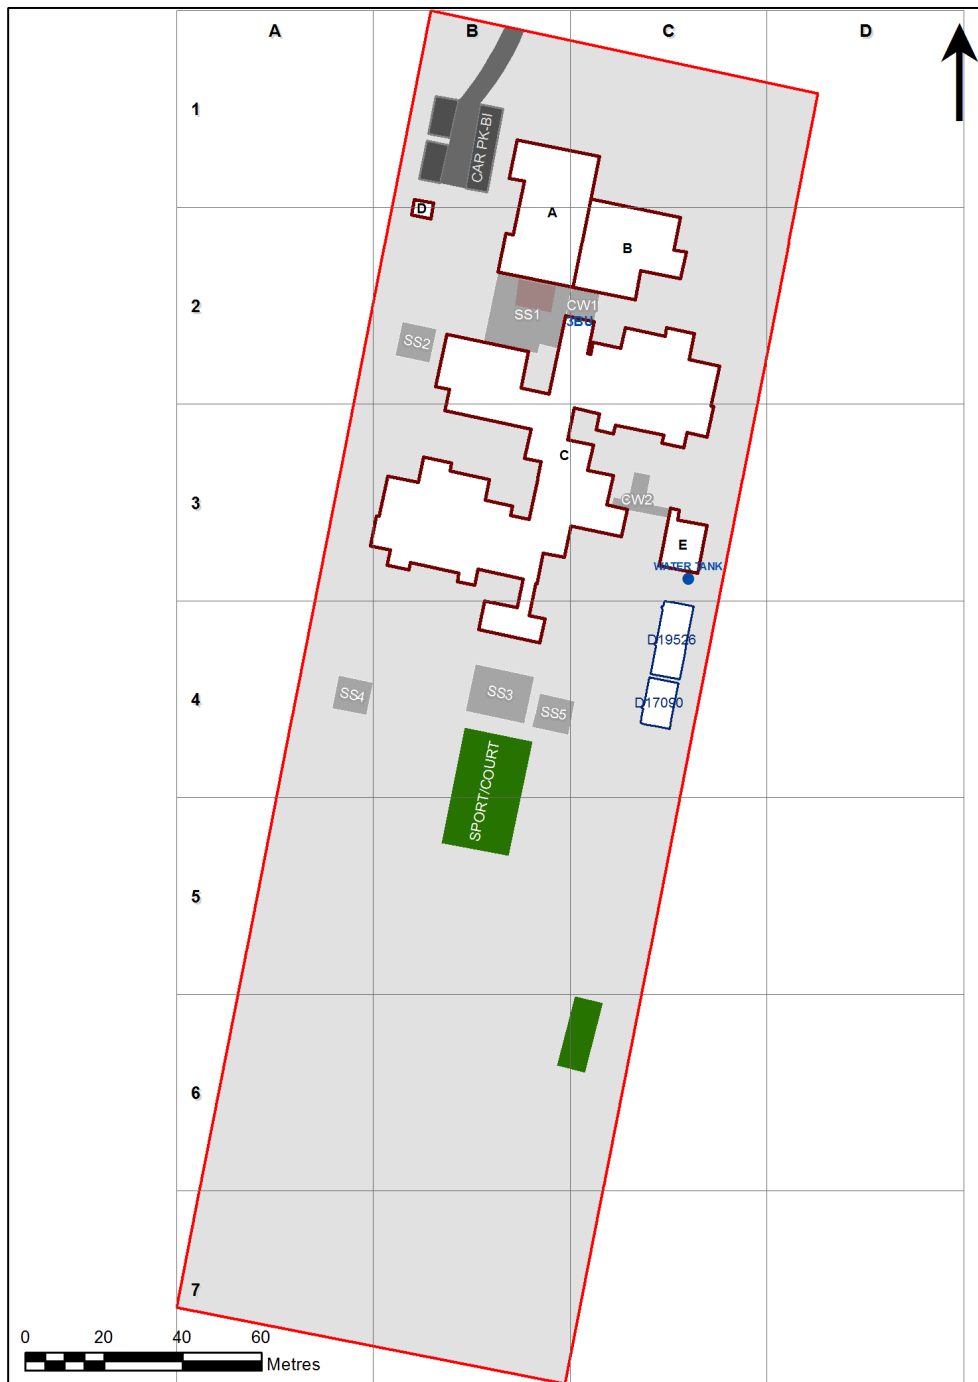

1:1,274

Printed: 30-Mar-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0003 - Communal Space - (250.16 SQM)	● Student Space (116)	
B00A - R0006 - Movement - (86.17 SQM)	Not Applicable	Circulation or storage space.
B00A - R0007 - Canteen - (43.19 SQM)	Not Applicable	Circulation or storage space.
B00A - R0013 - Raised Platform - (53.8 SQM)	Not Applicable	Circulation or storage space.
B00A - R0017 - Movement - (11.31 SQM)	Not Applicable	Circulation or storage space.
B00B - R0006 - Movement - (46.08 SQM)	Not Applicable	Circulation or storage space.
B00B - R0007 - Staff Room - (70.61 SQM)	● Office (17)	
B00B - R0008 - Sick Bay - (12.18 SQM)	● Student Space (5)	
B00B - R0009 - Interview - (13.21 SQM)	● Office (3)	
B00B - R0014 - Staff Room Annexe - (12.14 SQM)	● Office (3)	
B00B - R0015 - Deputy Principal - (13.11 SQM)	● Office (3)	
B00B - R0016 - Entry Vestibule - (19.36 SQM)	Not Applicable	Circulation or storage space.
B00B - R0017 - Clerical Office - (13.21 SQM)	● Office (3)	
B00B - R0018 - Clerical Office/Workroom - (32.54 SQM)	● Office (8)	
B00B - R0019 - Principal - (22.61 SQM)	● Office (5)	
B00B - R0020 - Movement - (5.76 SQM)	Not Applicable	Circulation or storage space.
B00B - R0021 - Movement - (17.04 SQM)	Not Applicable	Circulation or storage space.
B00B - R0022 - Movement - (37.73 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Movement - (14.53 SQM)	Not Applicable	Circulation or storage space.
B00C - R0002 - Movement - (44.21 SQM)	Not Applicable	Circulation or storage space.
B00C - R0003 - Home Base - (60.58 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0005 - Practical Activities - 1hb - (26.43 SQM)	● Student Space (12)	
B00C - R0006 - Home Base - (60.4 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0008 - Withdrawal Space - 1hb - (13.72 SQM)	● Student Space (6)	
B00C - R0009 - Home Base - (60.85 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0010 - Movement - (12.21 SQM)	Not Applicable	Circulation or storage space.
B00C - R0013 - Home Base - (64.21 SQM) - Teaching Space: 1	● Student Space (29)	
B00C - R0016 - Withdrawal Space - 1hb - (14.01 SQM)	● Student Space (6)	
B00C - R0017 - Home Base - (60.42 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0021 - Movement - (5.14 SQM)	Not Applicable	Circulation or storage space.
B00C - R0024 - Seminar/Study - (13.54 SQM)	● Office (3)	
B00C - R0025 - Seminar/Study - (13.54 SQM)	● Office (3)	
B00C - R0026 - Reading Area - (209.51 SQM)	● Student Space (97)	
B00C - R0029 - Movement - (21.39 SQM)	Not Applicable	Circulation or storage space.
B00C - R0034 - Movement - (32.48 SQM)	Not Applicable	Circulation or storage space.
B00C - R0042 - Home Base - (60.72 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0043 - Withdrawal Space - 1hb - (13.99 SQM)	● Student Space (6)	
B00C - R0044 - Home Base - (63.94 SQM) - Teaching Space: 1	● Student Space (29)	
B00C - R0048 - Home Base - (60.61 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0049 - Movement - (11.69 SQM)	Not Applicable	Circulation or storage space.
B00C - R0050 - Withdrawal Space - 1hb - (13.68 SQM)	● Student Space (6)	
B00C - R0052 - Home Base - (59.86 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R0053 - Practical Activities - 1hb - (26.13 SQM)	● Student Space (12)	
B00C - R0054 - Movement - (45.41 SQM)	Not Applicable	Circulation or storage space.
B00C - R0055 - Home Base - (60.38 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0056 - Movement - (14.01 SQM)	Not Applicable	Circulation or storage space.
B00C - R0059 - Withdrawal Space - 1hb - (13.07 SQM)	● Student Space (6)	
B00C - R0061 - Home Base - (60.48 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0062 - Movement - (17.34 SQM)	Not Applicable	Circulation or storage space.
B00C - R0063 - Movement - (16.68 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00C - R0064 - Practical Activities - 1hb - (30.7 SQM)	● Student Space (14)	
B00C - R0065 - Withdrawal Space - 1hb - (16.96 SQM)	● Student Space (7)	
B00C - R0067 - Movement - (106.95 SQM)	Not Applicable	Circulation or storage space.
B00C - R0072 - Special Programs Room - (31.78 SQM)	● Student Space (14)	
B00C - R0076 - Withdrawal Space - 1hb - (7.3 SQM)	● Student Space (3)	
B00C - R0077 - Home Base - (60.97 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0079 - Home Base - (61.22 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0080 - Movement - (9.68 SQM)	Not Applicable	Circulation or storage space.
B00C - R0081 - Withdrawal Space - 1hb - (12.85 SQM)	● Student Space (5)	
B00C - R0082 - Home Base - (60.96 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0084 - Movement - (54.09 SQM)	Not Applicable	Circulation or storage space.
B00C - R0085 - Practical Activities - 1hb - (23.43 SQM)	● Student Space (10)	
B00C - R0086 - Staff Room Annexe - (15.51 SQM)	● Office (3)	
B00C - R0088 - Movement - (38.94 SQM)	Not Applicable	Circulation or storage space.
B00C - R0089 - Movement - (21.7 SQM)	Not Applicable	Circulation or storage space.
B00C - R0091 - Withdrawal Space - 1hb - (15.06 SQM)	● Student Space (6)	
B00C - R0092 - Practical Activities - 1hb - (26.27 SQM)	● Student Space (12)	
B00C - R0093 - Movement - (20.65 SQM)	Not Applicable	Circulation or storage space.
B00C - R0094 - Home Base - (60.8 SQM) - Teaching Space: 1	● Student Space (28)	
B00C - R0095 - Movement - (17.11 SQM)	Not Applicable	Circulation or storage space.
B00C - R0096 - Withdrawal Space - 1hb - (12.92 SQM)	● Student Space (5)	
B00C - R0101 - Movement - (26.11 SQM)	Not Applicable	Circulation or storage space.
B00C - R0102 - Movement - (57.59 SQM)	Not Applicable	Circulation or storage space.
B00C - R0103 - Movement - (38.27 SQM)	Not Applicable	Circulation or storage space.
B00C - R0104 - Movement - (55.33 SQM)	Not Applicable	Circulation or storage space.
B00C - R0105 - Movement - (140.42 SQM)	Not Applicable	Circulation or storage space.
B00E - R0003 - Special Programs Room - (32.12 SQM)	● Student Space (14)	
B00E - R0004 - Special Programs Room - (31.96 SQM)	● Student Space (14)	
OS 612 19526 - OS 612 19526 - Learning Unit - Double With Resource - (152 SQM)	● Student Space (70)	
OS 621 17090 - OS 621 17090 - Learning Unit Single - PWD - (95 SQM)	● Student Space (44)	