


VENTILATION AUDIT REPORT

SCHOOL:	Jilliby Public School (2236)
AMU REGION:	Hunter/Central Coast
STATE ELECTORATE:	Wyong
LOCAL GOVERNMENT AREA:	Central Coast

2236 - Jilliby Public School
Site Plan (12552)

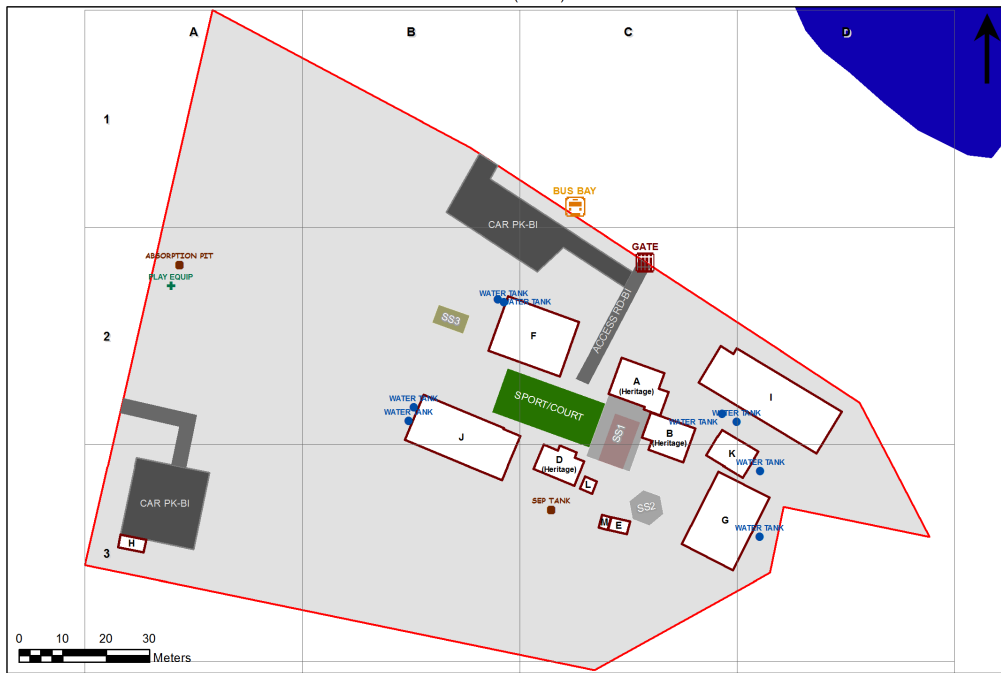

1:816

Printed: 01-May-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0002 - Reading Area - (11.5 SQM)	● Student Space (5)	
B00A - R0004 - Home Base - (43.71 SQM) - Teaching Space: 1	● Student Space (20)	
B00A - R0006 - Movement - (13.74 SQM)	Not Applicable	Circulation or storage space.
B00B - R0001 - Home Base - (44.87 SQM) - Teaching Space: 1	● Student Space (20)	
B00B - R0007 - Movement - (6.09 SQM)	Not Applicable	Circulation or storage space.
B00D - R0002 - Canteen - (11.47 SQM)	Not Applicable	Circulation or storage space.
B00F - R0002 - Practical Activities - 1hb - (19.41 SQM)	● Student Space (9)	
B00F - R0004 - Home Base - (59.24 SQM) - Teaching Space: 1	● Student Space (27)	
B00F - R0005 - Withdrawal Space - 2hb - (11.37 SQM)	● Student Space (5)	
B00F - R0006 - Home Base - (59.23 SQM) - Teaching Space: 1	● Student Space (27)	
B00F - R0008 - Practical Activities - 1hb - (19.42 SQM)	● Student Space (9)	
B00G - R0002 - Practical Activities - 1hb - (21.62 SQM)	● Student Space (10)	
B00G - R0004 - Home Base - (62.76 SQM) - Teaching Space: 1	● Student Space (29)	
B00G - R0005 - Withdrawal Space - 2hb - (10.84 SQM)	● Student Space (5)	
B00G - R0006 - Home Base - (62.77 SQM) - Teaching Space: 1	● Student Space (29)	
B00I - R0001 - Entry Vestibule - (23.21 SQM)	Not Applicable	Circulation or storage space.
B00I - R0002 - Movement - (55.81 SQM)	Not Applicable	Circulation or storage space.
B00I - R0003 - Clerical Office - (27.58 SQM)	● Office (6)	
B00I - R0004 - Clerical Office/Workroom - (23.87 SQM)	● Office (5)	
B00I - R0005 - Sick Bay - (9.06 SQM)	● Student Space (4)	
B00I - R0010 - Interview/Office - Type 3 - (16.85 SQM)	● Office (4)	
B00I - R0012 - Staff Room Annexe - (19.77 SQM)	● Office (4)	
B00I - R0013 - Staff Room - (49.05 SQM)	● Office (12)	
B00I - R0016 - Deputy Principal - Type 1 - (12.81 SQM)	● Office (3)	
B00I - R0017 - Principal - (17.38 SQM)	● Office (4)	
B00I - R0018 - Interview - (13.31 SQM)	● Office (3)	
B00J - R0001 - Reading Area - (168.33 SQM)	● Student Space (78)	