


VENTILATION AUDIT REPORT

SCHOOL:	Jugiong Public School (2245)
AMU REGION:	Southern NSW
STATE ELECTORATE:	Cootamundra
LOCAL GOVERNMENT AREA:	Hilltops



2245 - Jugiong Public School
Site Plan (10413)

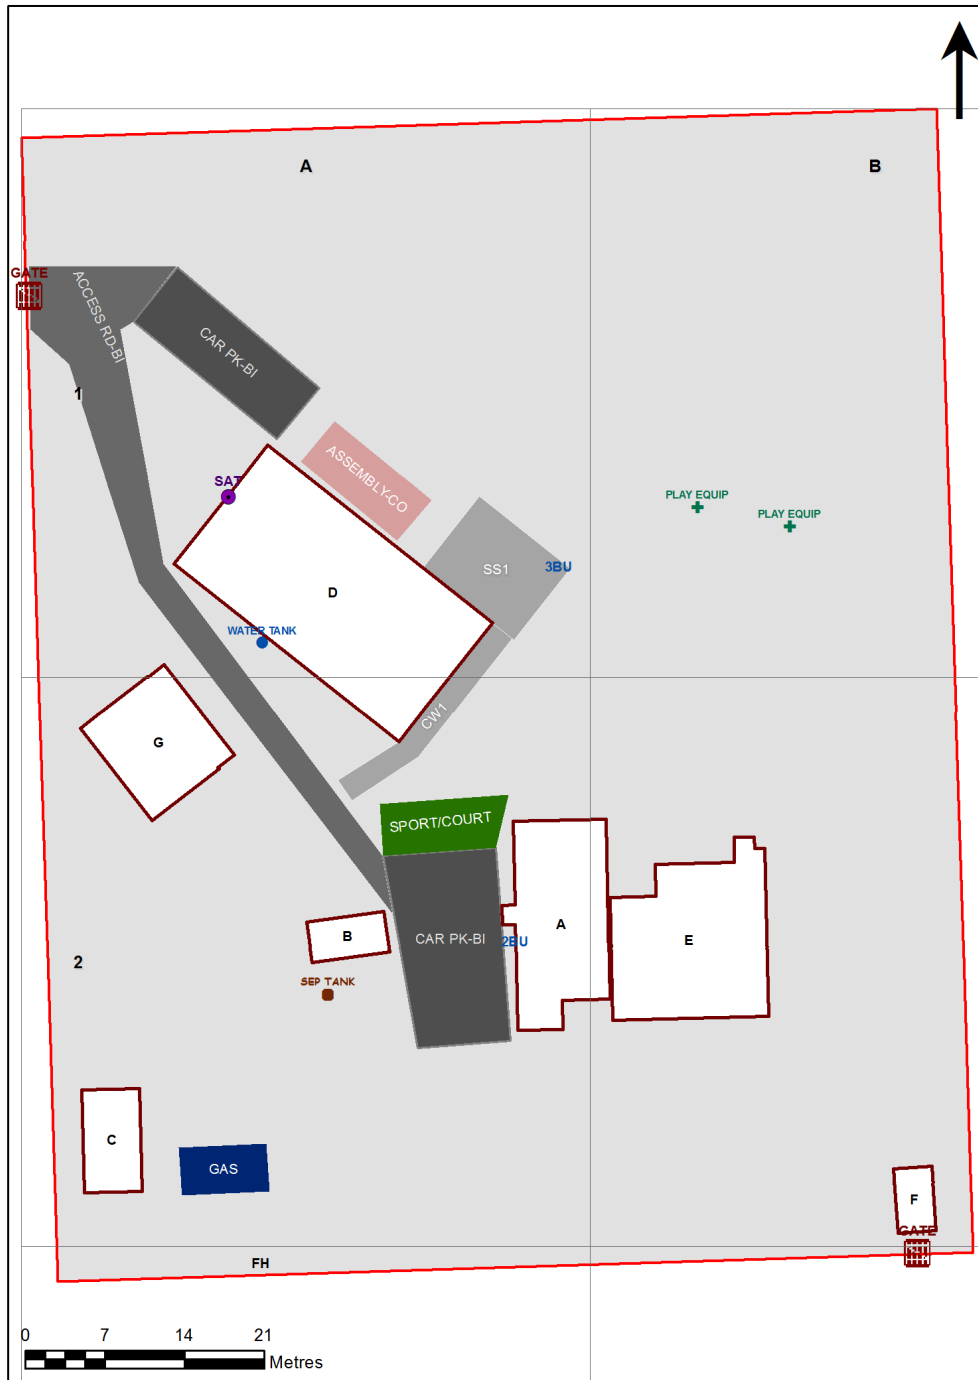












1:441

Printed: 30-Oct-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Reading Area - (46.92 SQM)	 Student Space (21)	
B00A - R0002 - Communal Space - (38.73 SQM)	 Student Space (17)	
B00A - R0005 - Movement - (8.39 SQM)	Not Applicable	Circulation or storage space.
B00D - R0001 - Movement - (43.53 SQM)	Not Applicable	Circulation or storage space.
B00D - R0005 - Principal - (17.41 SQM)	 Office (4)	
B00D - R0007 - Home Base - (86.92 SQM) - Teaching Space: 1	 Student Space (40)	
B00D - R0011 - Movement - (41.12 SQM)	Not Applicable	Circulation or storage space.
B00D - R0012 - Clerical Office - (10.52 SQM)	 Office (2)	
B00D - R0014 - Clerical Office - (10.78 SQM)	 Office (2)	
B00D - R0015 - Principal - (15.44 SQM)	 Office (3)	
B00D - R0016 - Withdrawal Space - 1hb - (27.41 SQM)	 Student Space (12)	
B00E - R0005 - Staff Kitchen - (15.11 SQM)	 Office (3)	
B00E - R0006 - Sick Bay - (15.59 SQM)	 Student Space (7)	
B00E - R0008 - Movement - (24.04 SQM)	Not Applicable	Circulation or storage space.
B00G - R0001 - Home Base - (59.86 SQM) - Teaching Space: 1	 Student Space (27)	