


VENTILATION AUDIT REPORT

SCHOOL:	Kahibah Public School (3874)
AMU REGION:	Hunter/Central Coast
STATE ELECTORATE:	Charlestown
LOCAL GOVERNMENT AREA:	Lake Macquarie

3874 - Kahibah Public School
Site Plan (11654)

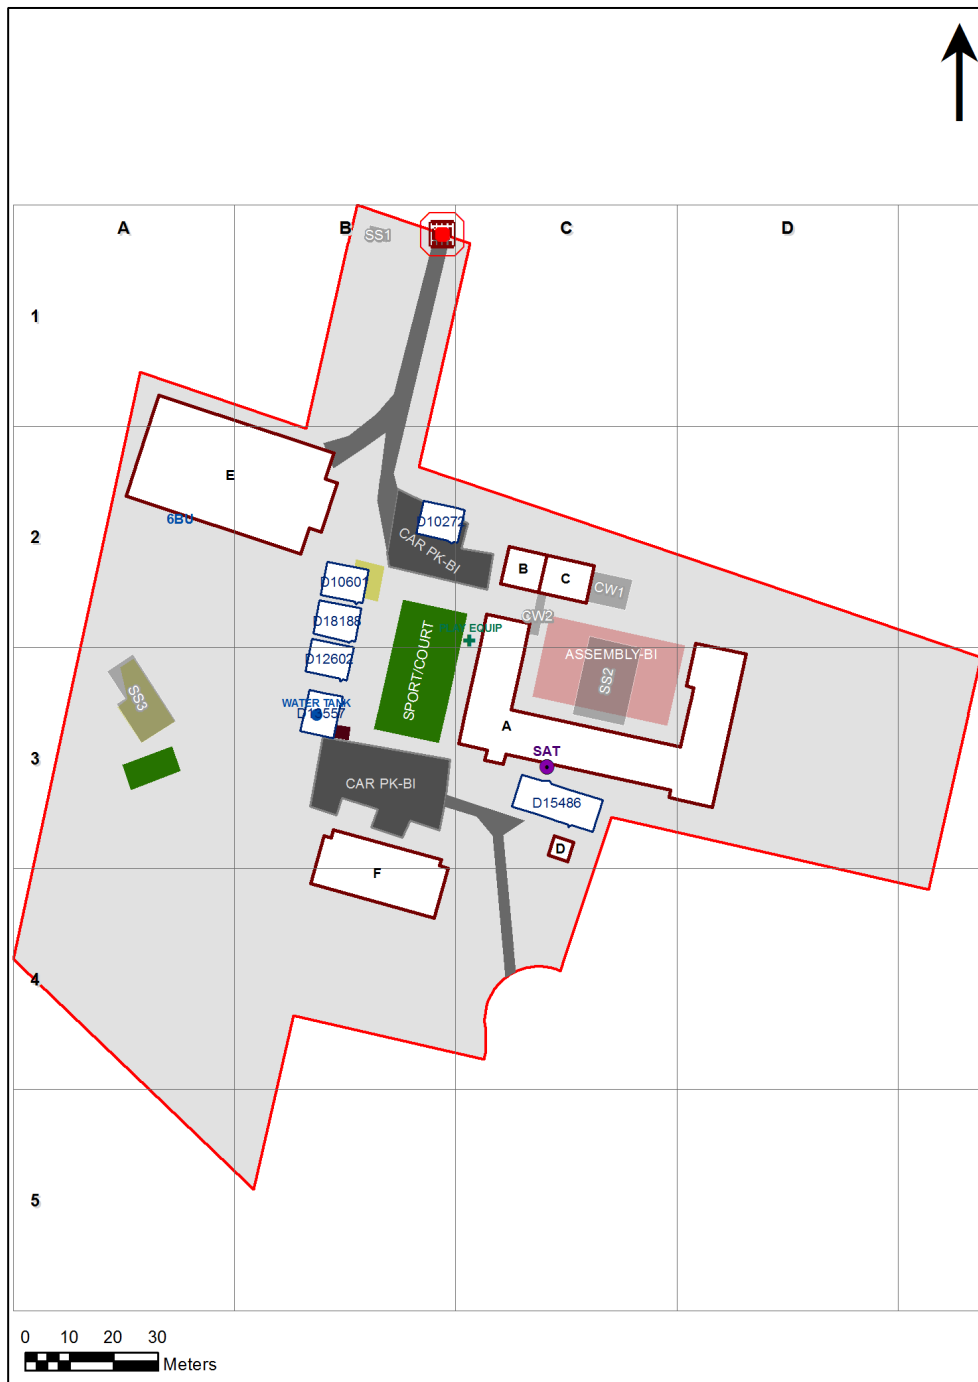

1:1,134

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0002 - Practical Activities - 1hb - (13.91 SQM)	● Student Space (6)	
B00A - R0003 - Home Base - (53.73 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0006 - Movement - (53.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R0007 - Home Base - (53.58 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0008 - Home Base - (53.36 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0009 - Home Base - (66.83 SQM) - Teaching Space: 1	● Student Space (31)	
B00A - R0010 - Practical Activities - 1hb - (12.72 SQM)	● Student Space (5)	
B00A - R0012 - Movement - (83.91 SQM)	Not Applicable	Circulation or storage space.
B00A - R0014 - Staff Room Annexe - (9.59 SQM)	● Office (2)	
B00A - R0016 - Home Base - (53.36 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0017 - Home Base - (53.36 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0020 - Home Base - (88.96 SQM) - Teaching Space: 1	● Student Space (41)	
B00A - R0024 - Clerical Office - (11.72 SQM)	● Office (2)	
B00A - R0025 - Entry Vestibule - (15.51 SQM)	Not Applicable	Circulation or storage space.
B00A - R0026 - Movement - (11.61 SQM)	Not Applicable	Circulation or storage space.
B00A - R0027 - Movement - (18.49 SQM)	Not Applicable	Circulation or storage space.
B00A - R0033 - Deputy Principal - (18.54 SQM)	● Office (4)	
B00A - R0036 - Movement - (29.95 SQM)	Not Applicable	Circulation or storage space.
B00A - R0037 - Home Base - (53.29 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0040 - Movement - (8.14 SQM)	Not Applicable	Circulation or storage space.
B00A - R0042 - Home Base - (53.29 SQM) - Teaching Space: 1	● Student Space (24)	
B00A - R0043 - Movement - (6.64 SQM)	Not Applicable	Circulation or storage space.
B00A - R9001 - Special Programs Room - (103.36 SQM)	● Student Space (47)	
B00A - R9008 - Movement - (15.91 SQM)	Not Applicable	Circulation or storage space.
B00B - R0001 - Movement - (34.62 SQM)	Not Applicable	Circulation or storage space.
B00B - R0003 - Canteen - (16.26 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Movement - (27.98 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Movement - (32.2 SQM)	Not Applicable	Circulation or storage space.
B00E - R0003 - Canteen - (38.24 SQM)	Not Applicable	Circulation or storage space.
B00E - R0008 - Movement - (71.41 SQM)	Not Applicable	Circulation or storage space.
B00E - R0009 - Communal Space - (656.59 SQM)	● Student Space (304)	
B00E - R0010 - Raised Platform - (161.64 SQM)	Not Applicable	Circulation or storage space.
B00F - R0006 - Reading Area - (167.77 SQM)	● Student Space (77)	
B00F - R0010 - Special Programs Room - (38.08 SQM)	● Student Space (17)	
OS 502 15486 - OS 502 15486 - Admin Staff/Principal/Clerk/Dup/Clinic - (152 SQM)	● Office (38)	
OS 601 10272 - OS 601 10272 - Learning Unit - Standard/Withdrawal - (76 SQM)	● Student Space (35)	
OS 602 10601 - OS 602 10601 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 602 13557 - OS 602 13557 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 603 12602 - OS 603 12602 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	● Student Space (35)	
OS 603 18188 - OS 603 18188 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	● Student Space (35)	