


VENTILATION AUDIT REPORT

SCHOOL:	Kogarah High School (8320)
AMU REGION:	Sydney
STATE ELECTORATE:	Kogarah
LOCAL GOVERNMENT AREA:	Georges River

8320 - Kogarah High School
Site Plan (12590)



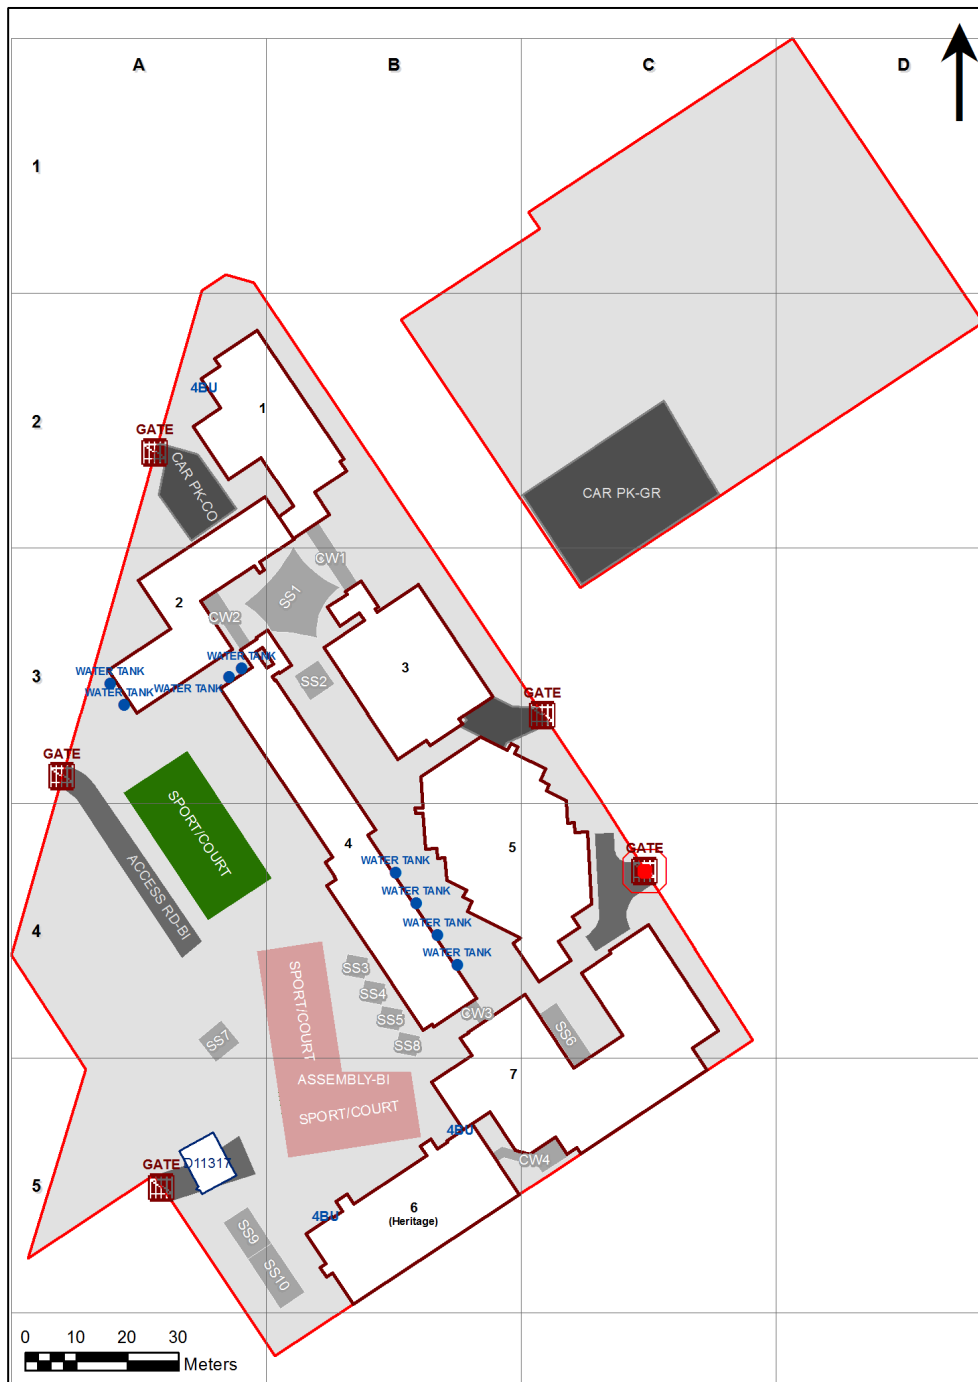

































1:984

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B001 - R0003 - Materials Technology L.S. - (82.48 SQM) - Teaching Space: 1	 Student Space (38)	
B001 - R0004 - Welding Area - (16.03 SQM)	Not Applicable	Circulation or storage space.
B001 - R0006 - Materials Technology L.S. - (83.02 SQM) - Teaching Space: 1	 Student Space (38)	
B001 - R0008 - Art Learning Space - (63.58 SQM) - Teaching Space: 1	 Student Space (29)	
B001 - R0012 - Movement - (68.81 SQM)	Not Applicable	Circulation or storage space.
B001 - R1004 - Materials Technology L.S. - (82.57 SQM) - Teaching Space: 1	 Student Space (38)	
B001 - R1008 - Materials Technology L.S. - (82.84 SQM) - Teaching Space: 1	 Student Space (38)	
B001 - R1013 - Staff Study - (25.7 SQM)	 Office (6)	
B001 - R1014 - Staff Study - (26.37 SQM)	 Office (6)	
B001 - R1015 - Movement - (74.11 SQM)	Not Applicable	Circulation or storage space.
B001 - R2002 - Art Learning Space - (65.67 SQM) - Teaching Space: 1	 Student Space (30)	
B001 - R2003 - Art Learning Space - (67.13 SQM) - Teaching Space: 1	 Student Space (31)	
B001 - R2005 - Art Learning Space - (52.43 SQM) - Teaching Space: 1	 Student Space (24)	
B001 - R2006 - Design L.S. - (65.39 SQM) - Teaching Space: 1	 Student Space (30)	
B001 - R2007 - Design L.S. - (28.41 SQM) - Teaching Space: 1	 Student Space (13)	
B001 - R2008 - Computer Learning Space - (57.48 SQM) - Teaching Space: 1	 Student Space (26)	
B001 - R2009 - Movement - (65.76 SQM)	Not Applicable	Circulation or storage space.
B001 - R2010 - Movement - (36.2 SQM)	Not Applicable	Circulation or storage space.
B002 - R0001 - Laboratory L.S. - (101.48 SQM) - Teaching Space: 1	 Student Space (47)	
B002 - R0002 - Preparation - (29.01 SQM)	Not Applicable	Circulation or storage space.
B002 - R0004 - Laboratory L.S. - (93.61 SQM) - Teaching Space: 1	 Student Space (43)	
B002 - R0007 - Laboratory L.S. - (99.25 SQM) - Teaching Space: 1	 Student Space (46)	
B002 - R0009 - Preparation - (26.43 SQM)	Not Applicable	Circulation or storage space.
B002 - R0011 - Staff Study - (26.32 SQM)	 Office (6)	
B002 - R0013 - Movement - (59.98 SQM)	Not Applicable	Circulation or storage space.
B002 - R1001 - General Learning Space - (52.72 SQM) - Teaching Space: 1	 Student Space (24)	
B002 - R1002 - General Learning Space - (52.79 SQM) - Teaching Space: 1	 Student Space (24)	
B002 - R1003 - General Learning Space - (52.79 SQM) - Teaching Space: 1	 Student Space (24)	
B002 - R1004 - General Learning Space - (53.23 SQM) - Teaching Space: 1	 Student Space (24)	
B002 - R1007 - Seminar - Type 1 - (26.65 SQM)	 Office (6)	
B002 - R1009 - Staff Study - (51.69 SQM)	 Office (12)	
B002 - R1010 - General Learning Space - (67.5 SQM) - Teaching Space: 1	 Student Space (31)	
B002 - R1011 - Movement - (100.64 SQM)	Not Applicable	Circulation or storage space.
B003 - M1002 - Senior Seminar - (14.8 SQM)	 Office (3)	
B003 - M1004 - Main Area - (69.21 SQM)	Not Applicable	Circulation or storage space.
B003 - M1005 - Seminar - (38.36 SQM)	 Office (9)	
B003 - R0001 - Laboratory L.S. - (90.86 SQM) - Teaching Space: 1	 Student Space (42)	
B003 - R0004 - Laboratory L.S. - (91.05 SQM) - Teaching Space: 1	 Student Space (42)	
B003 - R0005 - General Learning Space - (82.97 SQM) - Teaching Space: 1	 Student Space (38)	
B003 - R0006 - Staff Study - (7.73 SQM)	 Office (1)	
B003 - R0007 - Staff Study - (10.32 SQM)	 Office (2)	
B003 - R0008 - Preparation - (37.17 SQM)	Not Applicable	Circulation or storage space.
B003 - R0009 - Laboratory L.S. - (90.49 SQM) - Teaching Space: 1	 Student Space (41)	
B003 - R0012 - Movement - (40.34 SQM)	Not Applicable	Circulation or storage space.
B003 - R0013 - Pupil Entry - (28.24 SQM)	Not Applicable	Circulation or storage space.
B003 - R0017 - Preparation - (48.78 SQM)	Not Applicable	Circulation or storage space.
B003 - R1001 - Seminar - (12.87 SQM)	 Office (3)	
B003 - R1002 - Seminar - (12.33 SQM)	 Office (3)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B003 - R1006 - Seminar - (12.99 SQM)	Office (3)	
B003 - R1007 - Seminar - (13.59 SQM)	Office (3)	
B003 - R1008 - Main Area - (327.18 SQM)	Not Applicable	Circulation or storage space.
B003 - R1009 - Audio Visual Workroom - (28.5 SQM)	Student Space (13)	
B003 - R1011 - Workroom - (17.79 SQM)	Office (4)	
B003 - R1015 - Seminar - (71.15 SQM)	Office (17)	
B004 - R0006 - Food/Research Space - (13.22 SQM)	Not Applicable	Circulation or storage space.
B004 - R0007 - Food/Research Space - (12.68 SQM)	Not Applicable	Circulation or storage space.
B004 - R0008 - Food/Research Space - (66.91 SQM)	Not Applicable	Circulation or storage space.
B004 - R0014 - Music Learning Space - (83.3 SQM) - Teaching Space: 1	Student Space (38)	
B004 - R0016 - Administration - Clerical - (61.03 SQM)	Office (15)	
B004 - R0017 - Computer Learning Space - (49.11 SQM) - Teaching Space: 1	Student Space (22)	
B004 - R0022 - Movement - (169.94 SQM)	Not Applicable	Circulation or storage space.
B004 - R0027 - Food Technology L.S. - (88.18 SQM) - Teaching Space: 1	Student Space (40)	
B004 - R0030 - Movement - (6.45 SQM)	Not Applicable	Circulation or storage space.
B004 - R0032 - Movement - (6.71 SQM)	Not Applicable	Circulation or storage space.
B004 - R1004 - Staff Study - (26.14 SQM)	Office (6)	
B004 - R1005 - Design L.S. - (66.41 SQM) - Teaching Space: 1	Student Space (30)	
B004 - R1009 - Design L.S. - (67.11 SQM) - Teaching Space: 1	Student Space (31)	
B004 - R1012 - General Learning Space - (52.94 SQM) - Teaching Space: 1	Student Space (24)	
B004 - R1013 - General Learning Space - (53.31 SQM) - Teaching Space: 1	Student Space (24)	
B004 - R1014 - General Learning Space - (53.46 SQM) - Teaching Space: 1	Student Space (24)	
B004 - R1015 - Staff Study - (25.2 SQM)	Office (6)	
B004 - R1016 - Staff Study - (13 SQM)	Office (3)	
B004 - R1017 - Staff Study - (12.75 SQM)	Office (3)	
B004 - R1022 - Movement - (177.02 SQM)	Not Applicable	Circulation or storage space.
B004 - R1026 - Movement - (22.18 SQM)	Not Applicable	Circulation or storage space.
B004 - R1027 - Movement - (6.5 SQM)	Not Applicable	Circulation or storage space.
B004 - R1028 - Movement - (6.45 SQM)	Not Applicable	Circulation or storage space.
B005 - R0005 - Movement - (73.48 SQM)	Not Applicable	Circulation or storage space.
B005 - R0006 - Student Canteen - (17.61 SQM)	Not Applicable	Circulation or storage space.
B005 - R0008 - Multi-Purpose Space - (455.93 SQM)	Student Space (211)	
B005 - R0010 - Movement - (7.79 SQM)	Not Applicable	Circulation or storage space.
B005 - R0011 - Stage - (117.26 SQM)	Not Applicable	Circulation or storage space.
B005 - R0012 - Movement - (7.55 SQM)	Not Applicable	Circulation or storage space.
B005 - R1004 - Movement - (6.51 SQM)	Not Applicable	Circulation or storage space.
B006 - R0004 - General Learning Space - (48.74 SQM) - Teaching Space: 1	Student Space (22)	
B006 - R0005 - General Learning Space - (48.48 SQM) - Teaching Space: 1	Student Space (22)	
B006 - R0008 - Staff Study - (47.63 SQM)	Office (11)	
B006 - R0009 - General Learning Space - (48.2 SQM) - Teaching Space: 1	Student Space (22)	
B006 - R0010 - General Learning Space - (47.62 SQM) - Teaching Space: 1	Student Space (22)	
B006 - R0011 - Interview/Office - Type 1 - (12.66 SQM)	Office (3)	
B006 - R0013 - Administration - Clerical - (28.3 SQM)	Office (7)	
B006 - R0014 - Staff Kitchen - (15.22 SQM)	Office (3)	
B006 - R0015 - Staff Study - (19.75 SQM)	Office (4)	
B006 - R0017 - Computer Room - (14.95 SQM)	Student Space (6)	
B006 - R0018 - Entry - (18.77 SQM)	Not Applicable	Circulation or storage space.
B006 - R0019 - Movement - (138.23 SQM)	Not Applicable	Circulation or storage space.
B006 - R0024 - Staff Study - (14.83 SQM)	Office (3)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B006 - R1001 - Movement - (120.76 SQM)	Not Applicable	Circulation or storage space.
B006 - R1002 - General Learning Space - (48.96 SQM) - Teaching Space: 1	● Student Space (22)	
B006 - R1003 - General Learning Space - (49.69 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R1004 - Computer Learning Space - (50.03 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R1005 - General Learning Space - (49.77 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R1006 - General Learning Space - (49.02 SQM) - Teaching Space: 1	● Student Space (22)	
B006 - R1008 - Staff Study - (26.44 SQM)	○ Office (6)	
B006 - R1009 - General Learning Space - (45.96 SQM) - Teaching Space: 1	● Student Space (21)	
B006 - R1010 - Staff Study - (71.96 SQM)	○ Office (17)	
B006 - R2005 - General Learning Space - (49.77 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R2006 - General Learning Space - (49.77 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R2007 - Special Learning Space - (50.79 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R2008 - General Learning Space - (50.78 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R2009 - Art Learning Space-I.E.C. - (50.73 SQM) - Teaching Space: 1	● Student Space (23)	
B006 - R2010 - Movement - (111.45 SQM)	Not Applicable	Circulation or storage space.
B006 - R2013 - Special Learning Space - (41.98 SQM) - Teaching Space: 1	● Student Space (19)	
B006 - R2014 - General Learning Space-I.E.C. - (30.62 SQM) - Teaching Space: 1	● Student Space (14)	
B006 - R2015 - Special Learning Space - (40.7 SQM) - Teaching Space: 1	● Student Space (18)	
B007 - R0001 - Duplicating Workroom - (26.72 SQM)	○ Office (6)	
B007 - R0003 - Administration - Clerical - (34.29 SQM)	○ Office (8)	
B007 - R0004 - Movement - (20.55 SQM)	Not Applicable	Circulation or storage space.
B007 - R0007 - Ancillary Staff - (24.45 SQM)	○ Office (6)	
B007 - R0008 - Movement - (12.98 SQM)	Not Applicable	Circulation or storage space.
B007 - R0010 - Principal Office - (20.71 SQM)	○ Office (5)	
B007 - R0012 - Movement - (38.66 SQM)	Not Applicable	Circulation or storage space.
B007 - R0014 - Clinic - Boys - (14.65 SQM)	○ Office (3)	
B007 - R0016 - Duplicating Workroom - (11.68 SQM)	○ Office (2)	
B007 - R0018 - Deputy Principal Office - (15.75 SQM)	○ Office (3)	
B007 - R0019 - Gymnasium - (287.36 SQM)	● Student Space (133)	
B007 - R0020 - Stage - (58.77 SQM)	Not Applicable	Circulation or storage space.
B007 - R0022 - Movement - (21.07 SQM)	Not Applicable	Circulation or storage space.
B007 - R0030 - Student Canteen - (67.66 SQM)	Not Applicable	Circulation or storage space.
B007 - R1001 - Commonroom - (122.61 SQM)	○ Office (30)	
B007 - R1002 - Staff Study - (11.9 SQM)	○ Office (2)	
B007 - R1003 - Interview/Office - Type 1 - (11.82 SQM)	○ Office (2)	
B007 - R1004 - Interview/Office - Type 1 - (11.76 SQM)	○ Office (2)	
B007 - R1008 - Movement - (34.33 SQM)	Not Applicable	Circulation or storage space.
B007 - R1013 - Movement - (62.11 SQM)	Not Applicable	Circulation or storage space.
B007 - R1017 - Staff Study - (7.7 SQM)	○ Office (1)	
B007 - R1018 - Staff Study - (9.23 SQM)	○ Office (2)	
B007 - R2001 - Staff Study - (28.44 SQM)	○ Office (7)	
B007 - R2003 - General Learning Space - (53.08 SQM) - Teaching Space: 1	● Student Space (24)	
B007 - R2004 - General Learning Space - (54.04 SQM) - Teaching Space: 1	● Student Space (25)	
B007 - R2005 - General Learning Space - (51.03 SQM) - Teaching Space: 1	● Student Space (23)	
B007 - R2006 - General Learning Space - (52.15 SQM) - Teaching Space: 1	● Student Space (24)	
B007 - R2007 - General Learning Space - (51.07 SQM) - Teaching Space: 1	● Student Space (23)	
B007 - R2009 - Movement - (49.4 SQM)	Not Applicable	Circulation or storage space.
OS 601 11317 - OS 601 11317 - Learning Unit - Standard/Withdrawal - (76 SQM)	● Student Space (35)	