


VENTILATION AUDIT REPORT

SCHOOL:	Kyogle Public School (2349)
AMU REGION:	North Coast
STATE ELECTORATE:	Lismore
LOCAL GOVERNMENT AREA:	Kyogle

2349 - Kyogle Public School
Site Plan (12608)

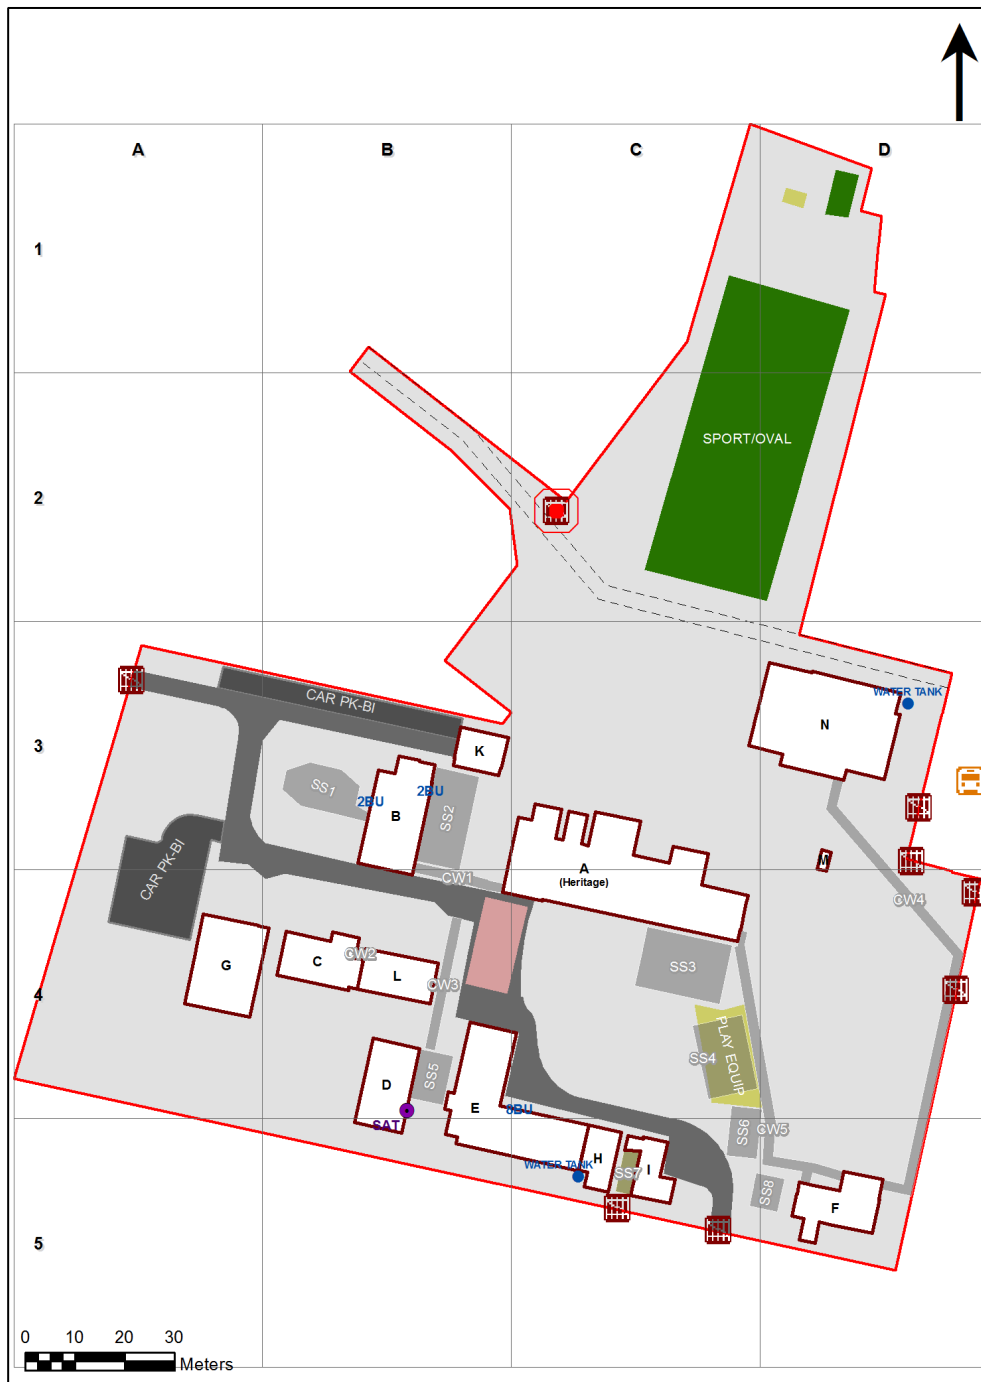

1:1,008

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Home Base - (93.28 SQM) - Teaching Space: 1	● Student Space (43)	
B00A - R0002 - Withdrawal Space - 1hb - (7.5 SQM)	● Student Space (3)	
B00A - R0004 - Staff Room - (49.55 SQM)	○ Office (12)	
B00A - R0005 - Seminar/Study - (46.75 SQM)	○ Office (11)	
B00A - R0006 - Reading Area - (72.6 SQM)	● Student Space (33)	
B00A - R0010 - Clerical Office - (29.94 SQM)	○ Office (7)	
B00A - R0014 - Principal - (15.73 SQM)	○ Office (3)	
B00A - R0015 - Deputy Principal - (14.25 SQM)	○ Office (3)	
B00A - R0020 - Sick Bay - (10.19 SQM)	● Student Space (4)	
B00A - R0022 - Interview - (18.72 SQM)	○ Office (4)	
B00A - R0023 - Movement - (80.64 SQM)	Not Applicable	Circulation or storage space.
B00A - R0024 - Movement - (35.07 SQM)	Not Applicable	Circulation or storage space.
B00B - R0003 - Canteen - (23.98 SQM)	Not Applicable	Circulation or storage space.
B00B - R0009 - Movement - (104.96 SQM)	Not Applicable	Circulation or storage space.
B00B - R0010 - Movement - (9.36 SQM)	Not Applicable	Circulation or storage space.
B00B - R1002 - Home Base - (55.88 SQM) - Teaching Space: 1	● Student Space (25)	
B00B - R1003 - Practical Activities - 1hb - (19.78 SQM)	● Student Space (9)	
B00B - R1004 - Practical Activities - 1hb - (19.79 SQM)	● Student Space (9)	
B00B - R1005 - Home Base - (55.64 SQM) - Teaching Space: 1	● Student Space (25)	
B00C - R0001 - Practical Activities - 1hb - (16.92 SQM)	● Student Space (7)	
B00C - R0002 - Home Base - (43.99 SQM) - Teaching Space: 1	● Student Space (20)	
B00C - R0003 - Practical Activities - 1hb - (16.73 SQM)	● Student Space (7)	
B00C - R0004 - Home Base - (43.86 SQM) - Teaching Space: 1	● Student Space (20)	
B00D - R0001 - Seminar/Study - (14.49 SQM)	○ Office (3)	
B00D - R0004 - Movement - (6.65 SQM)	Not Applicable	Circulation or storage space.
B00D - R0006 - Practical Activities - 1hb - (5.01 SQM)	● Student Space (2)	
B00D - R0007 - Home Base - (74.97 SQM) - Teaching Space: 1	● Student Space (34)	
B00D - R0008 - Home Base - (31.66 SQM) - Teaching Space: 1	● Student Space (14)	
B00E - R0001 - Movement - (47.15 SQM)	Not Applicable	Circulation or storage space.
B00E - R0002 - Withdrawal Space - 1hb - (13.41 SQM)	● Student Space (6)	
B00E - R0004 - Home Base - (46.02 SQM) - Teaching Space: 1	● Student Space (21)	
B00E - R0006 - Home Base - (47.35 SQM) - Teaching Space: 1	● Student Space (21)	
B00E - R0007 - Deputy Principal - (12.82 SQM)	○ Office (3)	
B00E - R0008 - Home Base - (47.13 SQM) - Teaching Space: 1	● Student Space (21)	
B00E - R0009 - Interview - (11.04 SQM)	○ Office (2)	
B00E - R0010 - Home Base - (47.26 SQM) - Teaching Space: 1	● Student Space (21)	
B00E - R0011 - Movement - (47.93 SQM)	Not Applicable	Circulation or storage space.
B00E - R0012 - Withdrawal Space - 1hb - (23.5 SQM)	● Student Space (10)	
B00E - R0013 - Withdrawal Space - 1hb - (22.91 SQM)	● Student Space (10)	
B00F - R0001 - Practical Activities - 1hb - (9.81 SQM)	● Student Space (4)	
B00F - R0002 - Home Base - (82.01 SQM) - Teaching Space: 1	● Student Space (38)	
B00F - R0003 - Staff Room Annexe - (6.79 SQM)	○ Office (1)	
B00F - R9001 - Special Programs Room - (52.65 SQM)	● Student Space (24)	
B00G - R0002 - Practical Activities - 1hb - (14.25 SQM)	● Student Space (6)	
B00G - R0003 - Home Base - (60.02 SQM) - Teaching Space: 1	● Student Space (27)	
B00G - R0004 - Movement - (14.51 SQM)	Not Applicable	Circulation or storage space.
B00G - R0005 - Withdrawal Space - 1hb - (11.54 SQM)	● Student Space (5)	
B00G - R0008 - Practical Activities - 1hb - (14.22 SQM)	● Student Space (6)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00G - R0009 - Home Base - (60.06 SQM) - Teaching Space: 1	● Student Space (27)	
B00G - R0010 - Movement - (14.6 SQM)	Not Applicable	Circulation or storage space.
B00I - R0011 - Special Programs Room - (36.1 SQM)	● Student Space (16)	
B00L - R0002 - Home Base - (46.97 SQM) - Teaching Space: 1	● Student Space (21)	
B00L - R0003 - Practical Activities - 1hb - (11.1 SQM)	● Student Space (5)	
B00L - R0004 - Home Base - (46.97 SQM) - Teaching Space: 1	● Student Space (21)	
B00L - R0005 - Movement - (8.07 SQM)	Not Applicable	Circulation or storage space.
B00N - R0001 - Communal Space - (238.64 SQM)	● Student Space (110)	