


VENTILATION AUDIT REPORT

SCHOOL:	Lindfield Learning Village (4658)
AMU REGION:	Northern Sydney
STATE ELECTORATE:	Davidson
LOCAL GOVERNMENT AREA:	Ku-Ring-Gai

4658 - Lindfield Learning Village
Site Plan (14771)

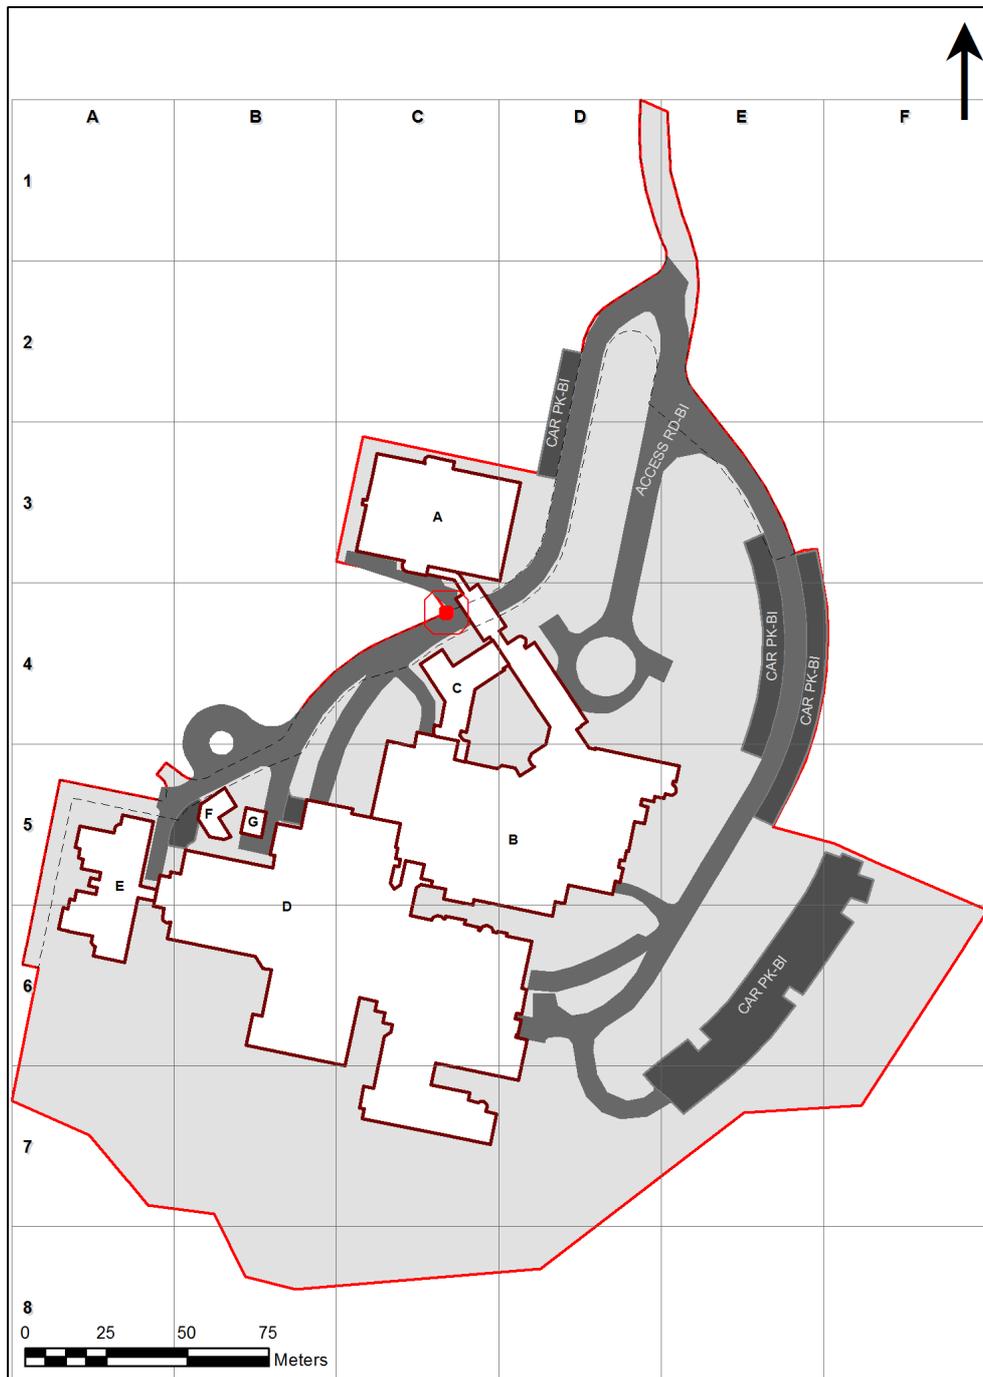

1:1,553

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
A - 4.1 - Gymnasium - (559.17 SQM)	● Student Space (259)	
A - 4.11 - Movement - (17.35 SQM)	Not Applicable	Circulation or storage space.
A - 4.12 - Movement - (14 SQM)	Not Applicable	Circulation or storage space.
A - 4.16 - Movement - (16.95 SQM)	Not Applicable	Circulation or storage space.
A - 5.15 - Movement - (140.95 SQM)	Not Applicable	Circulation or storage space.
A - 5.3 - Workshop - (123.03 SQM)	● Student Space (57)	
A - 5.4 - Kitchen - Type 1 - (139.74 SQM)	● Student Space (64)	
A - 5.6 - Preparation - (20.13 SQM)	Not Applicable	Circulation or storage space.
A - 6.2 - Preparation - Science - (61.46 SQM)	Not Applicable	Circulation or storage space.
A - 6.3 - Science Laboratory - (165.5 SQM)	● Student Space (76)	
A - 6.4 - Movement - (89.96 SQM)	Not Applicable	Circulation or storage space.
B - 4.15 - Multi-Purpose Space - (85.65 SQM)	● Student Space (39)	
B - 4.16 - Movement - (42.94 SQM)	Not Applicable	Circulation or storage space.
B - 4.17 - Movement - (117.09 SQM)	Not Applicable	Circulation or storage space.
B - 5.10 - Student Reception - (11.43 SQM)	Not Applicable	Circulation or storage space.
B - 5.16 - Administration - Clerical - (12.8 SQM)	● Office (3)	
B - 5.17 - Clinic - Girls - (14.72 SQM)	● Office (3)	
B - 5.18 - Clinic - Boys - (15.13 SQM)	● Office (3)	
B - 5.2 - Principal - (20.09 SQM)	● Office (5)	
B - 5.25 - Canteen - (27.32 SQM)	Not Applicable	Circulation or storage space.
B - 5.28 - Visual Arts Workshop - (96.87 SQM)	● Student Space (44)	
B - 5.30 - Movement - (594.05 SQM)	Not Applicable	Circulation or storage space.
B - 5.38 - Administration - Clerical - (18.73 SQM)	● Office (4)	
B - 5.39 - Movement - (71.33 SQM)	Not Applicable	Circulation or storage space.
B - 5.4 - Deputy Principal - (12.56 SQM)	● Office (3)	
B - 5.40 - Public Entry - (29.66 SQM)	Not Applicable	Circulation or storage space.
B - 5.41 - Tea Room - (6.29 SQM)	Not Applicable	Circulation or storage space.
B - 5.42 - Movement - (8.5 SQM)	Not Applicable	Circulation or storage space.
B - 5.45 - Movement - (46.43 SQM)	Not Applicable	Circulation or storage space.
B - 5.46 - Study Space - (50.84 SQM)	Not Applicable	Circulation or storage space.
B - 5.47 - Canteen - (110.26 SQM)	Not Applicable	Circulation or storage space.
B - 5.48 - Staff Study - (149.65 SQM)	● Office (37)	
B - 5.49 - Movement - (21.63 SQM)	Not Applicable	Circulation or storage space.
B - 5.5 - Deputy Principal - (12.67 SQM)	● Office (3)	
B - 5.52 - Staff Kitchen - (8.83 SQM)	● Office (2)	
B - 5.53 - Staff Room - (65.27 SQM)	● Office (16)	
B - 5.57 - Movement - (71.02 SQM)	Not Applicable	Circulation or storage space.
B - 5.58 - Movement - (16.1 SQM)	Not Applicable	Circulation or storage space.
B - 5.6 - Administration - Executive - (13.09 SQM)	● Office (3)	
B - 5.62 - Movement - (11.1 SQM)	Not Applicable	Circulation or storage space.
B - 5.7 - Interview - (13.3 SQM)	● Office (3)	
B - 5.8 - Interview - (11.07 SQM)	● Office (2)	
B - 5.9 - Public Reception - (16.69 SQM)	Not Applicable	Circulation or storage space.
B - 6.12 - Withdrawal Space - 1hb - (13.45 SQM)	● Student Space (6)	
B - 6.13 - Home Base - (68.04 SQM) - Teaching Space: 1	● Student Space (31)	
B - 6.14 - Home Base - (60.09 SQM) - Teaching Space: 1	● Student Space (27)	
B - 6.15 - Withdrawal Space - 1hb - (10.23 SQM)	● Student Space (4)	
B - 6.16 - Practical Activities - (15.33 SQM)	● Student Space (7)	
B - 6.2 - Home Base X2 - (81.6 SQM) - Teaching Space: 2	● Student Space (37)	
B - 6.26 - Practical Activities - (49.56 SQM)	● Student Space (22)	
B - 6.29 - Practical Activities - (34.41 SQM)	● Student Space (15)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B - 6.3 - Withdrawal Space - 2hb - (12.62 SQM)	● Student Space (5)	
B - 6.31 - Home Base - (35.84 SQM) - Teaching Space: 1	● Student Space (16)	
B - 6.32 - Practical Activities - 1hb - (39.16 SQM)	● Student Space (18)	
B - 6.33 - Movement - (46.39 SQM)	Not Applicable	Circulation or storage space.
B - 6.34 - Practical Activities - 1hb - (27.64 SQM)	● Student Space (12)	
B - 6.36 - Movement - (198.71 SQM)	Not Applicable	Circulation or storage space.
B - 6.39 - Practical Activities - (25.12 SQM)	● Student Space (11)	
B - 6.8 - Home Base - (55.95 SQM) - Teaching Space: 1	● Student Space (25)	
B - 6.9 - Withdrawal Space - 1hb - (9.69 SQM)	● Student Space (4)	
C - 4.14 - Home Base X3 - (233.36 SQM) - Teaching Space: 3	● Student Space (108)	
C - 4.15 - Movement - (17.08 SQM)	Not Applicable	Circulation or storage space.
C - 4.7 - Withdrawal Space - 2hb - (14.53 SQM)	● Student Space (6)	
C - 5.12 - Home Base X3 - (256.45 SQM) - Teaching Space: 3	● Student Space (118)	
C - 5.13 - Movement - (10.26 SQM)	Not Applicable	Circulation or storage space.
C - 5.5 - Withdrawal Space - 2hb - (14.06 SQM)	● Student Space (6)	
C - 5.9 - Movement - (14.74 SQM)	Not Applicable	Circulation or storage space.
C - 6.10 - Movement - (15.02 SQM)	Not Applicable	Circulation or storage space.
C - 6.11 - Home Base X3 - (244.02 SQM) - Teaching Space: 3	● Student Space (113)	
C - 6.12 - Practical Activities - 3hb - (32.85 SQM)	● Student Space (15)	
C - 6.14 - Movement - (10.18 SQM)	Not Applicable	Circulation or storage space.
C - 6.15 - Withdrawal Space - 2hb - (19.35 SQM)	● Student Space (8)	
D - 4.1 - Music Learning Space - (105.62 SQM) - Teaching Space: 1	● Student Space (49)	
D - 4.10 - Practice/Seminar - (5.81 SQM)	Not Applicable	Circulation or storage space.
D - 4.11 - Practice/Seminar - (11.66 SQM)	Not Applicable	Circulation or storage space.
D - 4.12 - Practice/Seminar - (6.72 SQM)	Not Applicable	Circulation or storage space.
D - 4.13 - Practice/Seminar - (5.92 SQM)	Not Applicable	Circulation or storage space.
D - 4.14 - Practice/Seminar - (5.49 SQM)	Not Applicable	Circulation or storage space.
D - 4.15 - Practice/Seminar - (5.72 SQM)	Not Applicable	Circulation or storage space.
D - 4.16 - Practice/Seminar - (5.46 SQM)	Not Applicable	Circulation or storage space.
D - 4.17 - Practice/Seminar - (5.38 SQM)	Not Applicable	Circulation or storage space.
D - 4.2 - Music Learning Space - (105.66 SQM) - Teaching Space: 1	● Student Space (49)	
D - 4.4 - Movement - (62.78 SQM)	Not Applicable	Circulation or storage space.
D - 4.6 - Practice/Seminar - (5.66 SQM)	Not Applicable	Circulation or storage space.
D - 4.7 - Practice/Seminar - (5.66 SQM)	Not Applicable	Circulation or storage space.
D - 4.8 - Practice/Seminar - (5.9 SQM)	Not Applicable	Circulation or storage space.
D - 4.9 - Practice/Seminar - (5.72 SQM)	Not Applicable	Circulation or storage space.