


VENTILATION AUDIT REPORT

SCHOOL:	Macksville High School (8162)
AMU REGION:	North Coast
STATE ELECTORATE:	Oxley
LOCAL GOVERNMENT AREA:	Nambucca

8162 - Macksville High School
Site Plan (12784)

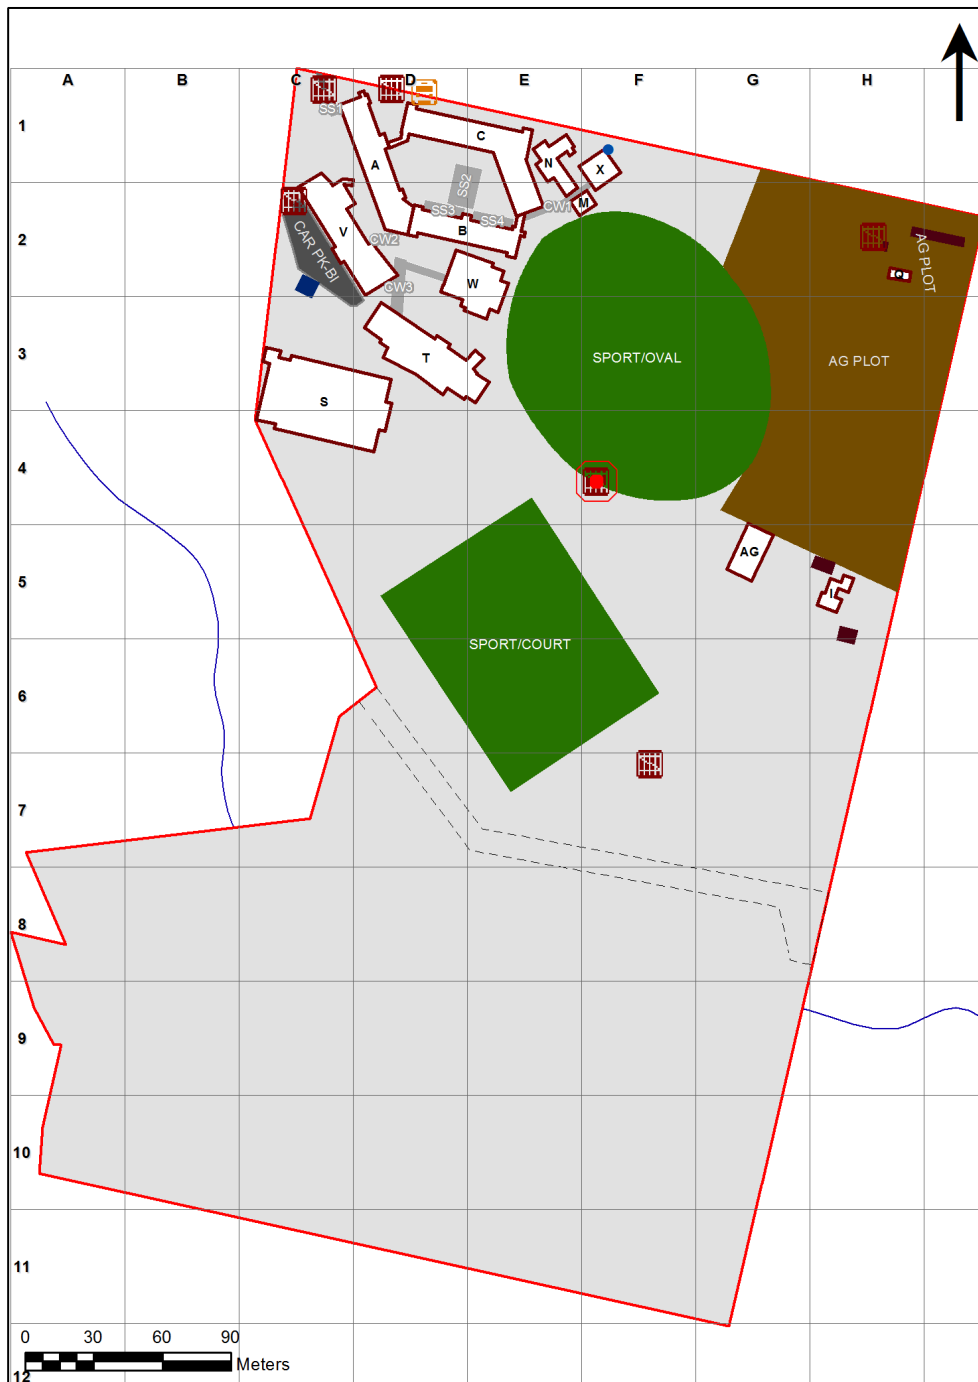

1:2,197

Printed: 21-Mar-2020




Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Movement - (21.49 SQM)	Not Applicable	Circulation or storage space.
B00A - R0017 - Movement - (22.41 SQM)	Not Applicable	Circulation or storage space.
B00A - R0018 - Public Entry - (16.64 SQM)	Not Applicable	Circulation or storage space.
B00A - R0019 - Administration - Clerical - (48.72 SQM)	Office (12)	
B00A - R0021 - Clinic - Girls - (11.86 SQM)	Office (2)	
B00A - R0022 - Clinic - Boys - (11.74 SQM)	Office (2)	
B00A - R0025 - Movement - (15.75 SQM)	Not Applicable	Circulation or storage space.
B00A - R0026 - Public Entry - (22.07 SQM)	Not Applicable	Circulation or storage space.
B00A - R0027 - Interview/Office - Type 1 - (13.03 SQM)	Office (3)	
B00A - R0028 - Duplicating Workroom - (27.79 SQM)	Office (6)	
B00A - R0030 - Interview/Office - Type 1 - (9.96 SQM)	Office (2)	
B00A - R0033 - Deputy Principal Office - (15.32 SQM)	Office (3)	
B00A - R0034 - Principal Office - (17.46 SQM)	Office (4)	
B00A - R0036 - Leading Teacher - (15.35 SQM)	Office (3)	
B00A - R0037 - Staff Study - (13.5 SQM)	Office (3)	
B00A - R0038 - Interview/Office - Type 1 - (11.37 SQM)	Office (2)	
B00A - R0039 - Movement - (7.38 SQM)	Not Applicable	Circulation or storage space.
B00A - R0040 - Movement - (7.35 SQM)	Not Applicable	Circulation or storage space.
B00A - R0046 - Principal Office - (23.34 SQM)	Office (5)	
B00A - R0047 - Movement - (35.57 SQM)	Not Applicable	Circulation or storage space.
B00A - R0048 - Movement - (10.6 SQM)	Not Applicable	Circulation or storage space.
B00A - R1005 - Staff Study - (27.6 SQM)	Office (6)	
B00A - R1006 - General Learning Space - (52.63 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R1007 - Seminar - (33.53 SQM)	Office (8)	
B00A - R1009 - General Learning Space - (58.12 SQM) - Teaching Space: 1	Student Space (26)	
B00A - R1011 - General Learning Space - (54.46 SQM) - Teaching Space: 1	Student Space (25)	
B00A - R1016 - General Learning Space - (51.32 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1017 - Staff Study - (11.42 SQM)	Office (2)	
B00A - R1019 - Movement - (12.91 SQM)	Not Applicable	Circulation or storage space.
B00A - R1020 - Movement - (77.17 SQM)	Not Applicable	Circulation or storage space.
B00A - R1021 - Movement - (25.32 SQM)	Not Applicable	Circulation or storage space.
B00A - R1023 - Movement - (10.87 SQM)	Not Applicable	Circulation or storage space.
B00A - R9002 - Movement - (7.69 SQM)	Not Applicable	Circulation or storage space.
B00A - R9003 - Student Canteen - (36.62 SQM)	Not Applicable	Circulation or storage space.
B00A - R9007 - Movement - (184.5 SQM)	Not Applicable	Circulation or storage space.
B00A - R9011 - Movement - (18.49 SQM)	Not Applicable	Circulation or storage space.
B00A - R9014 - General Assistants - (54.53 SQM)	Office (13)	
B00B - R0001 - Movement - (20.89 SQM)	Not Applicable	Circulation or storage space.
B00B - R0003 - General Learning Space - (54.1 SQM) - Teaching Space: 1	Student Space (25)	
B00B - R0012 - Movement - (20.45 SQM)	Not Applicable	Circulation or storage space.
B00B - R0015 - General Learning Space - (52.21 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0016 - General Learning Space - (53.58 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R0017 - Senior Seminar - (11.78 SQM)	Office (2)	
B00B - R0019 - Staff Study - (26.39 SQM)	Office (6)	
B00B - R0021 - Staff Study - (14.72 SQM)	Office (3)	
B00B - R0022 - General Learning Space - (52.56 SQM) - Teaching Space: 1	Student Space (24)	
B00B - R1001 - Movement - (29.27 SQM)	Not Applicable	Circulation or storage space.
B00B - R1004 - Staff Study - (13.24 SQM)	Office (3)	
B00B - R1005 - Staff Study - (14.02 SQM)	Office (3)	
B00B - R1006 - Seminar - (25.8 SQM)	Office (6)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R1007 - General Learning Space - (52.77 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1008 - General Learning Space - (52.99 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1009 - Music Learning Space - (52.63 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R1013 - Music Learning Space - (54.17 SQM) - Teaching Space: 1	● Student Space (25)	
B00B - R1015 - Movement - (28.79 SQM)	Not Applicable	Circulation or storage space.
B00B - R1016 - Movement - (76.37 SQM)	Not Applicable	Circulation or storage space.
B00B - R1019 - Movement - (10.08 SQM)	Not Applicable	Circulation or storage space.
B00C - R0002 - Movement - (10.27 SQM)	Not Applicable	Circulation or storage space.
B00C - R0007 - Movement - (5.7 SQM)	Not Applicable	Circulation or storage space.
B00C - R0013 - Movement - (7.17 SQM)	Not Applicable	Circulation or storage space.
B00C - R0019 - Commonroom - (74.64 SQM)	● Office (18)	
B00C - R0020 - Movement - (8.51 SQM)	Not Applicable	Circulation or storage space.
B00C - R0028 - Senior Study - (80.92 SQM)	● Office (20)	
B00C - R0029 - Movement - (103.98 SQM)	Not Applicable	Circulation or storage space.
B00C - R1001 - Staff Study - (51.82 SQM)	● Office (12)	
B00C - R1002 - Duplicating Workroom - (25.84 SQM)	● Office (6)	
B00C - R1005 - Administration - Clerical - (8.29 SQM)	● Office (2)	
B00C - R1009 - General Learning Space - (55.13 SQM) - Teaching Space: 1	● Student Space (25)	
B00C - R1010 - Movement - (65.46 SQM)	Not Applicable	Circulation or storage space.
B00C - R1012 - Administration - Clerical - (12.29 SQM)	● Office (3)	
B00C - R1013 - General Learning Space - (53.44 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R1016 - General Learning Space - (52.77 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R1017 - Computer Learning Space - (52.85 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R1020 - Computer Learning Space - (52.78 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R1021 - Staff Study - (39.93 SQM)	● Office (9)	
B00C - R1024 - Movement - (27.57 SQM)	Not Applicable	Circulation or storage space.
B00C - R1025 - Movement - (107.96 SQM)	Not Applicable	Circulation or storage space.
B00C - R1026 - Deputy Principal Office - (16.44 SQM)	● Office (4)	
B00C - R2001 - General Learning Space - (51.76 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R2008 - Movement - (79.67 SQM)	Not Applicable	Circulation or storage space.
B00C - R2010 - Interview/Office - Type 1 - (12.96 SQM)	● Office (3)	
B00C - R2012 - Audio Visual Workroom - (28.62 SQM)	● Student Space (13)	
B00C - R2013 - Workroom - (48.99 SQM)	● Office (12)	
B00C - R2015 - Main Area - (345.64 SQM)	Not Applicable	Circulation or storage space.
B00C - R2016 - Entry - (15.16 SQM)	Not Applicable	Circulation or storage space.
B00C - R2017 - Study Space - (32.47 SQM)	Not Applicable	Circulation or storage space.
B00C - R2020 - Movement - (30.79 SQM)	Not Applicable	Circulation or storage space.
B00C - R2021 - General Learning Space - (52.93 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R2022 - General Learning Space - (52 SQM) - Teaching Space: 1	● Student Space (24)	
B00C - R2023 - Movement - (27.82 SQM)	Not Applicable	Circulation or storage space.
B00C - R9001 - Movement - (6.31 SQM)	Not Applicable	Circulation or storage space.
B00M - R0001 - Staff Study - (43.95 SQM)	● Office (10)	
B00N - R0001 - Food Technology L.S. - (74.8 SQM) - Teaching Space: 1	● Student Space (34)	
B00N - R0002 - Food/Research Space - (16.92 SQM)	Not Applicable	Circulation or storage space.
B00N - R0003 - Preparation - (10.39 SQM)	Not Applicable	Circulation or storage space.
B00N - R0004 - Food Technology L.S. - (88.16 SQM) - Teaching Space: 1	● Student Space (40)	
B00N - R0005 - Interview/Office - Type 1 - (17.87 SQM)	● Office (4)	
B00N - R0006 - Movement - (8.64 SQM)	Not Applicable	Circulation or storage space.
B00N - R0007 - Movement - (8.67 SQM)	Not Applicable	Circulation or storage space.
B00P - R0001 - Art Learning Space - (47 SQM) - Teaching Space: 1	● Student Space (21)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00P - R0002 - Staff Study - (12.96 SQM)	Office (3)	
B00P - R0004 - Art Learning Space - (53.5 SQM) - Teaching Space: 1	Student Space (24)	
B00S - M0003 - Movement - (110.55 SQM)	Not Applicable	Circulation or storage space.
B00S - R0004 - Student Canteen - (10.3 SQM)	Not Applicable	Circulation or storage space.
B00S - R0006 - Movement - (38.19 SQM)	Not Applicable	Circulation or storage space.
B00S - R0007 - Multi-Purpose Space - (1211.63 SQM)	Student Space (562)	
B00S - R0019 - Movement - (7.1 SQM)	Not Applicable	Circulation or storage space.
B00S - R0020 - Movement - (7.64 SQM)	Not Applicable	Circulation or storage space.
B00S - R0026 - Stage - (101.07 SQM)	Not Applicable	Circulation or storage space.
B00S - R0031 - General Learning Space - Type 13 - (68.99 SQM) - Teaching Space: 1	Student Space (32)	
B00T - R0003 - Staff Study - (39.27 SQM)	Office (9)	
B00T - R0005 - Movement - (18.53 SQM)	Not Applicable	Circulation or storage space.
B00T - R0006 - Laboratory L.S. - (92.22 SQM) - Teaching Space: 1	Student Space (42)	
B00T - R0007 - Laboratory L.S. - (91.57 SQM) - Teaching Space: 1	Student Space (42)	
B00T - R0008 - Laboratory L.S. - (91.57 SQM) - Teaching Space: 1	Student Space (42)	
B00T - R0009 - Laboratory L.S. - (92.12 SQM) - Teaching Space: 1	Student Space (42)	
B00T - R0010 - Laboratory L.S. - (92.5 SQM) - Teaching Space: 1	Student Space (42)	
B00T - R0012 - Movement - (7.53 SQM)	Not Applicable	Circulation or storage space.
B00T - R0015 - Preparation - (73.89 SQM)	Not Applicable	Circulation or storage space.
B00T - R1003 - Staff Study - (32.39 SQM)	Office (8)	
B00T - R1004 - Art Learning Space - (62.1 SQM) - Teaching Space: 1	Student Space (28)	
B00T - R1005 - Workshop - (47.29 SQM)	Student Space (21)	
B00T - R1007 - Art Learning Space - (62.1 SQM) - Teaching Space: 1	Student Space (28)	
B00T - R1011 - Art Learning Space - (61.01 SQM) - Teaching Space: 1	Student Space (28)	
B00T - R1013 - Music Learning Space - (61.43 SQM) - Teaching Space: 1	Student Space (28)	
B00T - R1017 - Practice/Seminar - (25.19 SQM)	Not Applicable	Circulation or storage space.
B00T - R1018 - Music Learning Space - (73.55 SQM) - Teaching Space: 1	Student Space (34)	
B00V - R0007 - Metal Technology Bay - (40 SQM)	Not Applicable	Circulation or storage space.
B00V - R0008 - Wood Technology Bay - (42.61 SQM)	Not Applicable	Circulation or storage space.
B00V - R0011 - Staff Study - (15.82 SQM)	Office (3)	
B00V - R0018 - Wood Technology Bay - (153.87 SQM)	Not Applicable	Circulation or storage space.
B00V - R0022 - Wood Technology Bay - (93.7 SQM)	Not Applicable	Circulation or storage space.
B00V - R0023 - Metal Technology Bay - (108.26 SQM)	Not Applicable	Circulation or storage space.
B00V - R0027 - General Learning Space - Type 6 - (44.6 SQM) - Teaching Space: 1	Student Space (20)	
B00V - R1001 - Serviced Learning Space - (54.29 SQM) - Teaching Space: 1	Student Space (25)	
B00V - R1002 - Design L.S. - (60.58 SQM) - Teaching Space: 1	Student Space (28)	
B00V - R1004 - Design L.S. - (72.54 SQM) - Teaching Space: 1	Student Space (33)	
B00V - R1005 - Food Technology L.S. - (74.19 SQM) - Teaching Space: 1	Student Space (34)	
B00V - R1008 - Food Technology L.S. - (74.68 SQM) - Teaching Space: 1	Student Space (34)	
B00V - R1009 - Food/Research Space - (39.29 SQM)	Not Applicable	Circulation or storage space.
B00V - R1012 - Staff Study - (38.16 SQM)	Office (9)	
B00V - R1014 - Darkroom Space - (29.32 SQM)	Office (7)	
B00V - R9007 - Metal Technology Bay - (44.54 SQM)	Not Applicable	Circulation or storage space.
B00V - R9011 - Wood Technology Bay - (15.05 SQM)	Not Applicable	Circulation or storage space.
B00W - R0003 - Movement - (5.11 SQM)	Not Applicable	Circulation or storage space.
B00W - R0004 - Multi-Purpose Space - (157 SQM)	Student Space (72)	
B00W - R0006 - Movement - (58.94 SQM)	Not Applicable	Circulation or storage space.
B00W - R0008 - Movement - (5.93 SQM)	Not Applicable	Circulation or storage space.
B00W - R0011 - Movement - (5.86 SQM)	Not Applicable	Circulation or storage space.
B00W - R0013 - Stage - (97.98 SQM)	Not Applicable	Circulation or storage space.
B00W - R0015 - Movement - (6.2 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00W - R0016 - Stage - (34.41 SQM)	Not Applicable	Circulation or storage space.
B00W - R0017 - Movement - (6.37 SQM)	Not Applicable	Circulation or storage space.
B00X - R0001 - Computer Learning Space - (92.73 SQM) - Teaching Space: 1	 Student Space (43)	
B00X - R0002 - Seminar - Type 2 - (18.75 SQM)	 Office (4)	
B0AG - R0005 - Clerical Office - (12.31 SQM)	 Office (3)	