


VENTILATION AUDIT REPORT

SCHOOL:	Mount Victoria Public School (2652)
AMU REGION:	Western Sydney
STATE ELECTORATE:	Blue Mountains
LOCAL GOVERNMENT AREA:	Blue Mountains



2652 - Mount Victoria Public School
Site Plan (13094)

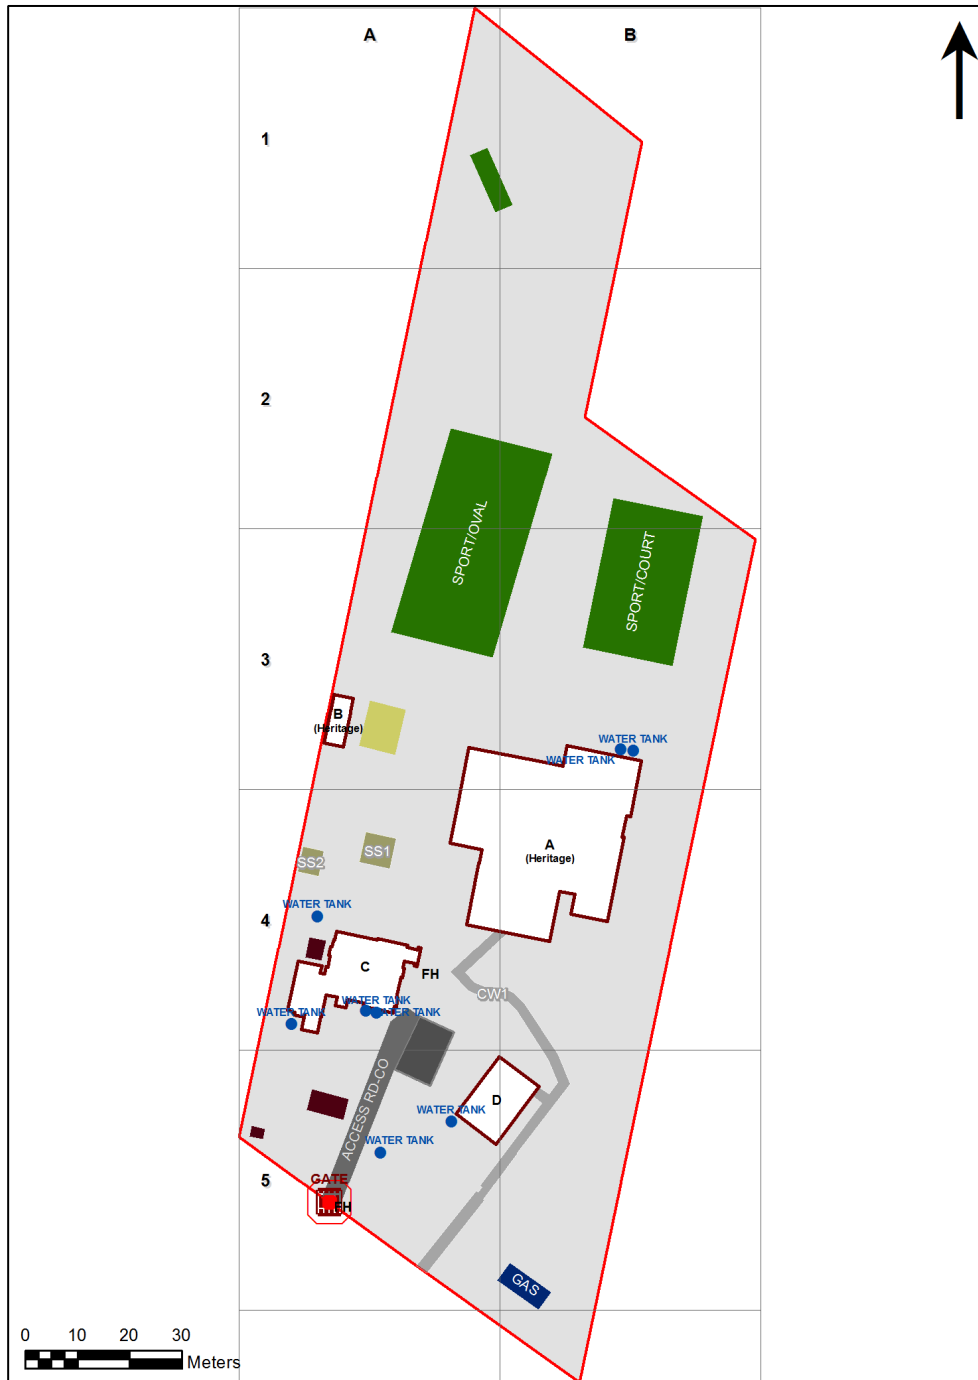

1:962

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Home Base - (65.91 SQM) - Teaching Space: 1	● Student Space (30)	
B00A - R0004 - Practical Activities - 1hb - (19.4 SQM)	● Student Space (9)	
B00A - R0006 - Movement - (5.06 SQM)	Not Applicable	Circulation or storage space.
B00A - R0009 - Canteen - (6.53 SQM)	Not Applicable	Circulation or storage space.
B00A - R0010 - Movement - (10.2 SQM)	Not Applicable	Circulation or storage space.
B00A - R0011 - Communal Space - (158.69 SQM)	● Student Space (73)	
B00A - R0012 - Movement - (22.97 SQM)	Not Applicable	Circulation or storage space.
B00A - R0015 - Reading Area - (84.06 SQM)	● Student Space (39)	
B00A - R0017 - Movement - (14.93 SQM)	Not Applicable	Circulation or storage space.
B00A - R0018 - Staff Room - (26.77 SQM)	● Office (6)	
B00A - R0020 - Clerical Office/Workroom - (25.6 SQM)	● Office (6)	
B00A - R0022 - Entry Vestibule - (23.65 SQM)	Not Applicable	Circulation or storage space.
B00A - R0023 - Movement - (9.79 SQM)	Not Applicable	Circulation or storage space.
B00A - R0027 - Movement - (11.04 SQM)	Not Applicable	Circulation or storage space.
B00A - R0030 - Principal - (15.38 SQM)	● Office (3)	
B00A - R0031 - Sick Bay - (8.12 SQM)	● Student Space (3)	
B00A - R0035 - Home Base - (65.32 SQM) - Teaching Space: 1	● Student Space (30)	
B00A - R0036 - Practical Activities - 1hb - (17.64 SQM)	● Student Space (8)	
B00A - R0039 - Practical Activities - 1hb - (17.55 SQM)	● Student Space (8)	
B00A - R0040 - Home Base - (65.37 SQM) - Teaching Space: 1	● Student Space (30)	
B00A - R0042 - Movement - (60.31 SQM)	Not Applicable	Circulation or storage space.
B00B - R0002 - Movement - (16.49 SQM)	Not Applicable	Circulation or storage space.
B00C - R0009 - Movement - (21.91 SQM)	Not Applicable	Circulation or storage space.
B00C - R0019 - Movement - (8.3 SQM)	Not Applicable	Circulation or storage space.
B00C - R0021 - Practical Activities - E - (31.35 SQM)	● Student Space (14)	
B00C - R0022 - Practical Activities - E - (27.39 SQM)	● Student Space (12)	
B00D - R0002 - Withdrawal Space - 1hb - (7.97 SQM)	● Student Space (3)	
B00D - R0004 - Home Base - (60.85 SQM) - Teaching Space: 1	● Student Space (28)	
B00D - R0005 - Practical Activities - 1hb - (18.47 SQM)	● Student Space (8)	