


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Nambucca Heads High School (8595)</b>
<b>AMU REGION:</b>	<b>North Coast</b>
<b>STATE ELECTORATE:</b>	<b>Oxley</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Nambucca</b>

8595 - Nambucca Heads High School  
Site Plan (11364)

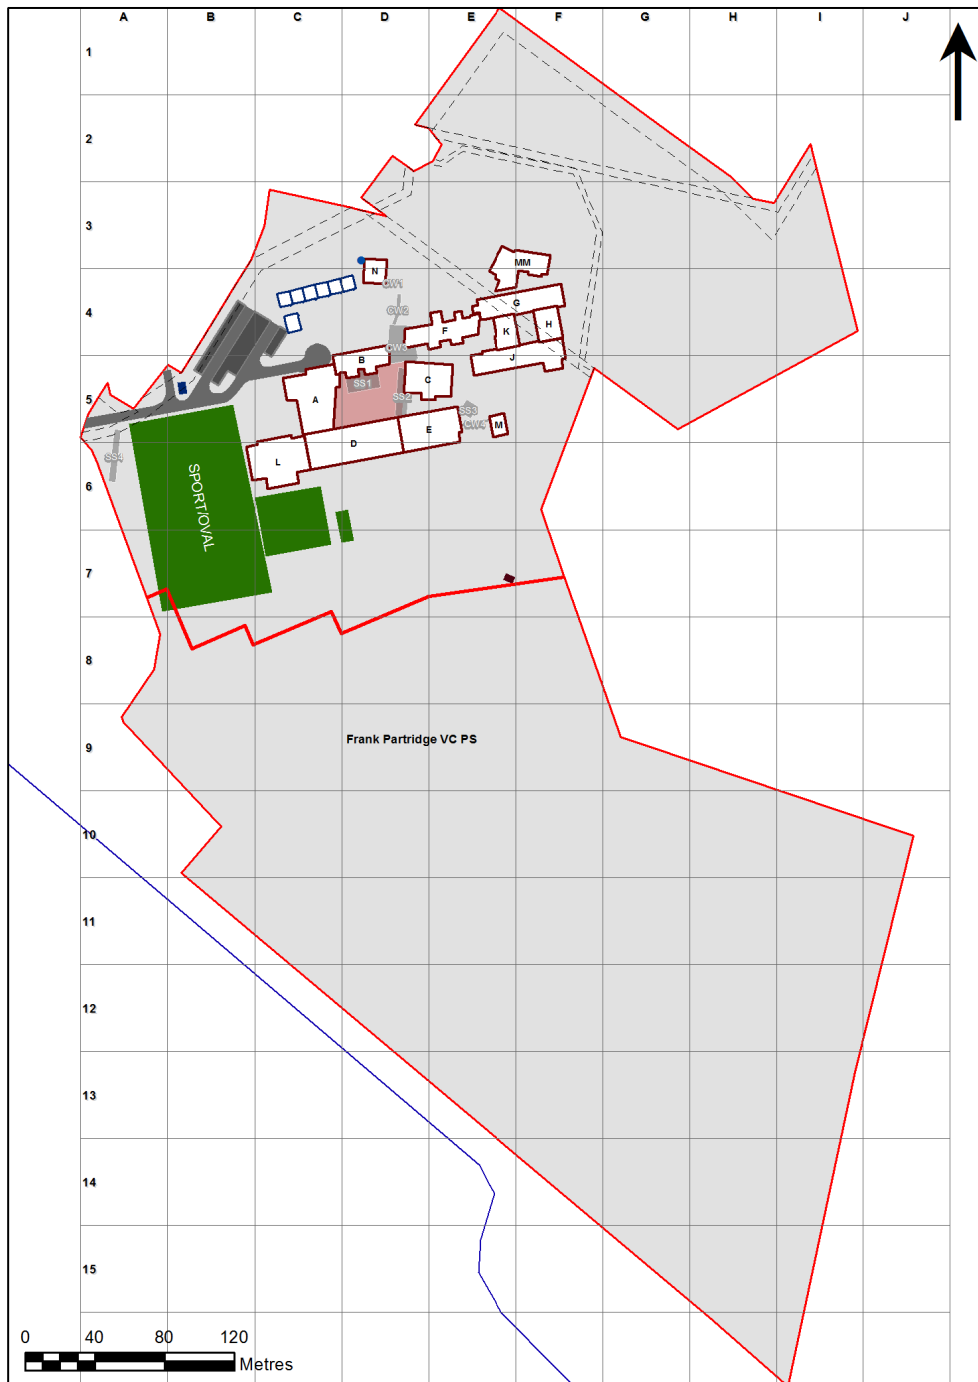

1:2,883













Printed: 04-Sep-2021

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0002 - Deputy Principal Office - (17.02 SQM)	Office (4)	
B00A - R0006 - Interview/Office - Type 1 - (10.79 SQM)	Office (2)	
B00A - R0007 - Ancillary Staff - (15.36 SQM)	Office (3)	
B00A - R0008 - Duplicating Workroom - (20.64 SQM)	Office (5)	
B00A - R0010 - Clinic - Girls - (12.52 SQM)	Office (3)	
B00A - R0011 - Clinic - Boys - (12.52 SQM)	Office (3)	
B00A - R0013 - Interview/Office - Type 1 - (12.45 SQM)	Office (3)	
B00A - R0014 - Principal Office - (22.13 SQM)	Office (5)	
B00A - R0015 - Interview/Office - Type 1 - (15.03 SQM)	Office (3)	
B00A - R0016 - Public Entry - (11.89 SQM)	Not Applicable	Circulation or storage space.
B00A - R0017 - Movement - (55.62 SQM)	Not Applicable	Circulation or storage space.
B00A - R0020 - Administration - Clerical - (30.36 SQM)	Office (7)	
B00A - R0022 - Student Canteen - (52.98 SQM)	Not Applicable	Circulation or storage space.
B00A - R0025 - Movement - (12.82 SQM)	Not Applicable	Circulation or storage space.
B00A - R0028 - Movement - (16.08 SQM)	Not Applicable	Circulation or storage space.
B00A - R0030 - Public Entry - (14.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R1001 - General Learning Space - (48.1 SQM) - Teaching Space: 1	Student Space (22)	
B00A - R1002 - General Learning Space - (46.26 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R1003 - Senior Study - (14.16 SQM)	Office (3)	
B00A - R1007 - General Learning Space - (46.25 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R1008 - General Learning Space - (46.86 SQM) - Teaching Space: 1	Student Space (21)	
B00A - R1009 - Movement - (65.18 SQM)	Not Applicable	Circulation or storage space.
B00A - R1010 - Movement - (40.1 SQM)	Not Applicable	Circulation or storage space.
B00B - R0002 - General Assistants - (12.97 SQM)	Office (3)	
B00B - R0004 - General Learning Space - (51.4 SQM) - Teaching Space: 1	Student Space (23)	
B00B - R0007 - Staff Study - (25.19 SQM)	Office (6)	
B00B - R0009 - Study Space - (15.75 SQM)	Not Applicable	Circulation or storage space.
B00B - R0010 - General Learning Space - (47.03 SQM) - Teaching Space: 1	Student Space (21)	
B00B - R0011 - General Learning Space - (51.6 SQM) - Teaching Space: 1	Student Space (23)	
B00B - R0013 - Movement - (89.51 SQM)	Not Applicable	Circulation or storage space.
B00B - R1001 - General Learning Space - (47.28 SQM) - Teaching Space: 1	Student Space (21)	
B00B - R1002 - Study Space - (15.2 SQM)	Not Applicable	Circulation or storage space.
B00B - R1003 - General Learning Space - (47.15 SQM) - Teaching Space: 1	Student Space (21)	
B00B - R1005 - Computer Learning Space - (58 SQM) - Teaching Space: 1	Student Space (26)	
B00B - R1010 - Staff Study - (37.81 SQM)	Office (9)	
B00B - R1011 - Movement - (89.64 SQM)	Not Applicable	Circulation or storage space.
B00B - R1012 - Interview/Office - Type 1 - (15.74 SQM)	Office (3)	
B00C - R0006 - Workroom - (30.15 SQM)	Office (7)	
B00C - R0007 - Main Area - (268.37 SQM)	Not Applicable	Circulation or storage space.
B00C - R0009 - Audio Visual Workroom - (25.79 SQM)	Student Space (11)	
B00C - R0010 - Seminar - (12.19 SQM)	Office (3)	
B00C - R0011 - Seminar - (12.18 SQM)	Office (3)	
B00C - R0014 - Movement - (98.11 SQM)	Not Applicable	Circulation or storage space.
B00D - R0008 - Performance Workspace - (210.63 SQM) - Teaching Space: 1	Student Space (97)	
B00D - R0013 - Movement - (7.5 SQM)	Not Applicable	Circulation or storage space.
B00D - R0016 - Movement - (38.95 SQM)	Not Applicable	Circulation or storage space.
B00D - R0017 - Practice/Seminar - (24.95 SQM)	Not Applicable	Circulation or storage space.
B00D - R0019 - Music Learning Space - (81.52 SQM) - Teaching Space: 1	Student Space (37)	
B00D - R0020 - General Learning Space - (53.85 SQM) - Teaching Space: 1	Student Space (24)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R0022 - Staff Study - (18.07 SQM)	Office (4)	
B00D - R0028 - Movement - (346.32 SQM)	Not Applicable	Circulation or storage space.
B00D - R1001 - Commonroom - (77.92 SQM)	Office (19)	
B00D - R1002 - Seminar - (14.61 SQM)	Office (3)	
B00D - R1003 - Interview/Office - Type 1 - (14.21 SQM)	Office (3)	
B00D - R1004 - Senior Study - (47.1 SQM)	Office (11)	
B00D - R1007 - Movement - (20.96 SQM)	Not Applicable	Circulation or storage space.
B00D - R1014 - General Learning Space - (47.42 SQM)	Student Space (22)	
B00D - R1016 - General Learning Space - (47.37 SQM) - Teaching Space: 1	Student Space (21)	
B00D - R1017 - General Learning Space - (57.43 SQM) - Teaching Space: 1	Student Space (26)	
B00D - R1018 - Movement - (109.01 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Laboratory L.S. - (90.08 SQM) - Teaching Space: 1	Student Space (41)	
B00E - R0002 - Preparation - (65.02 SQM)	Not Applicable	Circulation or storage space.
B00E - R0007 - Laboratory L.S. - (90.07 SQM) - Teaching Space: 1	Student Space (41)	
B00E - R0008 - Staff Study - (30.96 SQM)	Office (7)	
B00E - R0009 - Laboratory L.S. - (90.77 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0010 - Laboratory L.S. - (90.76 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0012 - Movement - (152.71 SQM)	Not Applicable	Circulation or storage space.
B00F - R0002 - Special Learning Space - (50.66 SQM) - Teaching Space: 1	Student Space (23)	
B00F - R0008 - Food Technology L.S. - (43.63 SQM) - Teaching Space: 1	Student Space (20)	
B00F - R0011 - Special Learning Space - (50.93 SQM) - Teaching Space: 1	Student Space (23)	
B00F - R0014 - Staff Study - (25.19 SQM)	Office (6)	
B00F - R0020 - Movement - (148.92 SQM)	Not Applicable	Circulation or storage space.
B00F - R0022 - Withdrawal - S - (14.97 SQM)	Student Space (6)	
B00F - R1001 - General Learning Space - (46.33 SQM) - Teaching Space: 1	Student Space (21)	
B00F - R1002 - General Learning Space - (45.7 SQM) - Teaching Space: 1	Student Space (21)	
B00F - R1004 - General Learning Space - (46.32 SQM) - Teaching Space: 1	Student Space (21)	
B00F - R1005 - General Learning Space - (47.17 SQM) - Teaching Space: 1	Student Space (21)	
B00F - R1007 - Study Space - (15.09 SQM)	Not Applicable	Circulation or storage space.
B00F - R1008 - Movement - (112.65 SQM)	Not Applicable	Circulation or storage space.
B00F - R1010 - Staff Study - (39.96 SQM)	Office (9)	
B00F - R1011 - General Learning Space - (46.33 SQM) - Teaching Space: 1	Student Space (21)	
B00G - R0001 - Computer Learning Space - (73.61 SQM) - Teaching Space: 1	Student Space (34)	
B00G - R0004 - Materials Technology L.S. - (70.79 SQM) - Teaching Space: 1	Student Space (32)	
B00G - R0005 - Metal Technology Bay - (30.78 SQM)	Not Applicable	Circulation or storage space.
B00G - R0007 - Welding Area - (14.1 SQM)	Not Applicable	Circulation or storage space.
B00G - R0008 - Materials Technology L.S. - (58.4 SQM) - Teaching Space: 1	Student Space (27)	
B00G - R0009 - Materials Technology L.S. - (110.88 SQM) - Teaching Space: 1	Student Space (51)	
B00G - R0010 - Wood Technology Bay - (36.19 SQM)	Not Applicable	Circulation or storage space.
B00G - R0012 - Movement - (129.96 SQM)	Not Applicable	Circulation or storage space.
B00H - R0001 - Design L.S. - (72.1 SQM) - Teaching Space: 1	Student Space (33)	
B00H - R0002 - Materials Technology L.S. - (72.19 SQM) - Teaching Space: 1	Student Space (33)	
B00H - R0004 - Seminar - (15.45 SQM)	Office (3)	
B00H - R0005 - Movement - (65.55 SQM)	Not Applicable	Circulation or storage space.
B00J - R0005 - Food Technology L.S. - (102.42 SQM) - Teaching Space: 1	Student Space (47)	
B00J - R0006 - Darkroom Space - (30.7 SQM)	Office (7)	
B00J - R0009 - Art Learning Space - (60.67 SQM) - Teaching Space: 1	Student Space (28)	
B00J - R0010 - Workshop - (54.73 SQM)	Student Space (25)	
B00J - R0011 - Art Learning Space - (60.15 SQM) - Teaching Space: 1	Student Space (27)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00J - R0012 - Movement - (133.97 SQM)	Not Applicable	Circulation or storage space.
B00J - R0014 - Kitchen - Type 2 - (99.91 SQM)	 Student Space (46)	
B00J - R0016 - Preparation - Materials - (17.9 SQM)	Not Applicable	Circulation or storage space.
B00J - R0018 - Outdoor Workshop - (55.08 SQM)	Not Applicable	Circulation or storage space.
B00K - R0002 - Interview/Office - Type 1 - (13.5 SQM)	 Office (3)	
B00K - R0003 - Staff Study - (47.52 SQM)	 Office (11)	
B00K - R0013 - Movement - (53 SQM)	Not Applicable	Circulation or storage space.
B00K - R0014 - Movement - (33.52 SQM)	Not Applicable	Circulation or storage space.
B00L - R0001 - Gymnasium - (639.82 SQM)	 Student Space (296)	
B00L - R0002 - Staff Study - (10.26 SQM)	 Office (2)	
B00L - R0011 - Staff Kitchen - (11.58 SQM)	 Office (2)	
B00L - R0012 - Movement - (32.61 SQM)	Not Applicable	Circulation or storage space.
B00M - R0002 - Senior Learning Centre - (62.74 SQM)	 Student Space (29)	
B00N - R0001 - Computer Learning Space - (91.56 SQM) - Teaching Space: 1	 Student Space (42)	
B00N - R0002 - Seminar - Type 2 - (18.75 SQM)	 Office (4)	
B0MM - R0001 - Workshop Area - (253.57 SQM)	 Student Space (117)	
B0MM - R0002 - Leading Teacher - (15.69 SQM)	 Office (3)	
B0MM - R0005 - General Learning Space - (44.7 SQM) - Teaching Space: 1	 Student Space (20)	