


VENTILATION AUDIT REPORT

SCHOOL:	Newtown Public School (7431)
AMU REGION:	Sydney
STATE ELECTORATE:	Newtown
LOCAL GOVERNMENT AREA:	Sydney

7431 - Newtown Public School
Site Plan (13186)



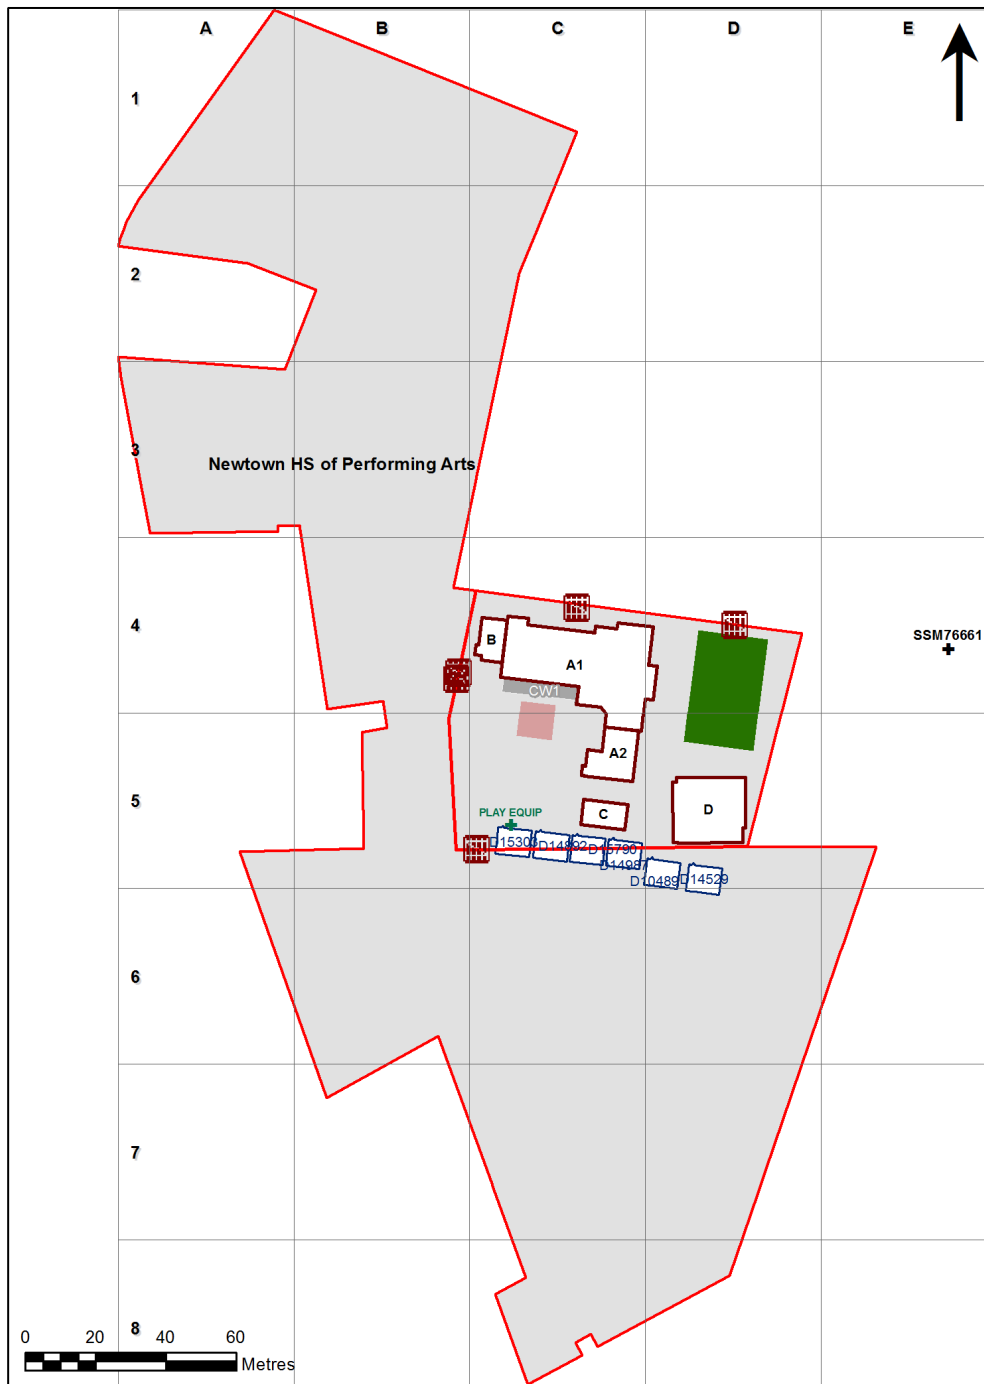







1:1,427

Printed: 10-Dec-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R0013 - Home Base - (55.39 SQM) - Teaching Space: 1	● Student Space (25)	
B00B - R0015 - Practical Activities - 1hb - (5.5 SQM)	● Student Space (2)	
B00B - R0016 - Withdrawal Space - 1hb - (9.75 SQM)	● Student Space (4)	
B00D - R0001 - Communal Space - (149.55 SQM)	● Student Space (69)	
B00D - R0002 - Raised Platform - (59.19 SQM)	Not Applicable	Circulation or storage space.
B00D - R0017 - Movement - (5.1 SQM)	Not Applicable	Circulation or storage space.
B00D - R0018 - Movement - (11.35 SQM)	Not Applicable	Circulation or storage space.
B00D - R0019 - Movement - (12.44 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R0001 - Principal - (21.72 SQM)	● Office (5)	
B0A1 - R0008 - Movement - (25.84 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R0019 - Home Base - (48.93 SQM) - Teaching Space: 1	● Student Space (22)	
B0A1 - R0020 - Practical Activities - 1hb - (25.02 SQM)	● Student Space (11)	
B0A1 - R0025 - Movement - (26 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R0027 - Practical Activities - 1hb - (35.35 SQM)	● Student Space (16)	
B0A1 - R0031 - Movement - (25.95 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R0034 - Home Base - (50.19 SQM) - Teaching Space: 1	● Student Space (23)	
B0A1 - R0035 - Practical Activities - 1hb - (25.19 SQM)	● Student Space (11)	
B0A1 - R0037 - Special Programs Room - (15.95 SQM)	● Student Space (7)	
B0A1 - R0041 - Interview - (9.89 SQM)	● Office (2)	
B0A1 - R0043 - Staff Room - (37.47 SQM)	● Office (9)	
B0A1 - R0045 - Staff Kitchen - (7.46 SQM)	● Office (1)	
B0A1 - R0048 - Duplicating Workroom - (5.82 SQM)	● Office (1)	
B0A1 - R0051 - Movement - (56.29 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R0055 - Home Base - (51.08 SQM) - Teaching Space: 1	● Student Space (23)	
B0A1 - R0056 - Home Base - (51.08 SQM) - Teaching Space: 1	● Student Space (23)	
B0A1 - R1002 - Movement - (14.1 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R1003 - Practical Activities - 1hb - (18.71 SQM)	● Student Space (8)	
B0A1 - R1004 - Home Base - (48.8 SQM) - Teaching Space: 1	● Student Space (22)	
B0A1 - R1006 - Home Base - (50.27 SQM) - Teaching Space: 1	● Student Space (23)	
B0A1 - R1007 - Practical Activities - 1hb - (15.97 SQM)	● Student Space (7)	
B0A1 - R1008 - Movement - (26.77 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R1009 - Home Base - (50.25 SQM) - Teaching Space: 1	● Student Space (23)	
B0A1 - R1010 - Practical Activities - 1hb - (16.35 SQM)	● Student Space (7)	
B0A1 - R1012 - Movement - (9.22 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R1014 - Movement - (26.82 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R1015 - Movement - (13.74 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R1017 - Practical Activities - 1hb - (17.76 SQM)	● Student Space (8)	
B0A1 - R1018 - Home Base - (49.26 SQM) - Teaching Space: 1	● Student Space (22)	
B0A1 - R9008 - Home Base - (50.96 SQM) - Teaching Space: 1	● Student Space (23)	
B0A1 - R9009 - Practical Activities - 1hb - (17.17 SQM)	● Student Space (7)	
B0A1 - R9023 - Entry Vestibule - (7.13 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R9024 - Clerical Office - (29.44 SQM)	● Office (7)	
B0A1 - R9025 - Clerical/Printing - (6.89 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R9026 - Clerical Office - (8.85 SQM)	● Office (2)	
B0A1 - R9027 - Principal - (18.02 SQM)	● Office (4)	
B0A1 - R9028 - Deputy Principal - (19.03 SQM)	● Office (4)	
B0A1 - R9030 - Movement - (40.95 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R9034 - Movement - (21.37 SQM)	Not Applicable	Circulation or storage space.
B0A1 - R9037 - Movement - (16.21 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
BOA2 - R0002 - Reading Area - (106.86 SQM)	 Student Space (49)	
BOA2 - R9001 - Home Base - (47.9 SQM)	 Student Space (22)	
BOA2 - R9004 - Movement - (7.07 SQM)	Not Applicable	Circulation or storage space.
OS 601 10489 - OS 601 10489 - Learning Unit - Standard/Withdrawal - (76 SQM)	 Student Space (35)	
OS 601 14529 - OS 601 14529 - Learning Unit - Standard/Withdrawal - (76 SQM)	 Student Space (35)	
OS 602 14987 - OS 602 14987 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 602 15790 - OS 602 15790 - Learning Unit - Standard With P.A.A. - (76 SQM)	 Student Space (35)	
OS 603 14892 - OS 603 14892 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	
OS 603 15303 - OS 603 15303 - Learning Unit - Standard With P.A.A. A/C - (76 SQM)	 Student Space (35)	