


VENTILATION AUDIT REPORT

SCHOOL:	Springwood Public School (3095)
AMU REGION:	Western Sydney
STATE ELECTORATE:	Blue Mountains
LOCAL GOVERNMENT AREA:	Blue Mountains

3095 - Springwood Public School
Site Plan (13051)

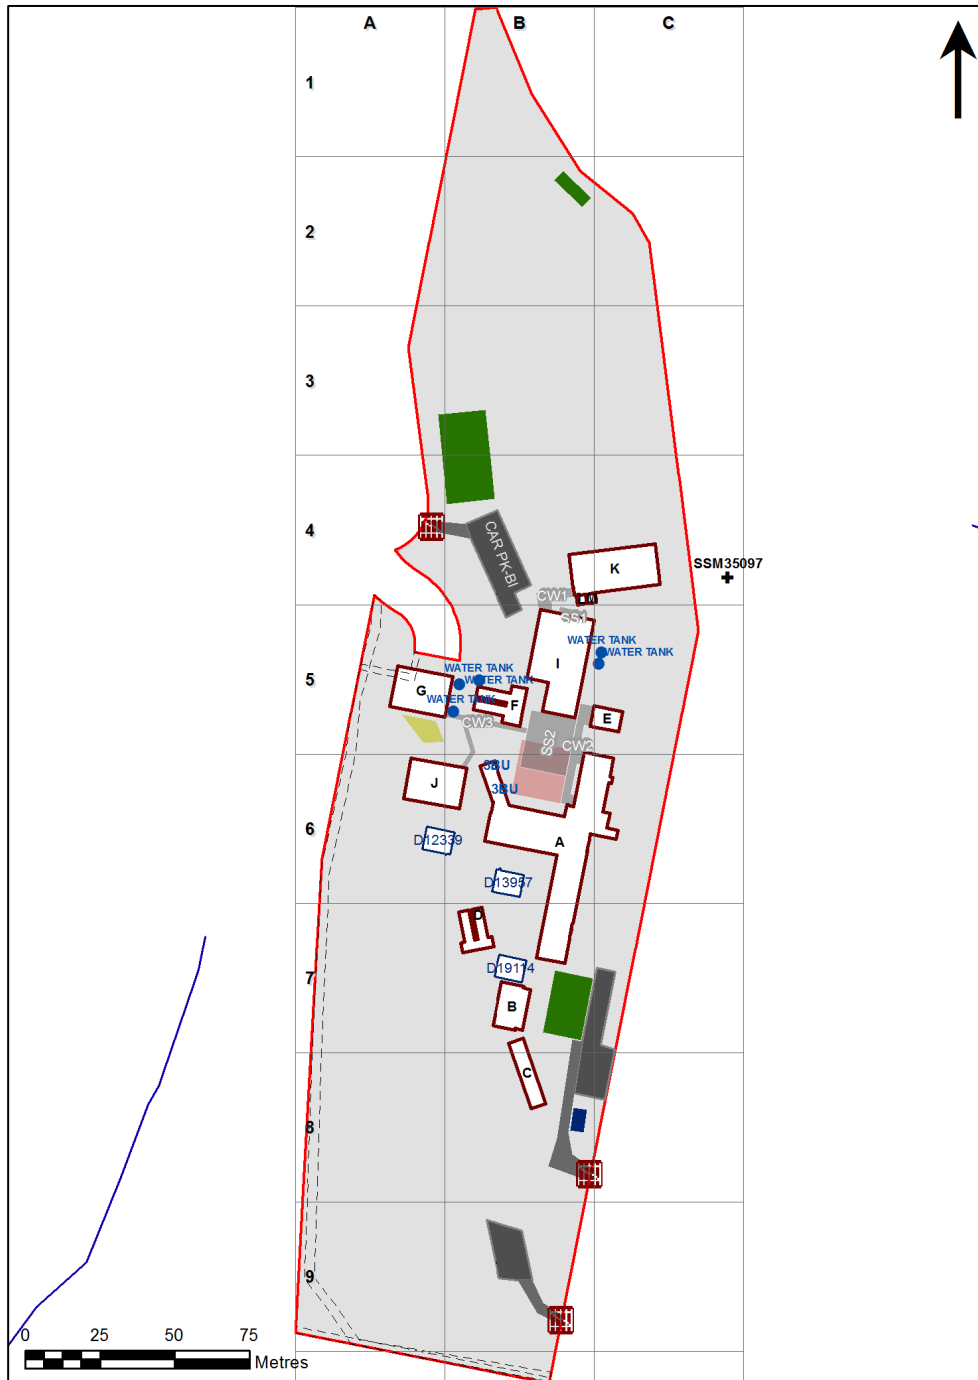

1:1,679

Printed: 18-Aug-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Communal Space - (133.49 SQM)	● Student Space (61)	
B00A - R0002 - Staff Room - (66.05 SQM)	● Office (16)	
B00A - R0003 - Staff Kitchen - (8.74 SQM)	● Office (2)	
B00A - R0004 - Raised Platform - (33.65 SQM)	Not Applicable	Circulation or storage space.
B00A - R0005 - Entry Vestibule - (30.01 SQM)	Not Applicable	Circulation or storage space.
B00A - R0006 - Movement - (7.52 SQM)	Not Applicable	Circulation or storage space.
B00A - R0009 - Duplicating Workroom - (33.9 SQM)	● Office (8)	
B00A - R0010 - Sick Bay - (9.29 SQM)	● Student Space (4)	
B00A - R0013 - Principal - (18.2 SQM)	● Office (4)	
B00A - R0014 - Deputy Principal - (12.92 SQM)	● Office (3)	
B00A - R0015 - Interview - (7.75 SQM)	● Office (1)	
B00A - R0016 - Home Base - (51.21 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0018 - Movement - (7.3 SQM)	Not Applicable	Circulation or storage space.
B00A - R0022 - Home Base - (51.67 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0024 - Movement - (66.31 SQM)	Not Applicable	Circulation or storage space.
B00A - R0025 - Movement - (5.38 SQM)	Not Applicable	Circulation or storage space.
B00A - R0026 - Movement - (54 SQM)	Not Applicable	Circulation or storage space.
B00A - R0028 - Home Base - (51.21 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0029 - Home Base - (51.13 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0032 - Clerical Office/Workroom - (15.44 SQM)	● Office (3)	
B00A - R0035 - Movement - (20.33 SQM)	Not Applicable	Circulation or storage space.
B00A - R1003 - Home Base - (51.52 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1005 - Home Base - (51.14 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1007 - Home Base - (49.1 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1016 - Deputy Principal - (15.44 SQM)	● Office (3)	
B00A - R1020 - Withdrawal Space - 1hb - (22.47 SQM)	● Student Space (10)	
B00A - R1021 - Withdrawal Space - 1hb - (27.97 SQM)	● Student Space (12)	
B00A - R1022 - Practical Activities - 1hb - (21.21 SQM)	● Student Space (9)	
B00A - R1025 - Interview - (9.6 SQM)	● Office (2)	
B00A - R1027 - Home Base - (86 SQM) - Teaching Space: 1	● Student Space (39)	
B00A - R1028 - Practical Activities - 1hb - (15.34 SQM)	● Student Space (7)	
B00A - R1029 - Deputy Principal - (8.36 SQM)	● Office (2)	
B00A - R1030 - Deputy Principal - Type 2 - (7.97 SQM)	● Office (1)	
B00A - R1031 - Movement - (19.01 SQM)	Not Applicable	Circulation or storage space.
B00A - R1032 - Home Base - (67.02 SQM) - Teaching Space: 1	● Student Space (31)	
B00A - R1033 - Practical Activities/Movement - 2hb - (5.67 SQM)	● Student Space (2)	
B00A - R1034 - Movement - (36.56 SQM)	Not Applicable	Circulation or storage space.
B00A - R1035 - Movement - (43.74 SQM)	Not Applicable	Circulation or storage space.
B00A - R1036 - Movement - (46.39 SQM)	Not Applicable	Circulation or storage space.
B00A - R1037 - Practical Activities/Movement - 2hb - (7.62 SQM)	● Student Space (3)	
B00B - R0002 - Home Base - (53.53 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R0003 - Home Base - (53.75 SQM) - Teaching Space: 1	● Student Space (24)	
B00B - R0004 - Practical Activities - 1hb - (14.57 SQM)	● Student Space (6)	
B00B - R0005 - Practical Activities - (15.91 SQM)	● Student Space (7)	
B00C - R0001 - Special Programs Room - (46.73 SQM)	● Student Space (21)	
B00E - R0003 - Canteen - (24.76 SQM)	Not Applicable	Circulation or storage space.
B00E - R0004 - Movement - (21.41 SQM)	Not Applicable	Circulation or storage space.
B00G - R0002 - Home Base - (64.5 SQM) - Teaching Space: 1	● Student Space (29)	
B00G - R0003 - Practical Activities - 1hb - (12.73 SQM)	● Student Space (5)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00G - R0004 - Movement - (14.12 SQM)	Not Applicable	Circulation or storage space.
B00G - R0005 - Withdrawal Space - 1hb - (11.79 SQM)	● Student Space (5)	
B00G - R0006 - Movement - (14.2 SQM)	Not Applicable	Circulation or storage space.
B00G - R0008 - Home Base - (64.47 SQM) - Teaching Space: 1	● Student Space (29)	
B00G - R0009 - Practical Activities - 1hb - (12.64 SQM)	● Student Space (5)	
B00G - R0010 - Movement - (35.55 SQM)	Not Applicable	Circulation or storage space.
B00I - R0001 - Reading Area - (228.72 SQM)	● Student Space (106)	
B00I - R0007 - Special Programs Room - (42.16 SQM)	● Student Space (19)	
B00J - R0001 - Movement - (35.04 SQM)	Not Applicable	Circulation or storage space.
B00J - R0002 - Practical Activities - 1hb - (18.94 SQM)	● Student Space (8)	
B00J - R0003 - Home Base - (58.36 SQM) - Teaching Space: 1	● Student Space (27)	
B00J - R0005 - Movement - (14.3 SQM)	Not Applicable	Circulation or storage space.
B00J - R0006 - Withdrawal Space - 1hb - (11.67 SQM)	● Student Space (5)	
B00J - R0007 - Movement - (14.21 SQM)	Not Applicable	Circulation or storage space.
B00J - R0009 - Home Base - (58.14 SQM) - Teaching Space: 1	● Student Space (26)	
B00J - R0010 - Practical Activities - 1hb - (19 SQM)	● Student Space (8)	
B00K - R0002 - Home Base - (66.76 SQM) - Teaching Space: 1	● Student Space (30)	
B00K - R0008 - Practical Activities - 2hb - (37.72 SQM)	● Student Space (17)	
B00K - R0009 - Home Base - (66.41 SQM) - Teaching Space: 1	● Student Space (30)	
B00K - R0011 - Home Base - (66.69 SQM) - Teaching Space: 1	● Student Space (30)	
OS 602 12339 - OS 602 12339 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 602 12628 - OS 602 12628 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 602 13957 - OS 602 13957 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	
OS 606 19114 - OS 606 19114 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	