


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Telopea Public School (4103)</b>
<b>AMU REGION:</b>	<b>Western Sydney</b>
<b>STATE ELECTORATE:</b>	<b>Parramatta</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Parramatta</b>

4103 - Telopea Public School  
Site Plan (11336)

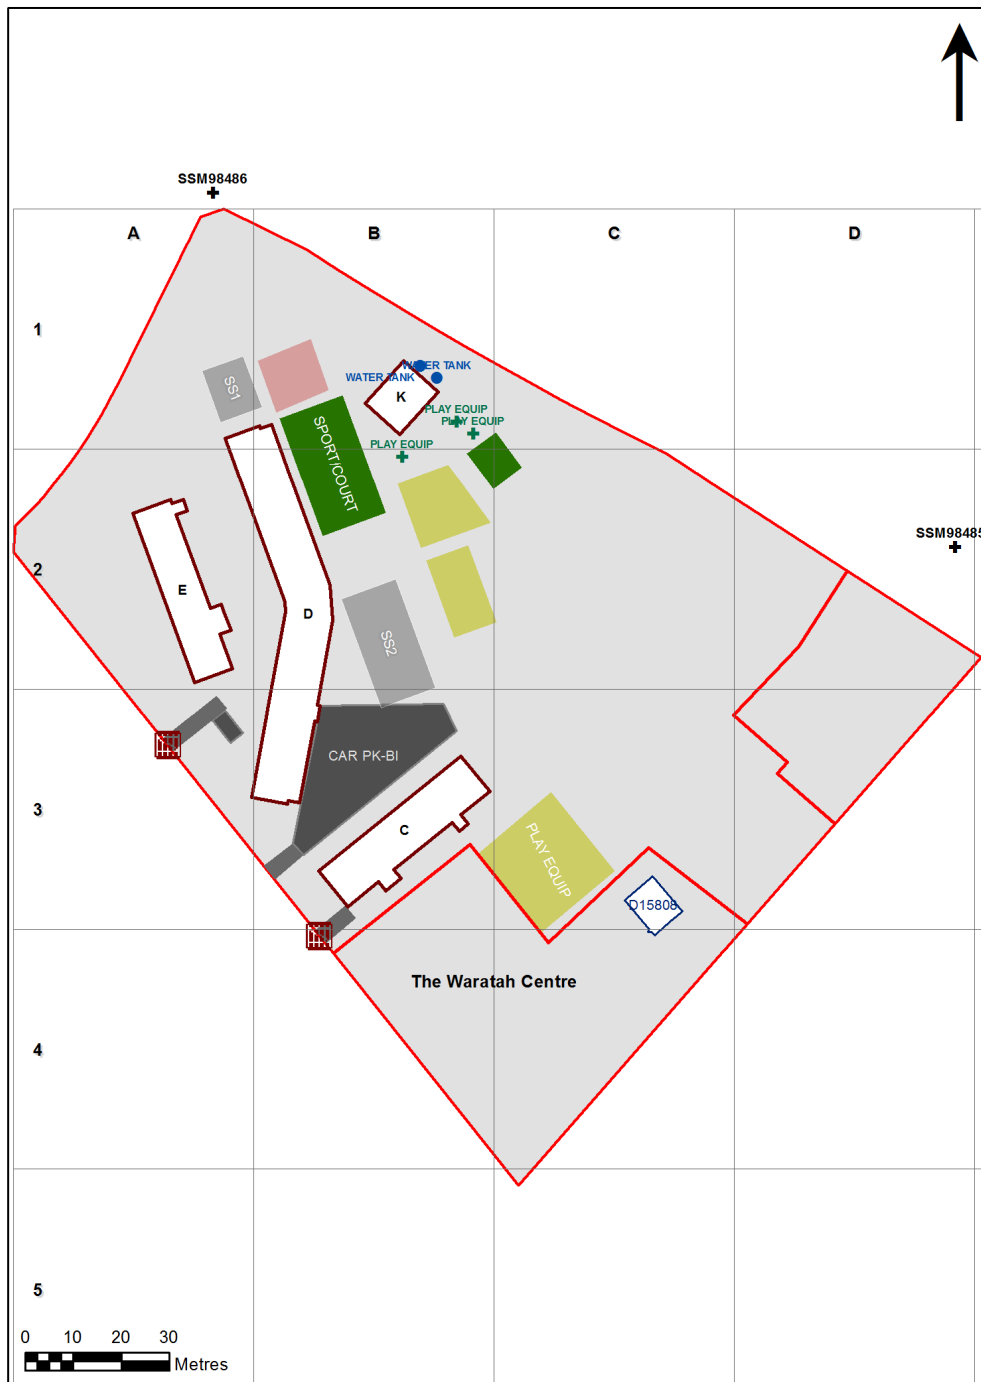

1:1,044

Printed: 19-Dec-2020

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00C - R0001 - Home Base - (65.87 SQM) - Teaching Space: 1	● Student Space (30)	
B00C - R0002 - Movement - (5.29 SQM)	Not Applicable	Circulation or storage space.
B00C - R0003 - Movement - (5.57 SQM)	Not Applicable	Circulation or storage space.
B00C - R0004 - Practical Activities - 1hb - (7.34 SQM)	● Student Space (3)	
B00C - R0006 - Communal Space - (64.97 SQM)	● Student Space (30)	
B00C - R0008 - Movement - (8.31 SQM)	Not Applicable	Circulation or storage space.
B00C - R0016 - Communal Space - (63.71 SQM)	● Student Space (29)	
B00C - R0019 - Communal Space - (83.87 SQM)	● Student Space (38)	
B00D - R0001 - Movement - (183.15 SQM)	Not Applicable	Circulation or storage space.
B00D - R0004 - Staff Kitchen - (12.8 SQM)	● Office (3)	
B00D - R0006 - Staff Room - (53.59 SQM)	● Office (13)	
B00D - R0007 - Home Base - (53.59 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0008 - Duplicating Workroom - (12.69 SQM)	● Office (3)	
B00D - R0009 - Movement - (9.24 SQM)	Not Applicable	Circulation or storage space.
B00D - R0010 - Home Base - (53.59 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0011 - Home Base - (53.59 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0015 - Deputy Principal - (14.5 SQM)	● Office (3)	
B00D - R0016 - Home Base - (53.66 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0017 - Home Base - (53.58 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0018 - Home Base - (53.58 SQM) - Teaching Space: 1	● Student Space (24)	
B00D - R0019 - Home Base - (53.58 SQM) - Teaching Space: 1	● Student Space (24)	
B00E - R0008 - Movement - (9.43 SQM)	Not Applicable	Circulation or storage space.
B00E - R0010 - Entry Vestibule - (15.25 SQM)	Not Applicable	Circulation or storage space.
B00E - R0011 - Clerical Office/Workroom - (19.45 SQM)	● Office (4)	
B00E - R0012 - Principal - (12.64 SQM)	● Office (3)	
B00E - R0013 - Reading Area - (99.68 SQM)	● Student Space (46)	
B00E - R0015 - Movement - (5.95 SQM)	Not Applicable	Circulation or storage space.
B00E - R0016 - Duplicating Workroom - (10.53 SQM)	● Office (2)	
B00E - R0020 - Staff Room - (16.9 SQM)	● Office (4)	
B00E - R9006 - Movement - (24.71 SQM)	Not Applicable	Circulation or storage space.
B00E - R9009 - Canteen - (20.72 SQM)	Not Applicable	Circulation or storage space.
OS 602 15808 - OS 602 15808 - Learning Unit - Standard With P.A.A. - (76 SQM)	● Student Space (35)	