


# VENTILATION AUDIT REPORT

<b>SCHOOL:</b>	<b>Toormina Public School (4506)</b>
<b>AMU REGION:</b>	<b>North Coast</b>
<b>STATE ELECTORATE:</b>	<b>Coffs Harbour</b>
<b>LOCAL GOVERNMENT AREA:</b>	<b>Coffs Harbour</b>

4506 - Toormina Public School  
Site Plan (11343)

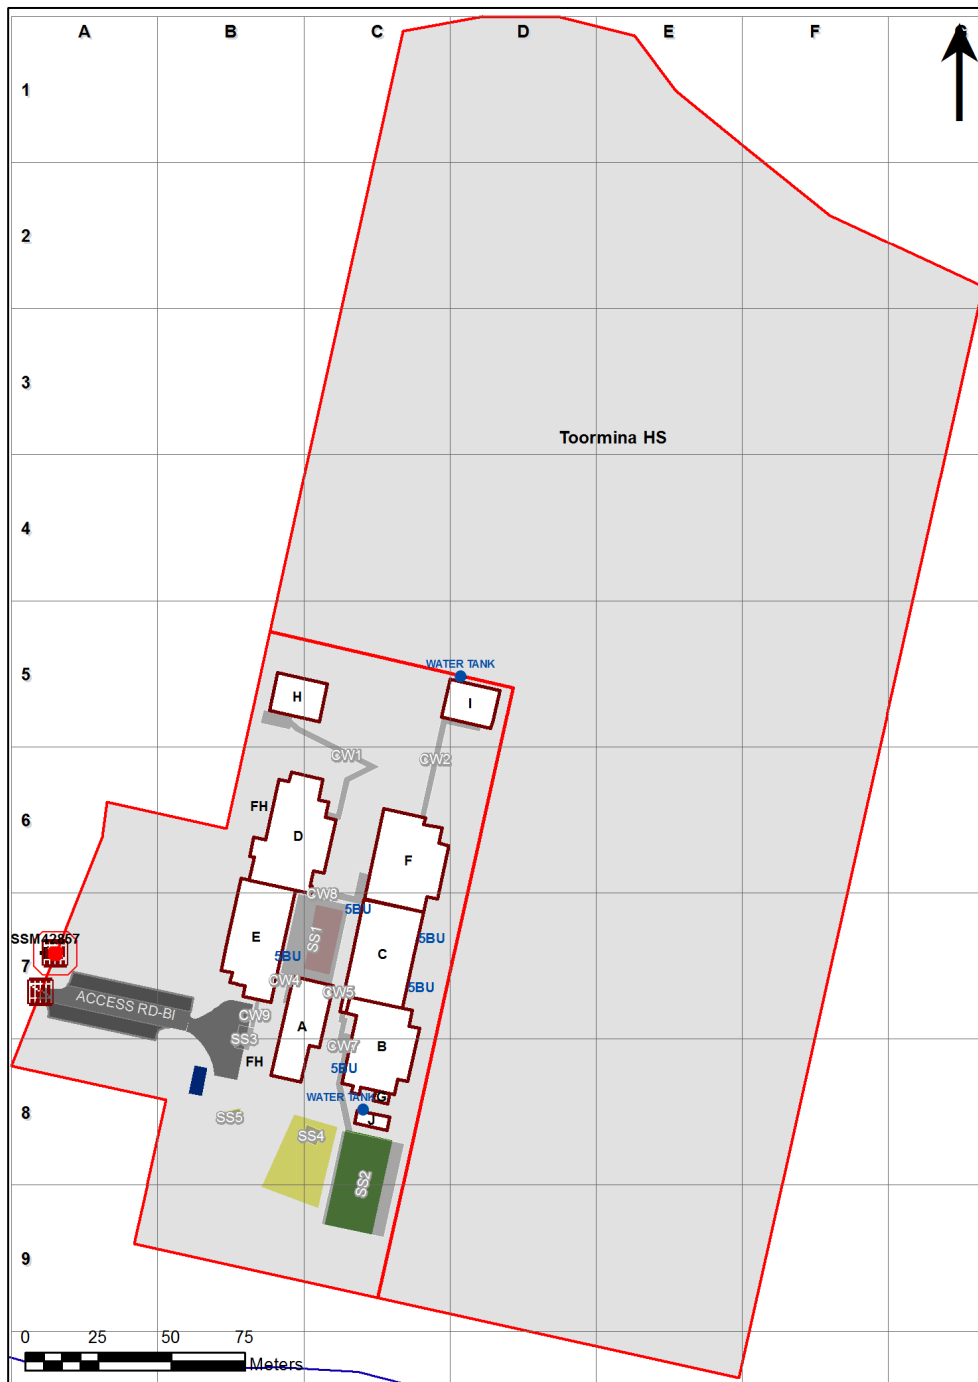

1:1,716

Printed: 21-Mar-2020

## Ventilation Audit Key

Category	Description
	Category A Operate this space in line with <a href="#">COVID safe school operations</a> . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m <sup>2</sup> to comply with <a href="#">COVID safe school operations and the guided use of spaces</a> . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Staff Room - (90.55 SQM)	Office (22)	
B00A - R0002 - Movement - (19.19 SQM)	Not Applicable	Circulation or storage space.
B00A - R0003 - Staff Room Annexe - (9.2 SQM)	Office (2)	
B00A - R0006 - Clerical Office - (25.14 SQM)	Office (6)	
B00A - R0007 - Entry Vestibule - (9.32 SQM)	Not Applicable	Circulation or storage space.
B00A - R0009 - Deputy Principal - (12.99 SQM)	Office (3)	
B00A - R0010 - Interview - (11.54 SQM)	Office (2)	
B00A - R0011 - Movement - (46.16 SQM)	Not Applicable	Circulation or storage space.
B00A - R0012 - Deputy Principal - (12.62 SQM)	Office (3)	
B00A - R0013 - Principal - (21.08 SQM)	Office (5)	
B00A - R0016 - Duplicating Workroom - (32.73 SQM)	Office (8)	
B00A - R0017 - Movement - (6.49 SQM)	Not Applicable	Circulation or storage space.
B00A - R0018 - Sick Bay - (14.15 SQM)	Student Space (6)	
B00A - R0020 - Staff Room Annexe - (6.01 SQM)	Office (1)	
B00A - R0021 - Movement - (65.76 SQM)	Not Applicable	Circulation or storage space.
B00B - R0001 - Movement - (5.85 SQM)	Not Applicable	Circulation or storage space.
B00B - R0002 - Seminar/Study - (23.84 SQM)	Office (5)	
B00B - R0006 - Clerical Office - (12.28 SQM)	Office (3)	
B00B - R0007 - Movement - (10.98 SQM)	Not Applicable	Circulation or storage space.
B00B - R0008 - Practical Activities - 1hb - (49.29 SQM)	Student Space (22)	
B00B - R0009 - Movement - (23.74 SQM)	Not Applicable	Circulation or storage space.
B00B - R0010 - Movement - (48.62 SQM)	Not Applicable	Circulation or storage space.
B00B - R0013 - Special Programs Room - (36.1 SQM)	Student Space (16)	
B00B - R0016 - Home Base - (55.96 SQM) - Teaching Space: 1	Student Space (25)	
B00B - R0017 - Movement - (7.91 SQM)	Not Applicable	Circulation or storage space.
B00B - R0018 - Withdrawal Space - 1hb - (12.34 SQM)	Student Space (5)	
B00B - R0019 - Movement - (26.35 SQM)	Not Applicable	Circulation or storage space.
B00B - R0020 - Home Base - (55.87 SQM) - Teaching Space: 1	Student Space (25)	
B00B - R0023 - Home Base - (56.03 SQM) - Teaching Space: 1	Student Space (25)	
B00B - R0024 - Withdrawal Space - 1hb - (12.34 SQM)	Student Space (5)	
B00B - R0025 - Movement - (8.02 SQM)	Not Applicable	Circulation or storage space.
B00B - R0026 - Home Base - (56.13 SQM) - Teaching Space: 1	Student Space (26)	
B00C - R0009 - Special Programs Room - (50.5 SQM)	Student Space (23)	
B00C - R0013 - Movement - (20.58 SQM)	Not Applicable	Circulation or storage space.
B00C - R0015 - Movement - (27.97 SQM)	Not Applicable	Circulation or storage space.
B00C - R0016 - Movement - (63.64 SQM)	Not Applicable	Circulation or storage space.
B00C - R0017 - Reading Area - (289.68 SQM)	Student Space (134)	
B00C - R0018 - Special Programs Room - (38.82 SQM)	Student Space (18)	
B00D - R0001 - Movement - (37.42 SQM)	Not Applicable	Circulation or storage space.
B00D - R0002 - Movement - (16.45 SQM)	Not Applicable	Circulation or storage space.
B00D - R0007 - Movement - (10.79 SQM)	Not Applicable	Circulation or storage space.
B00D - R0008 - Practical Activities - 1hb - (47.39 SQM)	Student Space (21)	
B00D - R0009 - Withdrawal Space - 1hb - (19.11 SQM)	Student Space (8)	
B00D - R0010 - Movement - (8.35 SQM)	Not Applicable	Circulation or storage space.
B00D - R0011 - Practical Activities - 1hb - (35.41 SQM)	Student Space (16)	
B00D - R0012 - Withdrawal Space - 1hb - (12.04 SQM)	Student Space (5)	
B00D - R0014 - Home Base - (57.04 SQM) - Teaching Space: 1	Student Space (26)	
B00D - R0015 - Movement - (10.75 SQM)	Not Applicable	Circulation or storage space.
B00D - R0017 - Home Base - (57.87 SQM) - Teaching Space: 1	Student Space (26)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00D - R0018 - Movement - (7.58 SQM)	Not Applicable	Circulation or storage space.
B00D - R0019 - Withdrawal Space - 1hb - (12.43 SQM)	● Student Space (5)	
B00D - R0020 - Home Base - (56.55 SQM) - Teaching Space: 1	● Student Space (26)	
B00D - R0021 - Movement - (23.7 SQM)	Not Applicable	Circulation or storage space.
B00D - R0023 - Movement - (27.96 SQM)	Not Applicable	Circulation or storage space.
B00D - R0024 - Home Base - (56.55 SQM) - Teaching Space: 1	● Student Space (26)	
B00D - R0025 - Withdrawal Space - 1hb - (12.43 SQM)	● Student Space (5)	
B00D - R0027 - Home Base - (56.03 SQM) - Teaching Space: 1	● Student Space (25)	
B00D - R0029 - Movement - (8.04 SQM)	Not Applicable	Circulation or storage space.
B00D - R0030 - Movement - (49.94 SQM)	Not Applicable	Circulation or storage space.
B00D - R0032 - Movement - (20.75 SQM)	Not Applicable	Circulation or storage space.
B00D - R0034 - Movement - (9.28 SQM)	Not Applicable	Circulation or storage space.
B00E - R0005 - Movement - (47.52 SQM)	Not Applicable	Circulation or storage space.
B00E - R0006 - Raised Platform - (33.35 SQM)	Not Applicable	Circulation or storage space.
B00E - R0007 - Communal Space - (214.77 SQM)	● Student Space (99)	
B00E - R0008 - Special Programs Room - (25.61 SQM)	● Student Space (11)	
B00E - R0009 - Movement - (11.98 SQM)	Not Applicable	Circulation or storage space.
B00E - R0013 - Canteen - (55.8 SQM)	Not Applicable	Circulation or storage space.
B00F - R0001 - Movement - (48.8 SQM)	Not Applicable	Circulation or storage space.
B00F - R0007 - Movement - (111.61 SQM)	Not Applicable	Circulation or storage space.
B00F - R0008 - Withdrawal Space - 1hb - (12.34 SQM)	● Student Space (5)	
B00F - R0014 - Home Base - (56.5 SQM) - Teaching Space: 1	● Student Space (26)	
B00F - R0015 - Movement - (8.11 SQM)	Not Applicable	Circulation or storage space.
B00F - R0016 - Withdrawal Space - 1hb - (12.41 SQM)	● Student Space (5)	
B00F - R0017 - Movement - (27.17 SQM)	Not Applicable	Circulation or storage space.
B00F - R0018 - Home Base - (56.72 SQM) - Teaching Space: 1	● Student Space (26)	
B00F - R0021 - Home Base - (56.17 SQM) - Teaching Space: 1	● Student Space (26)	
B00F - R0022 - Withdrawal Space - 1hb - (12.33 SQM)	● Student Space (5)	
B00F - R0023 - Movement - (8.15 SQM)	Not Applicable	Circulation or storage space.
B00F - R0024 - Home Base - (56.85 SQM) - Teaching Space: 1	● Student Space (26)	
B00F - R0027 - Movement - (73.82 SQM)	Not Applicable	Circulation or storage space.
B00F - R0028 - Withdrawal Space - 2hb - (24.12 SQM)	● Student Space (11)	
B00H - R0001 - Movement - (38.55 SQM)	Not Applicable	Circulation or storage space.
B00H - R0002 - Practical Activities - 1hb - (19.44 SQM)	● Student Space (9)	
B00H - R0004 - Home Base - (59.31 SQM) - Teaching Space: 1	● Student Space (27)	
B00H - R0005 - Withdrawal Space - 2hb - (11.38 SQM)	● Student Space (5)	
B00H - R0006 - Home Base - (59.31 SQM) - Teaching Space: 1	● Student Space (27)	
B00H - R0008 - Practical Activities - 1hb - (19.44 SQM)	● Student Space (9)	
B00I - R0002 - Practical Activities - 1hb - (19.27 SQM)	● Student Space (8)	
B00I - R0004 - Home Base - (59.42 SQM) - Teaching Space: 1	● Student Space (27)	
B00I - R0005 - Withdrawal Space - 2hb - (10.69 SQM)	● Student Space (4)	
B00I - R0006 - Home Base - (59.42 SQM) - Teaching Space: 1	● Student Space (27)	
B00I - R0008 - Practical Activities - 1hb - (19.26 SQM)	● Student Space (8)	