


VENTILATION AUDIT REPORT

SCHOOL:	Tuncurry Public School (4533)
AMU REGION:	North Coast
STATE ELECTORATE:	Myall Lakes
LOCAL GOVERNMENT AREA:	Mid-Coast

4533 - Tuncurry Public School
Site Plan (11505)

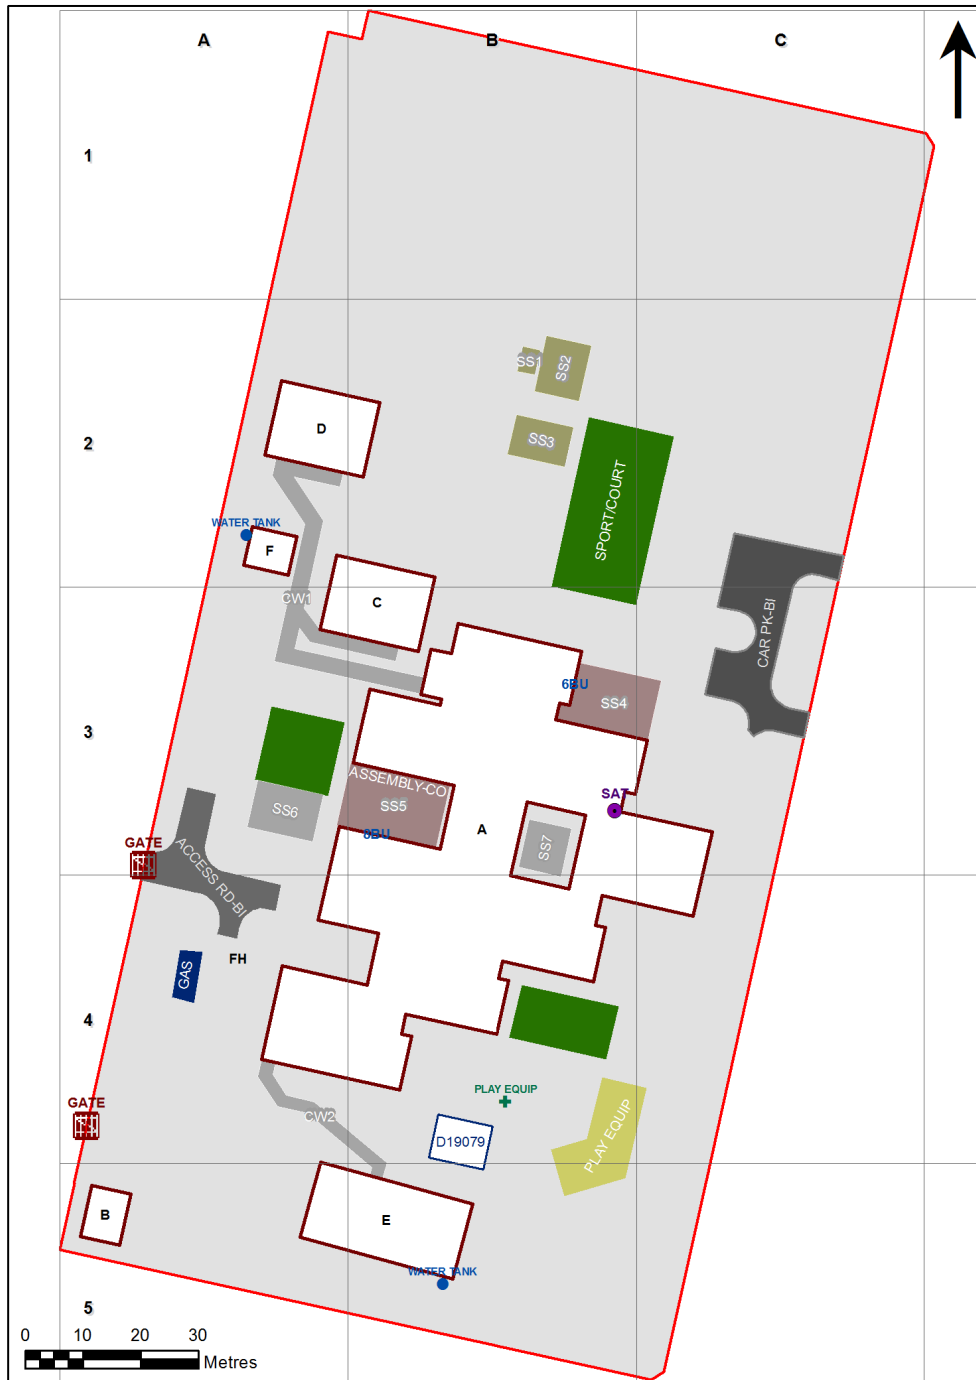

1:870

Printed: 20-Jul-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - M0001 - Staff Room Annexe - (14.55 SQM)	Office (3)	
B00A - R0001 - Movement - (11.97 SQM)	Not Applicable	Circulation or storage space.
B00A - R0002 - Home Base - (59.08 SQM) - Teaching Space: 1	Student Space (27)	
B00A - R0004 - Withdrawal Space - 1hb - (10.01 SQM)	Student Space (4)	
B00A - R0005 - Movement - (16.65 SQM)	Not Applicable	Circulation or storage space.
B00A - R0006 - Practical Activities - 1hb - (18.34 SQM)	Student Space (8)	
B00A - R0007 - Movement - (9.67 SQM)	Not Applicable	Circulation or storage space.
B00A - R0010 - Practical Activities - 1hb - (35.8 SQM)	Student Space (16)	
B00A - R0012 - Movement - (9.66 SQM)	Not Applicable	Circulation or storage space.
B00A - R0014 - Withdrawal Space - 1hb - (24.96 SQM)	Student Space (11)	
B00A - R0015 - Home Base - (58.34 SQM) - Teaching Space: 1	Student Space (27)	
B00A - R0017 - Movement - (18.26 SQM)	Not Applicable	Circulation or storage space.
B00A - R0018 - Movement - (17.47 SQM)	Not Applicable	Circulation or storage space.
B00A - R0019 - Practical Activities - 1hb - (19.67 SQM)	Student Space (9)	
B00A - R0020 - Home Base - (58.93 SQM) - Teaching Space: 1	Student Space (27)	
B00A - R0022 - Withdrawal Space - 1hb - (10.08 SQM)	Student Space (4)	
B00A - R0024 - Home Base - (58.16 SQM) - Teaching Space: 1	Student Space (26)	
B00A - R0026 - Movement - (9.67 SQM)	Not Applicable	Circulation or storage space.
B00A - R0027 - Practical Activities - 1hb - (18.04 SQM)	Student Space (8)	
B00A - R0029 - Practical Activities - 1hb - (9.39 SQM)	Student Space (4)	
B00A - R0030 - Movement - (42.4 SQM)	Not Applicable	Circulation or storage space.
B00A - R0033 - Reading Area - (196.22 SQM)	Student Space (91)	
B00A - R0036 - Seminar/Study - (8.75 SQM)	Office (2)	
B00A - R0037 - Seminar/Study - (8.75 SQM)	Office (2)	
B00A - R0039 - Movement - (21.07 SQM)	Not Applicable	Circulation or storage space.
B00A - R0043 - Movement - (11.95 SQM)	Not Applicable	Circulation or storage space.
B00A - R0044 - Entry Vestibule - (20.28 SQM)	Not Applicable	Circulation or storage space.
B00A - R0045 - Sick Bay - (8.47 SQM)	Student Space (3)	
B00A - R0046 - Movement - (44.44 SQM)	Not Applicable	Circulation or storage space.
B00A - R0047 - Interview - (12.21 SQM)	Office (3)	
B00A - R0048 - Interview - (13.73 SQM)	Office (3)	
B00A - R0049 - Clerical Office - (13.81 SQM)	Office (3)	
B00A - R0050 - Clerical Office - (16.57 SQM)	Office (4)	
B00A - R0051 - Duplicating Workroom - (21.53 SQM)	Office (5)	
B00A - R0057 - Principal - (21.78 SQM)	Office (5)	
B00A - R0058 - Staff Room - (54.04 SQM)	Office (13)	
B00A - R0062 - Movement - (47.43 SQM)	Not Applicable	Circulation or storage space.
B00A - R0069 - Movement - (5.36 SQM)	Not Applicable	Circulation or storage space.
B00A - R0071 - Movement - (26.83 SQM)	Not Applicable	Circulation or storage space.
B00A - R0072 - Movement - (12.03 SQM)	Not Applicable	Circulation or storage space.
B00A - R0073 - Home Base - (58.37 SQM) - Teaching Space: 1	Student Space (27)	
B00A - R0074 - Withdrawal Space - 1hb - (10.1 SQM)	Student Space (4)	
B00A - R0076 - Movement - (8.96 SQM)	Not Applicable	Circulation or storage space.
B00A - R0077 - Practical Activities - 1hb - (20.02 SQM)	Student Space (9)	
B00A - R0079 - Movement - (9.71 SQM)	Not Applicable	Circulation or storage space.
B00A - R0080 - Practical Activities - 1hb - (17.86 SQM)	Student Space (8)	
B00A - R0081 - Duplicating Workroom - (7.92 SQM)	Office (1)	
B00A - R0082 - Movement - (10.26 SQM)	Not Applicable	Circulation or storage space.
B00A - R0084 - Home Base - (58.32 SQM) - Teaching Space: 1	Student Space (27)	
B00A - R0085 - Movement - (50.7 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0087 - Raised Platform - (30.41 SQM)	Not Applicable	Circulation or storage space.
B00A - R0088 - Communal Space - (184.32 SQM)	● Student Space (85)	
B00A - R0095 - Canteen - (28.5 SQM)	Not Applicable	Circulation or storage space.
B00A - R0100 - Movement - (16.35 SQM)	Not Applicable	Circulation or storage space.
B00A - R0102 - Home Base - (58.63 SQM) - Teaching Space: 1	● Student Space (27)	
B00A - R0103 - Movement - (11.95 SQM)	Not Applicable	Circulation or storage space.
B00A - R0104 - Withdrawal Space - 1hb - (10.1 SQM)	● Student Space (4)	
B00A - R0107 - Movement - (9.56 SQM)	Not Applicable	Circulation or storage space.
B00A - R0108 - Practical Activities - 1hb - (35.61 SQM)	● Student Space (16)	
B00A - R0109 - Home Base - (58.27 SQM) - Teaching Space: 1	● Student Space (27)	
B00A - R0112 - Movement - (23.69 SQM)	Not Applicable	Circulation or storage space.
B00A - R0113 - Movement - (9.66 SQM)	Not Applicable	Circulation or storage space.
B00A - R0114 - Staff Room Annexe - (8.07 SQM)	● Office (2)	
B00A - R0115 - Movement - (17.29 SQM)	Not Applicable	Circulation or storage space.
B00A - R0116 - Practical Activities - 1hb - (19.7 SQM)	● Student Space (9)	
B00A - R0117 - Home Base - (58.42 SQM) - Teaching Space: 1	● Student Space (27)	
B00A - R0119 - Withdrawal Space - 1hb - (10.06 SQM)	● Student Space (4)	
B00A - R0122 - Movement - (9.61 SQM)	Not Applicable	Circulation or storage space.
B00A - R0123 - Practical Activities - 1hb - (18.26 SQM)	● Student Space (8)	
B00A - R0125 - Movement - (9 SQM)	Not Applicable	Circulation or storage space.
B00A - R0127 - Home Base - (58.55 SQM) - Teaching Space: 1	● Student Space (27)	
B00A - R0130 - Movement - (11.12 SQM)	Not Applicable	Circulation or storage space.
B00A - R0133 - Movement - (11.95 SQM)	Not Applicable	Circulation or storage space.
B00C - R0002 - Practical Activities - 1hb - (19.4 SQM)	● Student Space (9)	
B00C - R0004 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R0005 - Withdrawal Space - 2hb - (11.36 SQM)	● Student Space (5)	
B00C - R0006 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00C - R0008 - Practical Activities - 1hb - (19.41 SQM)	● Student Space (9)	
B00D - R0002 - Practical Activities - 1hb - (19.4 SQM)	● Student Space (9)	
B00D - R0004 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0005 - Withdrawal Space - 2hb - (11.36 SQM)	● Student Space (5)	
B00D - R0006 - Home Base - (59.2 SQM) - Teaching Space: 1	● Student Space (27)	
B00D - R0008 - Practical Activities - 1hb - (19.41 SQM)	● Student Space (9)	
B00E - R0005 - Special Programs Room - (38.43 SQM)	● Student Space (17)	
B00E - R0006 - Special Programs Room - (5.23 SQM)	● Student Space (2)	
B00E - R0008 - Practical Activities/Movement - 1hb - (19.76 SQM)	● Student Space (9)	
B00E - R0010 - Home Base - (59.39 SQM) - Teaching Space: 1	● Student Space (27)	
B00E - R0011 - Withdrawal Space - 2hb - (11.68 SQM)	● Student Space (5)	
B00E - R0012 - Home Base - (59.98 SQM) - Teaching Space: 1	● Student Space (27)	
B00E - R0014 - Practical Activities/Movement - 1hb - (19.77 SQM)	● Student Space (9)	
OS 606 19079 - OS 606 19079 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19079 - OS 606 19079 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19079 - OS 606 19079 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19079 - OS 606 19079 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19080 - OS 606 19080 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19080 - OS 606 19080 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19080 - OS 606 19080 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	
OS 606 19080 - OS 606 19080 - Learning Unit - Standard With P.A.A A/C - (76 SQM)	● Student Space (35)	