


VENTILATION AUDIT REPORT

SCHOOL:	Ungarie Central School (3311)
AMU REGION:	Southern NSW
STATE ELECTORATE:	Cootamundra
LOCAL GOVERNMENT AREA:	Bland

3311 - Ungarie Central School
Site Plan (11514)

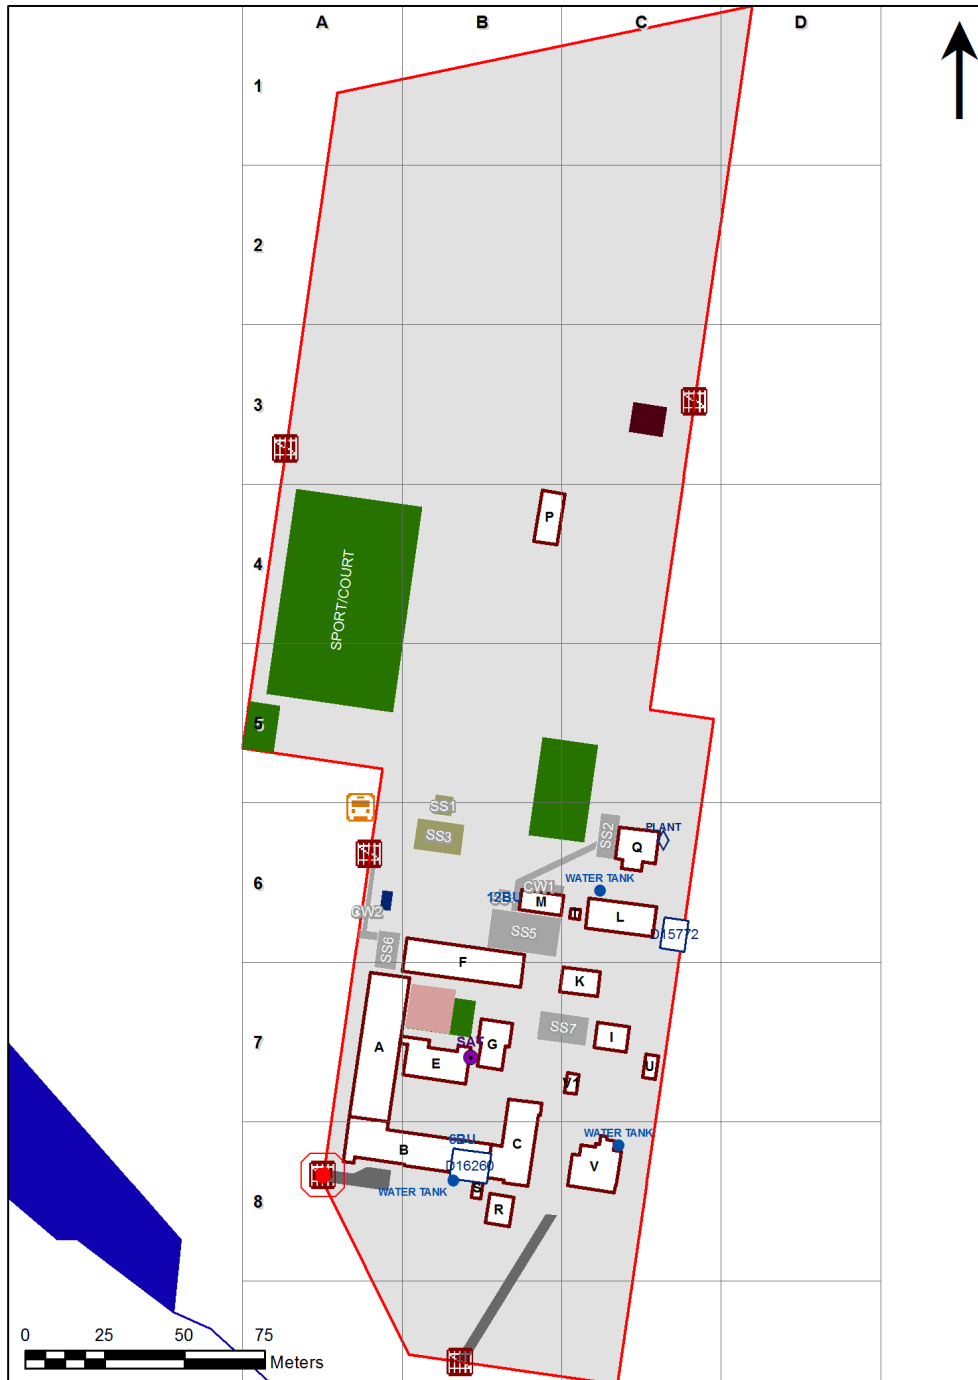


1:1,572

Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - Movement - (79.54 SQM)	Not Applicable	Circulation or storage space.
B00A - R0002 - Seminar/Study - (13.08 SQM)	Office (3)	
B00A - R0003 - Seminar/Study - (12.75 SQM)	Office (3)	
B00A - R0004 - Reading Area - (85.51 SQM)	Student Space (39)	
B00A - R0007 - Movement - (11.44 SQM)	Not Applicable	Circulation or storage space.
B00A - R0021 - Food Technology L.S. - (64.47 SQM) - Teaching Space: 1	Student Space (29)	
B00A - R0024 - Movement - (81.8 SQM)	Not Applicable	Circulation or storage space.
B00A - R0025 - Principal - (15.59 SQM)	Office (3)	
B00A - R0026 - Movement - (16.83 SQM)	Not Applicable	Circulation or storage space.
B00A - R0027 - Clerical Office - (17.64 SQM)	Office (4)	
B00A - R0028 - Sick Bay - (12.91 SQM)	Student Space (5)	
B00A - R0029 - Duplicating Workroom - (12.62 SQM)	Office (3)	
B00B - R0002 - Movement - (172.06 SQM)	Not Applicable	Circulation or storage space.
B00B - R0003 - Canteen - (35.35 SQM)	Not Applicable	Circulation or storage space.
B00B - R0010 - Materials Technology L.S. - (100.04 SQM) - Teaching Space: 1	Student Space (46)	
B00B - R0011 - Welding Area - (5.51 SQM)	Not Applicable	Circulation or storage space.
B00B - R0013 - Movement - (69.01 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Movement - (36.69 SQM)	Not Applicable	Circulation or storage space.
B00C - R0011 - Movement - (41.99 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Movement - (6.41 SQM)	Not Applicable	Circulation or storage space.
B00E - R0002 - Movement - (6.32 SQM)	Not Applicable	Circulation or storage space.
B00E - R0007 - Laboratory L.S. - (83.21 SQM) - Teaching Space: 1	Student Space (38)	
B00E - R0008 - Staff Study - (21.28 SQM)	Office (5)	
B00E - R0010 - Movement - (7.08 SQM)	Not Applicable	Circulation or storage space.
B00E - R0012 - Staff Study - (23.92 SQM)	Office (5)	
B00E - R0013 - Movement - (20.06 SQM)	Not Applicable	Circulation or storage space.
B00F - R0001 - Movement - (67.93 SQM)	Not Applicable	Circulation or storage space.
B00F - R0002 - Computer Learning Space - (58.22 SQM) - Teaching Space: 1	Student Space (27)	
B00F - R0006 - Home Base - (57.59 SQM) - Teaching Space: 1	Student Space (26)	
B00F - R0007 - Home Base - (57.59 SQM) - Teaching Space: 1	Student Space (26)	
B00F - R0009 - Deputy Principal - (15.65 SQM)	Office (3)	
B00F - R0011 - Home Base - (58.15 SQM) - Teaching Space: 1	Student Space (26)	
B00G - R0001 - General Learning Space - (46.21 SQM) - Teaching Space: 1	Student Space (21)	
B00G - R0002 - Withdrawal Space - 1hb - (30.27 SQM)	Student Space (14)	
B00G - R0005 - Staff Room Annexe - (6.74 SQM)	Office (1)	
B00G - R0006 - Movement - (16.92 SQM)	Not Applicable	Circulation or storage space.
B00G - R0007 - Interview - (8.53 SQM)	Office (2)	
B00I - R0003 - General Learning Space - Type 1 - (30.21 SQM) - Teaching Space: 1	Student Space (14)	
B00I - R0004 - Practical Activities - 1hb - (11.06 SQM)	Student Space (5)	
B00I - R0005 - Movement - (14.7 SQM)	Not Applicable	Circulation or storage space.
B00K - R0001 - Movement - (33.98 SQM)	Not Applicable	Circulation or storage space.
B00K - R0002 - General Learning Space - (40.82 SQM) - Teaching Space: 1	Student Space (18)	
B00L - R0003 - Home Base - (78.41 SQM) - Teaching Space: 1	Student Space (36)	
B00L - R0004 - Practical Activities - 1hb - (46.6 SQM)	Student Space (21)	
B00L - R0006 - Movement - (36.56 SQM)	Not Applicable	Circulation or storage space.
B00P - R0001 - Movement - (36.32 SQM)	Not Applicable	Circulation or storage space.
B00Q - R0001 - Communal Space - (113.61 SQM)	Student Space (52)	
B00T - R0001 - Practical Activities - (8.1 SQM)	Student Space (3)	
NS 200 16260 - NS 200 16260 - Art Learning Space/Workshop/Bulk Store - (95 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
OS 521 15772 - OS 521 15772 - Staff Study - (76 SQM)	 Office (19)	