


VENTILATION AUDIT REPORT

SCHOOL:	Wauchope High School (8173)
AMU REGION:	North Coast
STATE ELECTORATE:	Oxley
LOCAL GOVERNMENT AREA:	Port Macquarie-Hastings

8173 - Wauchope High School
Site Plan (1990)

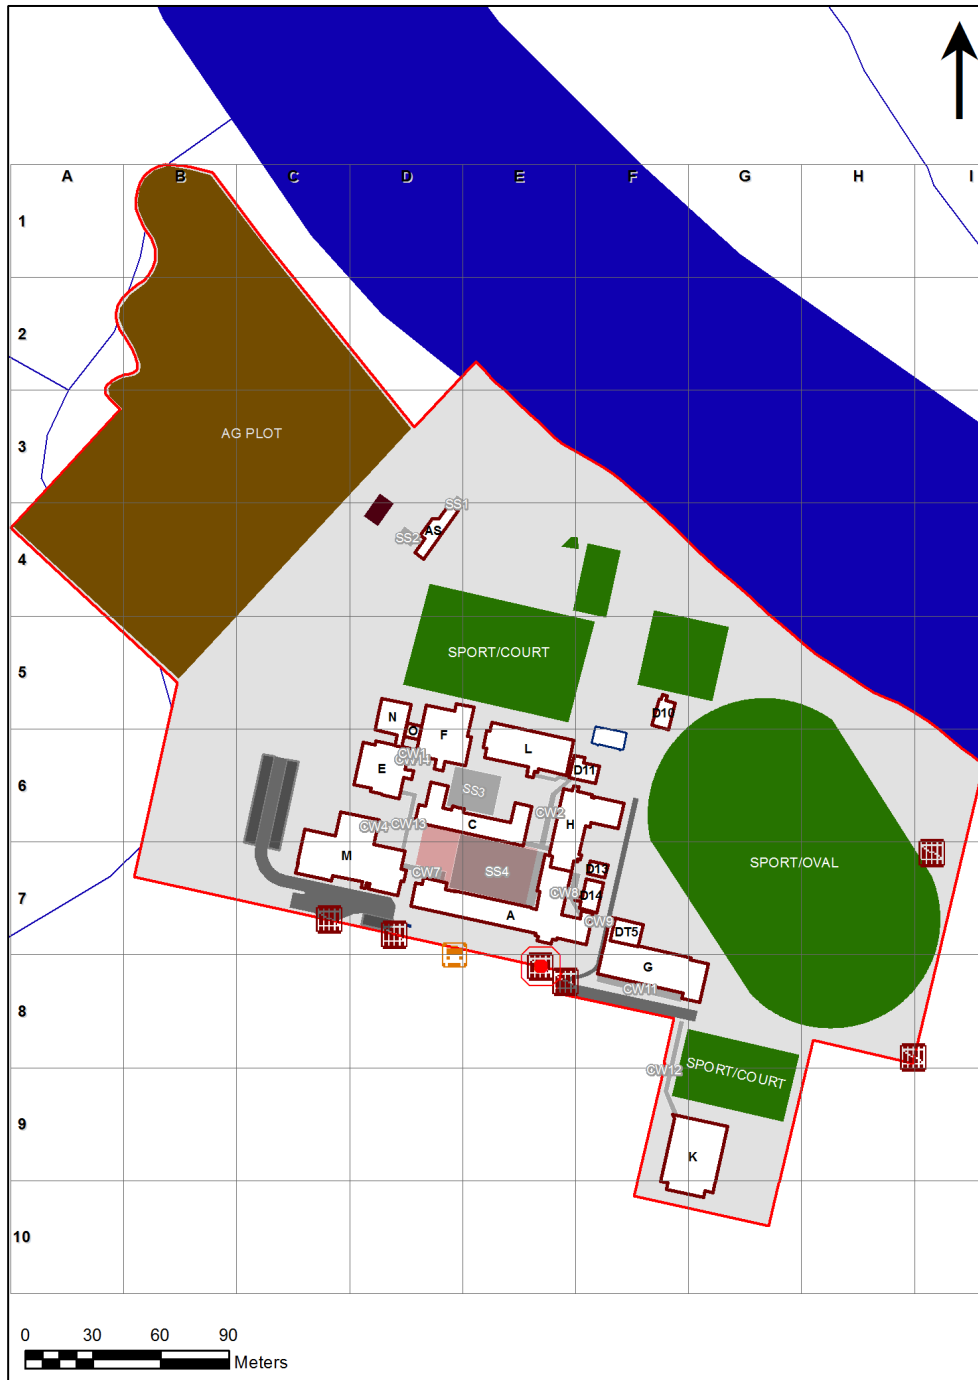

1:2,220




















Printed: 21-Mar-2020

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0005 - Interview/Office - Type 1 - (10.54 SQM)	Office (2)	
B00A - R0007 - Administration - Clerical - (23.62 SQM)	Office (5)	
B00A - R0008 - Administration - Clerical - (12 SQM)	Office (3)	
B00A - R0011 - Principal Office - (21.32 SQM)	Office (5)	
B00A - R0012 - Administration - Clerical - (14.92 SQM)	Office (3)	
B00A - R0017 - Movement - (11.95 SQM)	Not Applicable	Circulation or storage space.
B00A - R0018 - Public Entry - (30.22 SQM)	Not Applicable	Circulation or storage space.
B00A - R0020 - General Learning Space - (53.37 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R0021 - General Learning Space - (53.37 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R0022 - General Learning Space - (53.36 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R0023 - General Learning Space - (53.22 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R0024 - General Learning Space - (53.29 SQM) - Teaching Space: 1	Student Space (24)	
B00A - R0025 - Duplicating Workroom - (26.3 SQM)	Office (6)	
B00A - R0027 - Staff Study - (35.53 SQM)	Office (8)	
B00A - R0028 - Administration - Clerical - (12.22 SQM)	Office (3)	
B00A - R0030 - Staff Study - (19.1 SQM)	Office (4)	
B00A - R0039 - Movement - (42.85 SQM)	Not Applicable	Circulation or storage space.
B00A - R0041 - Deputy Principal Office - (22.94 SQM)	Office (5)	
B00A - R0042 - Movement - (16.18 SQM)	Not Applicable	Circulation or storage space.
B00A - R0045 - Clinic - Girls - (9.61 SQM)	Office (2)	
B00A - R0046 - Clinic - Boys - (9.63 SQM)	Office (2)	
B00A - R0047 - Movement - (22.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R0048 - Movement - (13.19 SQM)	Not Applicable	Circulation or storage space.
B00A - R0050 - Movement - (114.91 SQM)	Not Applicable	Circulation or storage space.
B00A - R0051 - Administration - Clerical - (26.76 SQM)	Office (6)	
B00A - R0052 - Deputy Principal Office - (16.17 SQM)	Office (4)	
B00A - R0053 - Entry - (8.71 SQM)	Not Applicable	Circulation or storage space.
B00A - R1001 - Staff Study - (20.62 SQM)	Office (5)	
B00A - R1004 - Staff Study - (21.33 SQM)	Office (5)	
B00A - R1005 - Commonroom - (70.75 SQM)	Office (17)	
B00A - R1008 - Music Learning Space - (51.55 SQM) - Teaching Space: 1	Student Space (23)	
B00A - R1009 - General Learning Space - (55.28 SQM) - Teaching Space: 1	Student Space (25)	
B00A - R1010 - General Learning Space - (55.95 SQM) - Teaching Space: 1	Student Space (25)	
B00A - R1011 - General Learning Space - (56.03 SQM) - Teaching Space: 1	Student Space (25)	
B00A - R1012 - Computer Learning Space - (55.27 SQM) - Teaching Space: 1	Student Space (25)	
B00A - R1013 - Computer Learning Space - (55.87 SQM) - Teaching Space: 1	Student Space (25)	
B00A - R1014 - Preparation - (27.41 SQM)	Not Applicable	Circulation or storage space.
B00A - R1015 - Laboratory L.S. - (89.15 SQM) - Teaching Space: 1	Student Space (41)	
B00A - R1022 - Movement - (170.95 SQM)	Not Applicable	Circulation or storage space.
B00C - R0001 - Movement - (55.23 SQM)	Not Applicable	Circulation or storage space.
B00C - R0006 - Student Canteen - (52.15 SQM)	Not Applicable	Circulation or storage space.
B00C - R0009 - Movement - (135.66 SQM)	Not Applicable	Circulation or storage space.
B00C - R0010 - Movement - (40.42 SQM)	Not Applicable	Circulation or storage space.
B00E - R0001 - Staff Study - (58.56 SQM)	Office (14)	
B00E - R0002 - Preparation - (43.48 SQM)	Not Applicable	Circulation or storage space.
B00E - R0003 - Staff Study - (7.33 SQM)	Office (1)	
B00E - R0008 - Laboratory L.S. - (91.73 SQM) - Teaching Space: 1	Student Space (42)	
B00E - R0009 - Laboratory L.S. - (91.83 SQM) - Teaching Space: 1	Student Space (42)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00E - R1018 - Interview/Office - Type 1 - (12.76 SQM)	Office (3)	
B00E - R1019 - Interview/Office - Type 1 - (12.8 SQM)	Office (3)	
B00E - R1020 - Shared Study Space - (76.14 SQM)	Office (19)	
B00E - R1021 - General Learning Space - Type 2 - (63.82 SQM) - Teaching Space: 1	Student Space (29)	
B00E - R1022 - Seminar - (23.84 SQM)	Office (5)	
B00E - R1023 - General Learning Space - Type 1 - (58.87 SQM) - Teaching Space: 1	Student Space (27)	
B00E - R1025 - General Learning Space - Type 1 - (56.72 SQM) - Teaching Space: 1	Student Space (26)	
B00F - R0001 - Art Learning Space - (65.69 SQM) - Teaching Space: 1	Student Space (30)	
B00F - R0002 - Laboratory L.S. - (91.47 SQM) - Teaching Space: 1	Student Space (42)	
B00F - R0009 - Art Learning Space - (80.1 SQM) - Teaching Space: 1	Student Space (37)	
B00F - R1001 - General Learning Space - (66.1 SQM) - Teaching Space: 1	Student Space (30)	
B00F - R1008 - Staff Study - (25.43 SQM)	Office (6)	
B00F - R1010 - General Learning Space - (53.14 SQM) - Teaching Space: 1	Student Space (24)	
B00F - R1013 - Interview/Office - Type 1 - (12.99 SQM)	Office (3)	
B00F - R1016 - General Learning Space - (54.16 SQM) - Teaching Space: 1	Student Space (25)	
B00F - R1017 - General Learning Space - (49.25 SQM) - Teaching Space: 1	Student Space (22)	
B00F - R1018 - Movement - (25.29 SQM)	Not Applicable	Circulation or storage space.
B00G - R0024 - Performance Workshop - (98.24 SQM)	Student Space (45)	
B00G - R0028 - Movement - (8.48 SQM)	Not Applicable	Circulation or storage space.
B00G - R0029 - Practice/Seminar - (26.21 SQM)	Not Applicable	Circulation or storage space.
B00G - R0030 - General Learning Space - Type 1 - (56.73 SQM) - Teaching Space: 1	Student Space (26)	
B00G - R0031 - Seminar - Type 1 - (32.15 SQM)	Office (8)	
B00G - R0032 - Practical Activities - (5.01 SQM)	Student Space (2)	
B00G - R0033 - General Learning Space - Type 10 - (65.34 SQM) - Teaching Space: 0.5	Student Space (30)	
B00G - R0040 - Practical Activities - (7.54 SQM)	Student Space (3)	
B00G - R0041 - General Learning Space - S/P - (63.53 SQM) - Teaching Space: 1	Student Space (29)	
B00H - R0007 - General Assistants - (6.78 SQM)	Office (1)	
B00H - R0008 - Stage - (80.51 SQM)	Not Applicable	Circulation or storage space.
B00H - R0009 - Multi-Purpose Space - (278.44 SQM)	Student Space (129)	
B00H - R0012 - Movement - (10.83 SQM)	Not Applicable	Circulation or storage space.
B00H - R0013 - Interview/Office - Type 1 - (14.01 SQM)	Office (3)	
B00H - R0016 - Music Learning Space - (74.36 SQM) - Teaching Space: 1	Student Space (34)	
B00H - R0021 - Practice/Seminar - (8.65 SQM)	Not Applicable	Circulation or storage space.
B00H - R0022 - Movement - (19.41 SQM)	Not Applicable	Circulation or storage space.
B00K - R0001 - Gymnasium - (479.03 SQM)	Student Space (222)	
B00K - R0004 - Movement - (5.1 SQM)	Not Applicable	Circulation or storage space.
B00K - R0018 - Staff Study - (24.2 SQM)	Office (6)	
B00L - R0001 - Movement - (10.08 SQM)	Not Applicable	Circulation or storage space.
B00L - R0002 - Entry - (9.99 SQM)	Not Applicable	Circulation or storage space.
B00L - R0003 - Main Area - (432.3 SQM)	Not Applicable	Circulation or storage space.
B00L - R0005 - Seminar - (11.33 SQM)	Office (2)	
B00L - R0006 - Seminar - (12.84 SQM)	Office (3)	
B00L - R0007 - Seminar - (14.34 SQM)	Office (3)	
B00L - R0008 - Audio Visual Workroom - (27.19 SQM)	Student Space (12)	
B00L - R0009 - Workroom - (36.72 SQM)	Office (9)	
B00M - R0005 - Wood Technology Bay - (59.01 SQM)	Not Applicable	Circulation or storage space.
B00M - R0006 - Outdoor Workshop - (82.59 SQM)	Not Applicable	Circulation or storage space.
B00M - R0007 - Welding Area - (12.11 SQM)	Not Applicable	Circulation or storage space.
B00M - R0008 - Materials Workshop - Type 2 - (119.99 SQM)	Student Space (55)	

Entity Location	Audit Condition Classification (Capacity)	Comment
B00M - R0010 - Materials Workshop - Type 2 - (119.33 SQM)	 Student Space (55)	
B00M - R0014 - General Learning Space - Type 8 - (59.94 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0015 - General Learning Space - Type 9 - (59.82 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0016 - General Learning Space - Type 9 - (60.12 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0017 - General Learning Space - Type 8 - (60.07 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R0020 - Movement - (6.51 SQM)	Not Applicable	Circulation or storage space.
B00M - R1003 - Staff Study - (53.87 SQM)	 Office (13)	
B00M - R1004 - General Learning Space - Type 6 - (59.73 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R1005 - Seminar - Type 2 - (21.77 SQM)	 Office (5)	
B00M - R1008 - Kitchen - Type 2 - (106.67 SQM)	 Student Space (49)	
B00M - R1009 - Movement - (18.46 SQM)	Not Applicable	Circulation or storage space.
B00M - R1012 - Kitchen - Type 1 - (106.52 SQM)	 Student Space (49)	
B00M - R1017 - General Learning Space - Type 7 - (60.3 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R1018 - General Learning Space - Type 6 - (59.86 SQM) - Teaching Space: 1	 Student Space (27)	
B00M - R1021 - Movement - (6.51 SQM)	Not Applicable	Circulation or storage space.
B00N - R0001 - General Learning Space - (65.16 SQM) - Teaching Space: 1	 Student Space (30)	
B00O - R0001 - Growing/Breeding - (33.03 SQM)	Not Applicable	Circulation or storage space.
BD10 - R1001 - Movement - (17.57 SQM)	Not Applicable	Circulation or storage space.
BD10 - R1002 - Interview/Office - Type 1 - (52.34 SQM)	 Office (13)	
BD11 - R0001 - General Learning Space - (39.44 SQM) - Teaching Space: 1	 Student Space (18)	
BD11 - R0002 - Movement - (10.86 SQM)	Not Applicable	Circulation or storage space.
BD11 - R0003 - Movement - (19.04 SQM)	Not Applicable	Circulation or storage space.
BD13 - R0001 - Staff Study - (28.1 SQM)	 Office (7)	
BD13 - R0002 - Movement - (12.68 SQM)	Not Applicable	Circulation or storage space.
BD14 - R0004 - General Learning Space - S/P - (70.74 SQM) - Teaching Space: 1	 Student Space (32)	
BDT5 - R0003 - General Learning Space - S/P - (61.38 SQM) - Teaching Space: 1	 Student Space (28)	
BDT5 - R0005 - Movement - (6.28 SQM)	Not Applicable	Circulation or storage space.
BDT5 - R0008 - Practical Activities - (5.01 SQM)	 Student Space (2)	
OS 700 10591 - OS 700 10591 - Art Learning Space/Workshop/Store - (114 SQM)	Not Applicable	Circulation or storage space.