


VENTILATION AUDIT REPORT

SCHOOL:	Woolgoolga High School (8548)
AMU REGION:	North Coast
STATE ELECTORATE:	Coffs Harbour
LOCAL GOVERNMENT AREA:	Coffs Harbour

8548 - Woolgoolga High School
Site Plan (11936)



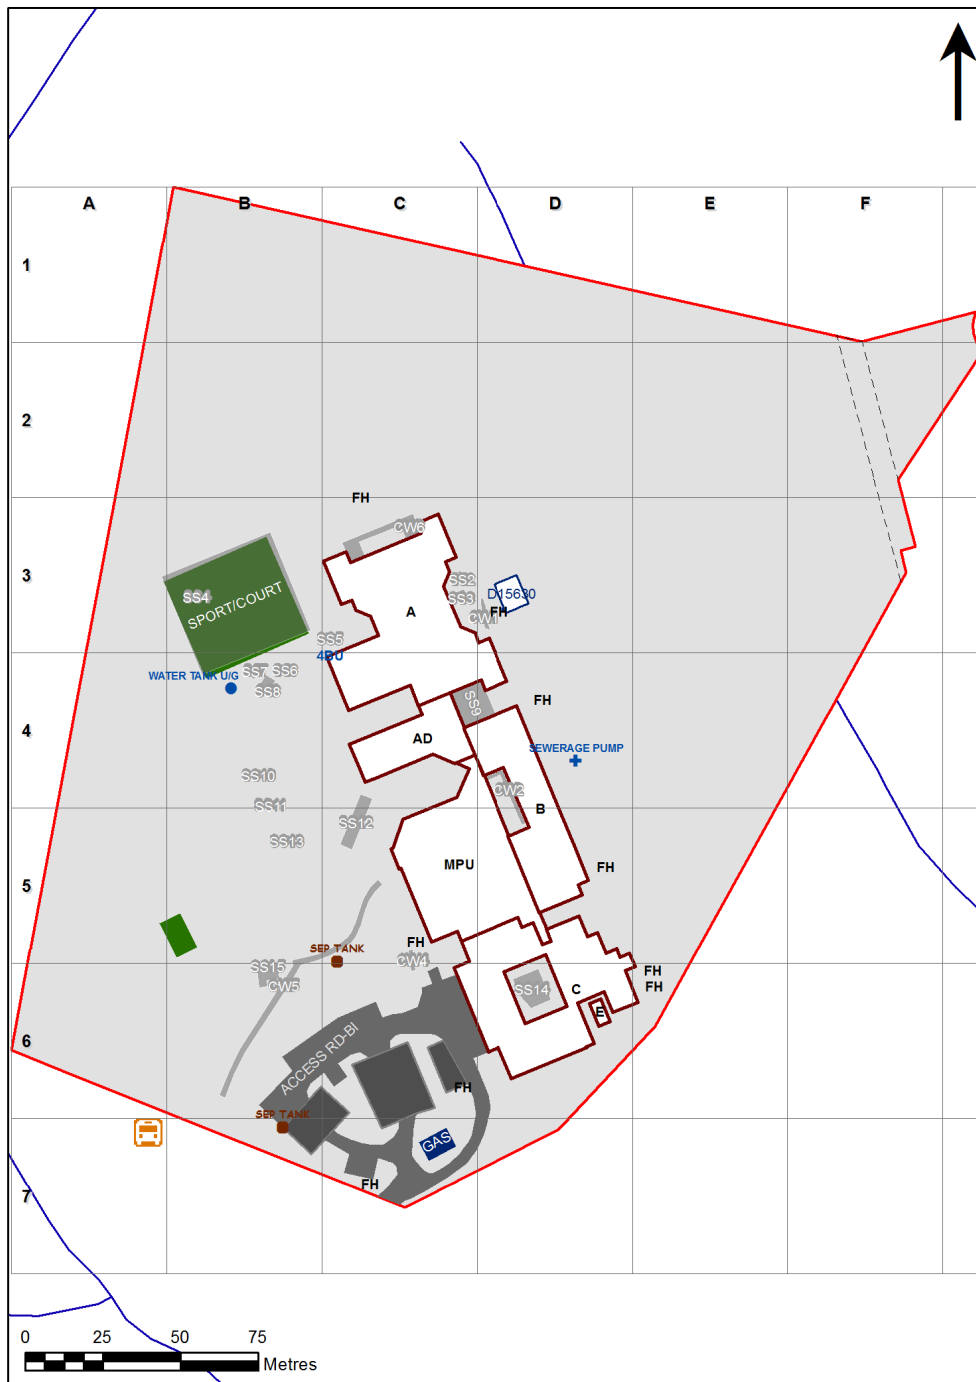



























1:1,615

Printed: 24-Jul-2021

Ventilation Audit Key

Category	Description
	Category A Operate this space in line with COVID safe school operations . It has the required level of natural ventilation. NB. Circulation and storage areas should not be used for groups or gatherings.
	Category B This space should be occupied at 1 person per 4m ² to comply with COVID safe school operations and the guided use of spaces . The report details the number of people who can be accommodated safely in each of the identified spaces.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00A - R0001 - General Learning Space - (48.24 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0002 - General Learning Space - (48.31 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0003 - Study Space - (37.6 SQM)	Not Applicable	Circulation or storage space.
B00A - R0006 - General Learning Space - (48.31 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0007 - General Learning Space - (48.31 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0009 - Study Space - (37.43 SQM)	Not Applicable	Circulation or storage space.
B00A - R0010 - General Learning Space - (48.31 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0011 - General Learning Space - (48.52 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R0012 - Staff Study - (24.82 SQM)	● Office (6)	
B00A - R0015 - Audio Visual Workroom - (31.33 SQM)	● Student Space (14)	
B00A - R0016 - Workroom - (42.24 SQM)	● Office (10)	
B00A - R0017 - Seminar - (12.1 SQM)	● Office (3)	
B00A - R0018 - Seminar - (12.13 SQM)	● Office (3)	
B00A - R0019 - Seminar - (12.17 SQM)	● Office (3)	
B00A - R0020 - Main Area - (319.88 SQM)	Not Applicable	Circulation or storage space.
B00A - R0022 - General Learning Space - (50.08 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0024 - General Learning Space - (39.65 SQM) - Teaching Space: 1	● Student Space (18)	
B00A - R0025 - General Learning Space - (50.37 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0026 - General Learning Space - (50.38 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R0031 - Staff Study - (44.43 SQM)	● Office (11)	
B00A - R0032 - Movement - (355.3 SQM)	Not Applicable	Circulation or storage space.
B00A - R0034 - Movement - (47.44 SQM)	Not Applicable	Circulation or storage space.
B00A - R0039 - Movement - (279.15 SQM)	Not Applicable	Circulation or storage space.
B00A - R1001 - General Learning Space - (48.31 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1002 - General Learning Space - (48.17 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1003 - Study Space - (37.9 SQM)	Not Applicable	Circulation or storage space.
B00A - R1006 - General Learning Space - (48.3 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1007 - General Learning Space - (47.97 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1009 - General Learning Space - (37.43 SQM) - Teaching Space: 1	● Student Space (17)	
B00A - R1010 - General Learning Space - (48.25 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1011 - General Learning Space - (48.25 SQM) - Teaching Space: 1	● Student Space (22)	
B00A - R1012 - Staff Study - (25.23 SQM)	● Office (6)	
B00A - R1017 - Staff Study - (13.18 SQM)	● Office (3)	
B00A - R1018 - Staff Study - (13.25 SQM)	● Office (3)	
B00A - R1022 - Computer Learning Space - (50.23 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1023 - General Learning Space - (39.61 SQM) - Teaching Space: 1	● Student Space (18)	
B00A - R1024 - General Learning Space - (50.3 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1025 - General Learning Space - (50.37 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1026 - Staff Study - (25.7 SQM)	● Office (6)	
B00A - R1030 - Staff Study - (43.95 SQM)	● Office (10)	
B00A - R1033 - Movement - (234.57 SQM)	Not Applicable	Circulation or storage space.
B00A - R1039 - Computer Learning Space - (50.26 SQM) - Teaching Space: 1	● Student Space (23)	
B00A - R1040 - Seminar - (24.57 SQM)	● Office (6)	
B00A - R1041 - Staff Study - (24.91 SQM)	● Office (6)	
B00A - R1043 - Movement - (197.82 SQM)	Not Applicable	Circulation or storage space.
B00B - R0003 - Movement - (11.92 SQM)	Not Applicable	Circulation or storage space.
B00B - R0007 - Laboratory L.S. - (79 SQM) - Teaching Space: 1	● Student Space (36)	
B00B - R0008 - Preparation - (29.87 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B00B - R0009 - Laboratory L.S. - (79.19 SQM) - Teaching Space: 1	 Student Space (36)	
B00B - R0010 - Movement - (41.5 SQM)	Not Applicable	Circulation or storage space.
B00B - R0011 - Preparation - (31.22 SQM)	Not Applicable	Circulation or storage space.
B00B - R0012 - Laboratory L.S. - (79.1 SQM) - Teaching Space: 1	 Student Space (36)	
B00B - R0013 - General Learning Space - Type 7 - (67.5 SQM) - Teaching Space: 1	 Student Space (31)	
B00B - R0014 - General Learning Space - Type 7 - (66.12 SQM) - Teaching Space: 1	 Student Space (30)	
B00B - R0016 - Food Technology L.S. - (103.3 SQM) - Teaching Space: 1	 Student Space (47)	
B00B - R0018 - Preparation - (18.45 SQM)	Not Applicable	Circulation or storage space.
B00B - R0019 - Food Technology L.S. - (103.05 SQM) - Teaching Space: 1	 Student Space (47)	
B00B - R0022 - Staff Study - (22.8 SQM)	 Office (5)	
B00B - R0023 - Movement - (51.68 SQM)	Not Applicable	Circulation or storage space.
B00B - R0024 - Movement - (7.76 SQM)	Not Applicable	Circulation or storage space.
B00B - R0026 - Movement - (31.51 SQM)	Not Applicable	Circulation or storage space.
B00B - R1001 - Laboratory L.S. - (79.01 SQM) - Teaching Space: 1	 Student Space (36)	
B00B - R1002 - Preparation - (28.67 SQM)	Not Applicable	Circulation or storage space.
B00B - R1004 - Laboratory L.S. - (79.01 SQM) - Teaching Space: 1	 Student Space (36)	
B00B - R1005 - Staff Study - (40.63 SQM)	 Office (10)	
B00B - R1007 - Movement - (31.03 SQM)	Not Applicable	Circulation or storage space.
B00B - R1008 - Movement - (11.54 SQM)	Not Applicable	Circulation or storage space.
B00B - R1009 - Staff Lounge - (23.78 SQM)	 Office (5)	
B00B - R1011 - Movement - (62.37 SQM)	Not Applicable	Circulation or storage space.
B00B - R1012 - Practice/Seminar - (30.88 SQM)	Not Applicable	Circulation or storage space.
B00B - R1013 - General Learning Space - Type 1 - (61.93 SQM) - Teaching Space: 1	 Student Space (28)	
B00B - R1014 - General Learning Space - Type 1 - (87.01 SQM) - Teaching Space: 1	 Student Space (40)	
B00B - R1017 - Staff Study - (12.21 SQM)	 Office (3)	
B00B - R1019 - Movement - (9.2 SQM)	Not Applicable	Circulation or storage space.
B00B - R1020 - Movement - (33.64 SQM)	Not Applicable	Circulation or storage space.
B00C - R0003 - Staff Study - (13.68 SQM)	 Office (3)	
B00C - R0004 - Staff Study - (24.8 SQM)	 Office (6)	
B00C - R0009 - Computer Learning Space - (55.61 SQM) - Teaching Space: 1	 Student Space (25)	
B00C - R0010 - Materials Technology L.S. - (89.16 SQM) - Teaching Space: 1	 Student Space (41)	
B00C - R0011 - Wood Technology Bay - (27.54 SQM)	Not Applicable	Circulation or storage space.
B00C - R0013 - Materials Technology L.S. - (88.99 SQM) - Teaching Space: 1	 Student Space (41)	
B00C - R0014 - Materials Technology L.S. - (59.57 SQM) - Teaching Space: 1	 Student Space (27)	
B00C - R0015 - Seminar/Technology Space - (34.22 SQM)	 Office (8)	
B00C - R0016 - Metal Technology Bay - (27.98 SQM)	Not Applicable	Circulation or storage space.
B00C - R0017 - Materials Technology L.S. - (88.56 SQM) - Teaching Space: 1	 Student Space (41)	
B00C - R0019 - Outdoor Workshop - (60.12 SQM)	Not Applicable	Circulation or storage space.
B00C - R0020 - Welding Area - (13.65 SQM)	Not Applicable	Circulation or storage space.
B00C - R0023 - Art Entry/Display - (95.81 SQM)	Not Applicable	Circulation or storage space.
B00C - R0027 - Staff Study - (20.72 SQM)	 Office (5)	
B00C - R0029 - General Learning Space - Type 4 - (58.91 SQM) - Teaching Space: 1	 Student Space (27)	
B00C - R0030 - Workshop - (48.12 SQM)	 Student Space (22)	
B00C - R0032 - General Learning Space - Type 4 - (59.6 SQM) - Teaching Space: 1	 Student Space (27)	
B00C - R0033 - General Learning Space - Type 4 - (59.06 SQM) - Teaching Space: 1	 Student Space (27)	
B00C - R0039 - Movement - (5.42 SQM)	Not Applicable	Circulation or storage space.
B00C - R0042 - General Learning Space - Type 4 - (56.95 SQM) - Teaching Space: 1	 Student Space (26)	
B00C - R0051 - Movement - (260.09 SQM)	Not Applicable	Circulation or storage space.

Entity Location	Audit Condition Classification (Capacity)	Comment
B0AD - R0001 - Public Entry - (18.5 SQM)	Not Applicable	Circulation or storage space.
B0AD - R0002 - Movement - (13.78 SQM)	Not Applicable	Circulation or storage space.
B0AD - R0003 - Principal Office - (18.43 SQM)	Office (4)	
B0AD - R0004 - Clinic - Boys - (13.2 SQM)	Office (3)	
B0AD - R0007 - Clinic - Girls - (12.67 SQM)	Office (3)	
B0AD - R0010 - Deputy Principal Office - (12.17 SQM)	Office (3)	
B0AD - R0014 - Movement - (55.04 SQM)	Not Applicable	Circulation or storage space.
B0AD - R0015 - Staff Lounge - (93.9 SQM)	Office (23)	
B0AD - R0016 - Deputy Principal Office - (24.82 SQM)	Office (6)	
B0AD - R0018 - Administration - Clerical - (19.14 SQM)	Office (4)	
B0AD - R0019 - Administration - Executive - (16.73 SQM)	Office (4)	
B0AD - R0022 - Administration - Clerical - (33.32 SQM)	Office (8)	
B0AD - R0023 - Movement - (90.36 SQM)	Not Applicable	Circulation or storage space.
B0AD - R1006 - Dark Room - (29.63 SQM)	Office (7)	
B0AD - R1008 - Interview/Office - Type 1 - (18.58 SQM)	Office (4)	
B0AD - R1009 - Staff Study - (10.62 SQM)	Office (2)	
B0AD - R1010 - Movement - (41.37 SQM)	Not Applicable	Circulation or storage space.
BMPU - R0005 - Multi-Purpose Space - (468.34 SQM)	Student Space (217)	
BMPU - R0006 - Pupil Entry - (17.01 SQM)	Not Applicable	Circulation or storage space.
BMPU - R0013 - Movement - (12.95 SQM)	Not Applicable	Circulation or storage space.
BMPU - R0014 - Staff Study - (15.27 SQM)	Office (3)	
BMPU - R0016 - Movement - (12.95 SQM)	Not Applicable	Circulation or storage space.
BMPU - R0018 - Stage - (97.08 SQM)	Not Applicable	Circulation or storage space.
BMPU - R0023 - Student Canteen - (58.39 SQM)	Not Applicable	Circulation or storage space.
BMPU - R0027 - Movement - (473.72 SQM)	Not Applicable	Circulation or storage space.
OS 522 12522 - OS 522 12522 - Staff Study - (38 SQM)	Office (9)	
OS 602 15630 - OS 602 15630 - Learning Unit - Standard With P.A.A. - (76 SQM)	Student Space (35)	